

## Attachment B

~~40.25.15 APPENDIX 15 TO ATTACHMENT HH~~

~~STANDARD~~

GENERATOR INTERCONNECTION AGREEMENT

~~(Applicable to Generating Facilities, Class Year Transmission Projects, and Cluster Study  
Transmission Projects)~~

---

~~SERVICE AGREEMENT NO. [●]~~

~~SERVICE AGREEMENT NO. [●]  
STANDARD INTERCONNECTION AGREEMENT  
AMONG THE  
NEW YORK INDEPENDENT SYSTEM OPERATOR, INC.~~

BETWEEN

NIAGARA MOHAWK POWER CORPORATION D/B/A NATIONAL GRID

AND

~~*[INSERT CONNECTING TRANSMISSION OWNER]*~~

AND

~~*[INSERT INTERCONNECTION CUSTOMER]*~~

~~*Dated as of [insert execution date]*~~

~~*Facility Project Name: [insert project name]*~~

~~*Queue Position No(s): [insert Queue number(s)]*~~

CURTIS/PALMER HYDROELECTRIC COMPANY L.P.

## TABLE OF CONTENTS

Page Number

### ARTICLE 1. DEFINITIONS

### ARTICLE 2. EFFECTIVE DATE, TERM AND TERMINATION

- 2.1 Effective Date
- 2.2 Term of Agreement
- 2.3 Termination
- 2.4 Termination Costs
- 2.5 Disconnection
- 2.6 Survival

### ARTICLE 3. REGULATORY FILINGS

### ARTICLE 4. SCOPE OF INTERCONNECTION SERVICE

- 4.1 Provision of Service
- 4.2 No Transmission Delivery Service
- 4.3 No Other Services

### ARTICLE 5. INTERCONNECTION FACILITIES ENGINEERING, PROCUREMENT, AND CONSTRUCTION

- 5.1 Options
- 5.2 General Conditions Applicable to Option to Build
- 5.3 Liquidated Damages
- 5.4 Power System Stabilizers
- 5.5 ~~Design and~~ Equipment Procurement
- 5.6 Construction Commencement
- 5.7 Work Progress
- 5.8 Information Exchange
- 5.9 ~~Other Interconnection Options~~ Limited Operation
- 5.10 ~~Interconnection Customer~~ Developer's Attachment Facilities ("~~ICAF~~DAF")
- 5.11 Connecting Transmission Owner's Attachment Facilities Construction
- 5.12 Access Rights
- 5.13 Lands of Other Property Owners
- 5.14 Permits
- 5.15 Early Construction of Base Case Facilities
- 5.16 Suspension
- 5.17 Taxes
- 5.18 Tax Status; Non-Jurisdictional Entities
- 5.19 Modification

### ARTICLE 6. TESTING AND INSPECTION

- 6.1 Pre-Commercial Operation Date Testing and Modifications
- 6.2 Post-Commercial Operation Date Testing and Modifications
- 6.3 Right to Observe Testing
- 6.4 Right to Inspect

### ARTICLE 7. METERING

- 7.1 General
- 7.2 Check Meters
- 7.3 Standards

7.4 Testing of Metering Equipment

7.5 Metering Data

#### ARTICLE 8. COMMUNICATIONS

8.1 ~~Interconnection Customer~~Developer Obligations

8.2 Remote Terminal Unit

8.3 No Annexation

#### ARTICLE 9. OPERATIONS

9.1 General

9.2 NYISO and Connecting Transmission Owner Obligations

9.3 ~~Interconnection Customer~~Developer Obligations

9.4 Start-Up and Synchronization

9.5 Real and Reactive Power Control and Primary Frequency Response

9.6 Outages and Interruptions

9.7 Switching and Tagging Rules

9.8 Use of Attachment Facilities by Third Parties

9.9 Disturbance Analysis Data Exchange

9.10 Phasor Measurement Units

#### ARTICLE 10. MAINTENANCE

10.1 Connecting Transmission Owner Obligations

10.2 ~~Interconnection Customer~~Developer Obligations

10.3 Coordination

10.4 Secondary Systems

10.5 Operating and Maintenance Expenses

#### ARTICLE 11. PERFORMANCE OBLIGATION

11.1 ~~Interconnection Customer~~Developer's Attachment Facilities

11.2 Connecting Transmission Owner's Attachment Facilities

11.3 System Upgrade Facilities and System Deliverability Upgrades

11.4 ~~Upgrades on~~Special Provisions for Affected Systems ~~and Upgrades Required for Multiple Projects on Connecting Transmission Owner's System or Affected System~~

11.5 Provision of Security

11.6 ~~Interconnection Customer's~~Developer Compensation for Emergency Services

11.7 Line Outage Costs

#### ARTICLE 12. INVOICE

12.1 General

12.2 Final Invoice

12.3 Payment

12.4 Disputes

#### ARTICLE 13. EMERGENCIES

13.1 Obligations

13.2 Notice

13.3 Immediate Action

13.4 NYISO and Connecting Transmission Owner Authority

13.5 ~~Interconnection Customer~~Developer Authority

13.6 Limited Liability

#### ARTICLE 14. REGULATORY REQUIREMENTS AND GOVERNING LAW

14.1 Regulatory Requirements

14.2 Governing Law  
ARTICLE 15. NOTICES  
15.1 General  
15.2 Billings and Payments  
15.3 Alternative Forms of Notice  
15.4 Operations and Maintenance Notice  
ARTICLE 16. FORCE MAJEURE

ARTICLE 17. DEFAULT

~~17.1 General~~

~~17.2 Right to Terminate~~

ARTICLE 18. INDEMNITY, CONSEQUENTIAL DAMAGES AND INSURANCE

18.1 Indemnity  
18.2 No Consequential Damages  
18.3 Insurance

ARTICLE 19. ASSIGNMENT

ARTICLE 20. SEVERABILITY

ARTICLE 21. COMPARABILITY

ARTICLE 22. CONFIDENTIALITY

22.1 Confidentiality  
22.2 Term  
22.3 Confidential Information  
22.4 Scope  
22.5 Release of Confidential Information  
22.6 Rights  
22.7 No Warranties  
22.8 Standard of Care  
22.9 Order of Disclosure  
22.10 Termination of Agreement  
22.11 Remedies  
22.12 Disclosure to FERC, its Staff or a State  
22.13 Required Notices Upon Requests or Demands for Confidential Information

~~ARTICLE 23. INTERCONNECTION CUSTOMER AND CONNECTING TRANSMISSION-  
OWNER NOTICE OF ENVIRONMENTAL RELEASES~~

~~23.1 Developer and Connecting Transmission Owner Notice~~

ARTICLE 24. INFORMATION REQUIREMENT

24.1 Information Acquisition  
24.2 Information Submission by Connecting Transmission Owner  
24.3 Updated Information Submission by ~~Interconnection Customer~~Developer  
24.4 Information Supplementation

ARTICLE 25. INFORMATION ACCESS AND AUDIT RIGHTS

25.1 Information Access  
25.2 Reporting of Non-Force Majeure Events  
25.3 Audit Rights  
25.4 Audit Rights Periods  
25.5 Audit Results

## ARTICLE 26. SUBCONTRACTORS

- 26.1 General
- 26.2 Responsibility of Principal
- 26.3 No Limitation by Insurance

## ARTICLE 27. DISPUTES

- 27.1 Submission
- 27.2 External Arbitration Procedures
- 27.3 Arbitration Decisions
- 27.4 Costs
- 27.5 Termination

## ARTICLE 28. REPRESENTATIONS, WARRANTIES AND COVENANTS

- 28.1 General

## ARTICLE 29. MISCELLANEOUS

- 29.1 Binding Effect
- 29.2 Conflicts
- 29.3 Rules of Interpretation
- 29.4 Compliance
- 29.5 Joint and Several Obligations
- 29.6 Entire Agreement
- 29.7 No Third Party Beneficiaries
- 29.8 Waiver
- 29.9 Headings
- 29.10 Multiple Counterparts
- 29.11 Amendment
- 29.12 Modification by the Parties
- 29.13 Reservation of Rights
- 29.14 No Partnership
- 29.15 Other Transmission Rights

~~29.16 Modifications Related to NYISO's Compliance with Order No. 2023~~

Appendices

## **STANDARD GENERATOR INTERCONNECTION AGREEMENT**

**THIS STANDARD GENERATOR INTERCONNECTION AGREEMENT** (“Agreement” or “GIA”) is made and entered into this 12th day of 20 August 2025, by and among: (i) ~~\_\_\_\_\_~~, a ~~[corporate description]~~ between Curtis/Palmer Hydroelectric Company L.P., a limited partnership organized and existing under the laws of the State/~~Commonwealth~~ of ~~\_\_\_\_\_~~ (“~~Interconnection Customer~~” with a Facility), (ii) ~~the New York Independent System Operator, Inc., a not-for-profit~~ New York (“Developer”), and Niagara Mohawk Power Corporation d/b/a National Grid, a corporation organized and existing under the laws of the State of New York (“NYISO”), and (iii) ~~\_\_\_\_\_ a [corporate description] organized and existing under the laws of the State of New York~~ (“Connecting Transmission Owner”). ~~Interconnection Customer, the NYISO, Developer~~ or Connecting Transmission Owner each may be referred to as a “Party” or ~~collectively together~~ referred to as the “Parties.”

### **RECITALS**

**WHEREAS**, ~~the New York Independent System Operator, Inc., a not-for-profit corporation organized and existing under the laws of the State of New York (“NYISO”)~~ operates the New York State Transmission System and Connecting Transmission Owner owns certain facilities included in the New York State Transmission System;

**WHEREAS**, ~~Interconnection Customer~~ Developer either owns, leases and/or controls and operates or, intends to own, lease and/or control and operate, the ~~Facility~~ two Generating Facilities located at the same site and identified in Appendix ~~A~~ C to this Agreement ~~(together the “Generating Facilities” and each individually a “Generating Facility”); and,~~

**WHEREAS**, Developer and Connecting Transmission Owner are parties to an Amended and Restated Power Purchase Agreement regarding the Generating Facilities dated January 5, 1995, which the Federal Energy Regulatory Commission accepted for filing in Docket No. ER95-433 and which will be superseded and replaced by this Agreement; and

**WHEREAS**, ~~Interconnection Customer, NYISO, Developer~~ and Connecting Transmission Owner have agreed to enter into this Agreement for the purpose of interconnecting the ~~Facility~~ Generating Facilities with the New York State Transmission System;

**NOW, THEREFORE**, in consideration of and subject to the mutual covenants contained herein, it is agreed:

### **ARTICLE 1. DEFINITIONS**

Whenever used in this Agreement with initial capitalization, the following terms shall have the meanings specified in this Article 1. Terms used in this Agreement with initial capitalization that are not defined in this Article 1 shall have the meanings specified in Section 1 of the ISO OATT, Section ~~40.1~~ 30.1 of Attachment ~~HHX~~ of the ISO OATT, Section 25.1.2 of Attachment S

of the ISO OATT, the body of the ~~Standard Interconnection Procedures~~, LFIP or the body of this Agreement.

**Affected System** shall mean an electric system ~~within the New York Control Area~~ other than the transmission system owned, controlled or operated by the Connecting Transmission Owner that may be affected by the proposed interconnection.

**Affected System Operator** shall mean the entity that operates an Affected System. ~~Affected System Operator includes the Affected Transmission Owners.~~

**Affected Transmission Owner** shall mean the New York public utility or authority (or its designated agent) other than the Connecting Transmission Owner that (i) owns facilities used for the transmission of Energy in interstate commerce and provides Transmission Service under the ~~ISO OATT~~ Tariff, and (ii) owns, leases or otherwise possesses an interest in a portion of the New York State Transmission System where System Deliverability Upgrades, System Upgrade Facilities, ~~Affected Network Upgrade Facilities~~, or Network Upgrade Facilities are or will be installed pursuant to Attachment P, Attachment X, Attachment Z, or Attachment S, ~~or Attachment HH~~ to the ISO OATT.

**Affiliate** shall mean, with respect to a person or entity, any individual, corporation, partnership, firm, joint venture, association, joint-stock company, trust or unincorporated organization, directly or indirectly controlling, controlled by, or under common control with, such person or entity. The term “control” shall mean the possession, directly or indirectly, of the power to direct the management or policies of a person or an entity. A voting interest of ten percent or more shall create a rebuttable presumption of control.

**Ancillary Services** shall mean those services that are necessary to support the transmission of Capacity and Energy from resources to Loads while maintaining reliable operation of the New York State Transmission System in accordance with Good Utility Practice.

**Applicable Laws and Regulations** shall mean all duly promulgated applicable federal, state and local laws, regulations, rules, ordinances, codes, decrees, judgments, directives, or judicial or administrative orders, permits and other duly authorized actions of any Governmental Authority, including but not limited to Environmental Law.

**Applicable Reliability Councils** shall mean the ~~Electric Reliability Organization~~ NERC, the NPCC and the NYSRC.

**Applicable Reliability Standards** shall mean the requirements and guidelines of the Applicable Reliability Councils, and the Transmission District to which the ~~Interconnection Customer's Facility is~~ Developer's Generating Facilities are directly interconnected, as those requirements

and guidelines are amended and modified and in effect from time to time; provided that ~~neither~~ Party shall waive its right to challenge the applicability or validity of any requirement or guideline as applied to it in the context of this Agreement.

~~**Applicable Reliability Requirements:** shall mean the NYSRC Reliability Rules, and other criteria, standards and procedures, as described in Section 40.12.1.2 of this Attachment HH, applied when conducting the Cluster Baseline Assessment and the Cluster Project Assessment; provided that no Party shall waive its right to challenge the applicability or validity of any requirement or guideline as applied to it in the context of the Standard Interconnection Procedures. The Applicable Reliability Requirements applied are those in effect when the particular assessment is commenced.~~

**Attachment Facilities** shall mean the Connecting Transmission Owner's Attachment Facilities and the ~~Interconnection Customer~~Developer's Attachment Facilities. Collectively, Attachment Facilities include all facilities and equipment between the Generating ~~Facility or Cluster Study~~Transmission Project Facilities and the Point of Interconnection, including any modification, additions or upgrades that are necessary to physically and electrically interconnect the ~~Facility~~Generating Facilities to the New York State Transmission ~~System or Distribution~~ System. Attachment Facilities are sole use facilities and shall not include Stand Alone System Upgrade Facilities, Distribution Upgrades, System Upgrade Facilities or System Deliverability Upgrades.

~~**Balancing Authority** shall mean an entity that integrates resource plans ahead of time, maintains demand and resource balance within a Balancing Authority Area, and supports interconnection frequency in real time.~~

~~**Balancing Authority Area** shall mean the collection of generation, transmission, and loads within the metered boundaries of the Balancing Authority. The Balancing Authority maintains load resource balance within this area.~~

**Base Case** shall mean the base case power flow, short circuit, and stability data bases used for the Interconnection Studies ~~or Cluster Study~~ by the NYISO, Connecting Transmission Owner or ~~Interconnection Customer~~Developer; ~~as described, as applicable, in Section 30.2.3 of the Standard Large Facility Interconnection Procedures or Section 40.2.6 of the Standard~~ Interconnection Procedures.

**Breach** shall mean the failure of a Party to perform or observe any material term or condition of this Agreement.

**Breaching Party** shall mean a Party that is in Breach of this Agreement.

**Business Day** shall mean Monday through Friday, excluding federal holidays.

Byway shall mean all transmission facilities comprising the New York State Transmission System that are neither Highways nor Other Interfaces. All transmission facilities in Zone J and Zone K are Byways.

**Calendar Day** shall mean any day including Saturday, Sunday or a federal holiday.

Capacity Region shall mean one of four subsets of the Installed Capacity statewide markets comprised of (1) Rest of State (*i.e.*, Load Zones A through F); (2) Lower Hudson Valley (*i.e.*, Load Zones G, H and I); (3) New York City (*i.e.*, Load Zone J); and (4) Long Island (*i.e.*, Load Zone K), except for Class Year Interconnection Facility Studies conducted prior to Class Year 2012, for which “Capacity Region” shall be defined as set forth in Section 25.7.3 of Attachment S to the ISO OATT.

**Capacity Resource Interconnection Service (“CRIS”)** shall mean the service provided by NYISO to ~~Interconnection Customers~~ Developers that satisfy the NYISO Deliverability Interconnection Standard or that are otherwise eligible to receive CRIS in accordance with Attachment S ~~or HH~~ to the ISO OATT; such service being one of the eligibility requirements for participation as a NYISO Installed Capacity Supplier.

**Class Year ~~Interconnection Facilities Study (“Class Year Study”)~~** shall mean a study ~~conducted by the NYISO or a third party consultant for the Interconnection Customer to determine a list of facilities (including Connecting Transmission Owner’s Attachment Facilities, Distribution Upgrades, System Upgrade Facilities and System Deliverability Upgrades as identified in the Interconnection System Reliability Impact Study), the cost of those facilities, and the time required to interconnect the Large Generating Facility or Class Year Transmission Project with the New York State Transmission System or with the Distribution System. The scope of the study is defined in Section 30.8 of the Large Facility Interconnection Procedures in Attachment X to the ISO OATT.~~

**~~Class Year Transmission Project~~** shall mean ~~an Interconnection Customer’s proposed new transmission facility that will interconnect to the New York State Transmission System or a proposed upgrade—an improvement to, addition to, or replacement of a part of an existing transmission facility—to the New York State Transmission System, for which (1) the Interconnection Customer is eligible to request and does request Capacity Resource Interconnection Service, subject to the eligibility requirements set forth in the ISO Procedures; or (2) the Interconnection Customer requests only Energy Resource Interconnection Service and the transmission facility for which it requests Energy Resource Interconnection Service is a transmission facility over which power flow can be directly controlled by power flow control devices directly connected to the Class Year Transmission Project without having to re-dispatch~~

~~generation. Class Year Transmission Projects shall not include Attachment Facilities, Network Upgrade Facilities, System Upgrade Facilities or System Deliverability Upgrades.~~

~~Cluster shall mean a group of one or more Projects with validated Interconnection Requests that are studied together for the purpose of conducting a Cluster Study.~~

~~Cluster Study shall mean the study conducted, as applicable, by the ISO, Connecting Transmission Owner, Affected Transmission Owner, Affected System Operator or a third party consultant for the Interconnection Customer to determine a list of facilities (including Connecting Transmission Owner's Attachment Facilities, Distribution Upgrades, System Upgrade Facilities and System Deliverability Upgrades), the cost of those facilities, and the time required to interconnect the Generating Facility or Cluster Study Transmission Project with the New York State Transmission System or with the Distribution System. The Cluster Study includes the Phase 1 Study and the Phase 2 Study.~~

~~Cluster Study Transmission Project shall mean an Interconnection Customer's proposed new transmission facility that will interconnect to the New York State Transmission System or a proposed upgrade—an improvement to, addition to, or replacement of a part of an existing transmission facility—to the New York State Transmission System, for which (1) the Interconnection Customer is eligible to request and does request Capacity Resource Interconnection Service, subject to the eligibility requirements set forth in the ISO Procedures; or (2) the Interconnection Customer requests only Energy Resource Interconnection Service and the transmission facility for which it requests Energy Resource Interconnection Service is a transmission facility over which power flow can be directly controlled by power flow control devices directly connected to the Cluster Study Transmission Project without having to re-dispatch generation. Cluster Study Transmission Projects shall not include Attachment Facilities, Network Upgrade Facilities, System Upgrade Facilities or System Deliverability Upgrades.~~ Deliverability Study shall mean an assessment, conducted by the NYISO staff in cooperation with Market Participants, to determine whether System Deliverability Upgrades are required for Class Year CRIS Projects under the NYISO Deliverability Interconnection Standard.

**Commercial Operation** shall mean the status of a Generating Facility that has commenced generating ~~or transmitting~~ electricity for sale, excluding electricity generated ~~or transmitted~~ during Trial Operation.

**Commercial Operation Date** of a unit shall mean the date on which ~~the~~each Generating Facility commences Commercial Operation as agreed to by the Parties, notice of which must be provided ~~by the Interconnection Customer to the NYISO and Connecting Transmission Owner~~ in the form ~~provided in~~of Appendix E-2 to this Agreement.

**Confidential Information** shall mean any information that is defined as confidential by Article 22 of this Agreement.

**Connecting Transmission Owner** shall mean the New York public utility or authority (or its designated agent) that (i) owns facilities used for the transmission of Energy in interstate commerce and provides Transmission Service under the ~~ISO-OATT~~[Tariff](#), (ii) owns, leases or otherwise possesses an interest in the portion of the New York State Transmission System or Distribution System at the Point of Interconnection, and (iii) is a Party to ~~this Agreement. For purposes of this Agreement, the Connecting Transmission Owner is set forth in the preamble of~~ this Agreement.

**Connecting Transmission Owner's Attachment Facilities** shall mean all facilities and equipment owned, controlled or operated by the Connecting Transmission Owner from the Point of Change of Ownership to the Point of Interconnection as identified in Appendix A to this Agreement, including any modifications, additions or upgrades to such facilities and equipment. Connecting Transmission Owner's Attachment Facilities are sole use facilities and shall not include ~~Distribution Upgrades~~, Stand Alone System Upgrade Facilities, System Upgrade Facilities, or System Deliverability Upgrades.

**Contingent Facilities** shall mean those Attachment Facilities, ~~Distribution Upgrades, and~~ System Upgrade Facilities, and/or System Deliverability Upgrades associated with Class Year Projects ~~or Cluster Study Projects~~ upon which the [Large](#) Facility's Class Year ~~Study or Cluster Study~~ Project Cost Allocations are dependent, and if delayed or not built, could impact the actual costs and timing of the [Large](#) Facility's Project Cost Allocation for System Upgrade Facilities or System Deliverability Upgrades.

**Control Area** shall mean an electric power system or combination of electric power systems to which a common automatic generation control scheme is applied in order to: (1) match, at all times, the power output of the Generating Facilities within the electric power system(s) and capacity and energy purchased from entities outside the electric power system(s), with the Load within the electric power system(s); (2) maintain scheduled interchange with other Control Areas, within the limits of Good Utility Practice; (3) maintain the frequency of the electric power system(s) within reasonable limits in accordance with Good Utility Practice; and (4) provide sufficient generating capacity to maintain Operating Reserves in accordance with Good Utility Practice. A Control Area must be certified by the NPCC.

**Default** shall mean the failure of a Party in Breach of this Agreement to cure such Breach in accordance with Article 17 of this Agreement.

**Developer** shall mean an Eligible Customer that has developed or is developing a Generating Facility, proposing to connect to the New York State Transmission System, in compliance with the NYISO Minimum Interconnection Standard.

**Developer's Attachment Facilities** shall mean all facilities and equipment, as identified in Appendix A of this Agreement, that are located between a Generating Facility and the Point of Change of Ownership, including any modification, addition, or upgrades to such facilities and equipment necessary to physically and electrically interconnect the Generating Facility to the New York State Transmission System. Developer's Attachment Facilities are sole use facilities.

**Distribution System** shall mean the Connecting Transmission Owner's facilities and equipment used to distribute electricity that are subject to FERC jurisdiction, and are subject to the NYISO's ~~Standard~~Large Facility Interconnection Procedures in Attachment HHX to the ISO OATT or Small Generator Interconnection Procedures in Attachment Z to the ISO OATT under FERC Order Nos. 2003 and/or 2006. The term Distribution System shall not include LIPA's distribution facilities.

**Distribution Upgrades** shall mean the additions, modifications, and upgrades to the ~~existing~~Connecting Transmission Owner's Distribution System at or beyond the Point of Interconnection ~~that are required for the Facility to connect reliably to the system in a manner that meets the NYISO Minimum Interconnection Standard~~to facilitate interconnection of a Generating Facility and render the transmission service necessary to affect the Developer's wholesale sale of electricity in interstate commerce. Distribution Upgrades do not include Attachment Facilities, System Upgrade Facilities, or System Deliverability Upgrades. Distribution Upgrades are sole use facilities and shall not include Stand Alone System Upgrade Facilities, System Upgrade Facilities, or System Deliverability Upgrades.

**Effective Date** shall mean the date on which this Agreement becomes effective ~~in accordance with Article 2.1 of this Agreement.~~

~~**Electric Reliability Organization ("ERO")** shall mean the North American Electric Reliability Corporation or its successor organization~~upon execution by the Parties, subject to acceptance by the Commission, or if filed unexecuted, upon the date specified by the Commission.

**Emergency State** shall mean the condition or state that the New York State Power System is in when an abnormal condition occurs that requires automatic or immediate manual action to prevent or limit loss of the New York State Transmission System or Generators that could adversely affect the reliability of the New York State Power System.

**Energy Resource Interconnection Service ("ERIS")** shall mean the service provided by NYISO to interconnect ~~the Interconnection Customer's~~a Generating Facility, ~~Class Year Transmission Project, or Cluster Study Transmission Project~~ to the New York State Transmission System or to the Distribution System in accordance with the NYISO Minimum Interconnection Standard, to enable the New York State Transmission System to receive Energy and Ancillary Services from the Generating Facility, ~~Class Year Transmission Project, or Cluster Study Transmission Project~~, pursuant to the terms of the ISO OATT.

**Environmental Law** shall mean Applicable Laws and Regulations relating to pollution or protection of the environment or natural resources.

~~**Facility** shall mean, as applicable, the Generating Facility, Class Year Transmission Project, or Cluster Study Transmission Project.~~

**Federal Power Act** shall mean the Federal Power Act, as amended, 16 U.S.C. §§ 791a *et seq.* (“FPA”).

**FERC** shall mean the Federal Energy Regulatory Commission (“Commission”) or its successor.

**Force Majeure** shall mean any act of God, labor disturbance, act of the public enemy, war, insurrection, riot, fire, storm or flood, explosion, breakage or accident to machinery or equipment, any order, regulation or restriction imposed by governmental, military or lawfully established civilian authorities, or any other cause beyond a Party’s control. A Force Majeure event does not include acts of negligence or intentional wrongdoing by the Party claiming Force Majeure.

**Generating Facility** shall mean ~~Interconnection Customer’s device(s)~~ either of Developer’s devices for the production and/or storage for later injection of electricity identified in ~~the Interconnection Request~~ Appendix C to this Agreement, but shall not include: the ~~Interconnection Customer~~ Developer’s Attachment Facilities or Distribution Upgrades. ~~—A facility comprised of multiple Generators will be treated as a single Generating Facility if the — facility proposed in the Interconnection Request is comprised of multiple Generators behind a single Point of Interconnection, even if such Generators are different technology types.~~

**Generating Facility Capacity** shall mean the net seasonal capacity of ~~the~~ a Generating Facility ~~or and~~ the aggregate net seasonal capacity of the Generating Facility ~~consisting of more than one device for a~~ where it includes multiple energy production ~~and/or storage for later injection~~ devices.

**Good Utility Practice** shall mean any of the practices, methods and acts engaged in or approved by a significant portion of the electric industry during the relevant time period, or any of the practices, methods and acts which, in the exercise of reasonable judgment in light of the facts known at the time the decision was made, could have been expected to accomplish the desired result at a reasonable cost consistent with good business practices, reliability, safety and expedition. Good Utility Practice is not intended to be limited to the optimum practice, method, or act to the exclusion of all others, but rather to delineate acceptable practices, methods, or acts generally accepted in the region.

**Governmental Authority** shall mean any federal, state, local or other governmental regulatory or administrative agency, court, commission, department, board, or other governmental subdivision, legislature, rulemaking board, tribunal, or other governmental authority having jurisdiction over ~~any~~either of the Parties, their respective facilities, or the respective services they provide, and exercising or entitled to exercise any administrative, executive, police, or taxing authority or power; provided, however, that such term does not include ~~Interconnection-Customer~~Developer, NYISO, Affected Transmission Owner, ~~Affected System Operator~~, Connecting Transmission Owner, or any Affiliate thereof.

**Hazardous Substances** shall mean any chemicals, materials or substances defined as or included in the definition of “hazardous substances,” “hazardous wastes,” “hazardous materials,” “hazardous constituents,” “restricted hazardous materials,” “extremely hazardous substances,” “toxic substances,” “radioactive substances,” “contaminants,” “pollutants,” “toxic pollutants” or words of similar meaning and regulatory effect under any applicable Environmental Law, or any other chemical, material or substance, exposure to which is prohibited, limited or regulated by any applicable Environmental Law.

Highway shall mean 115 kV and higher transmission facilities that comprise the following NYCA interfaces: Dysinger East, West Central, Volney East, Moses South, Central East/Total East, and UPNY-ConEd, and their immediately connected, in series, bulk power system facilities in New York State. Each interface shall be evaluated to determine additional “in series” facilities, defined as any transmission facility higher than 115 kV that (a) is located in an upstream or downstream zone adjacent to the interface and (b) has a power transfer distribution factor (DFAX) equal to or greater than five percent when the aggregate of generation in zones or systems adjacent to the upstream zone or zones that define the interface is shifted to the aggregate of generation in zones or systems adjacent to the downstream zone or zones that define the interface. In determining “in series” facilities for Dysinger East and West Central interfaces, the 115 kV and 230 kV tie lines between NYCA and PJM located in LBMP Zones A and B shall not participate in the transfer. Highway transmission facilities are listed in ISO Procedures.

**Initial ~~Backfeed~~Synchronization Date** shall mean the date upon which ~~the Interconnection-Customer~~a Generating Facility is initially synchronized and upon which Trial Operation begins, notice of which must be provided to the NYISO in the form of Appendix E-1.

In-Service Date shall mean the date upon which the Developer reasonably expects it will be ready to begin use of the Connecting Transmission Owner’s Attachment Facilities to obtain back feed power. ~~Initial Backfeed Date shall include the term In-Service Date as that term is used in Attachments S, X, and Z to the ISO OATT.~~

**Interconnection ~~Customer~~Facilities Study** shall mean ~~any entity, including the~~a study conducted by NYISO or a third party consultant for the Developer to determine a list of facilities (including Connecting Transmission Owner ~~or any of its affiliates or subsidiaries, that proposes’s Attachment Facilities, Distribution Upgrades, System Upgrade Facilities and System~~

Deliverability Upgrades as identified in the Interconnection System Reliability Impact Study), the cost of those facilities, and the time required to interconnect its Generating Facility, ~~Class-Year Transmission Project, or Cluster Study Transmission Project~~ with the New York State Transmission System or with the Distribution System. ~~For purposes~~ The scope of ~~applying the requirements in this Agreement, an Interconnection Customer shall include an entity that was categorized as a Developer under~~ study is defined in Section 30.8 of the NYISO's Standard Large Facility Interconnection Procedures.

**Interconnection ~~Customer's Attachment~~ Facilities** shall mean all facilities and equipment that are located between the Generating Facility, ~~Class-Year Transmission Project, or Cluster Study Transmission Project~~ and the Point of Change of Ownership as identified in Appendix A to this Agreement, ~~including any modification, addition, or upgrades to such facilities and equipment necessary to physically and electrically interconnect the Generating Facility,~~ Study Agreement (~~"Class Year Transmission Project, or Cluster Study Transmission Project to the New York State Transmission System or Distribution System. Interconnection Customer's Attachment Facilities are sole use facilities. For purposes of applying the requirements in this Agreement, Interconnection Customer's Attachment Facilities shall include facilities that were categorized as Developer's Attachment Facilities under the NYISO's~~ Study Agreement") shall mean the form of agreement contained in Appendix 2 of the Standard Large Facility Interconnection Procedures ~~or Interconnection Customer's for conducting the~~ Interconnection Facilities ~~under the NYISO's Small Generator Interconnection Procedures~~ Study.

**Interconnection Request** shall mean ~~Interconnection Customer~~ the Developer's request, in the form of Appendix 1 to the Standard ~~Interconnection Procedures in Attachment HH to the ISO-OATT or Appendix I to the Standard~~ Large Facility Interconnection Procedures ~~in Attachment X to the ISO-OATT~~, in accordance with the ~~ISO-OATT~~ Tariff, to interconnect a new Generating Facility, Class-Year Transmission Project, or Cluster Study Transmission Project to the New York State Transmission System or to the Distribution System, or to materially increase the capacity of, or make a material modification to the operating characteristics of, an existing Generating Facility, ~~Class-Year Transmission Project, or Cluster Study Transmission Project~~ that is interconnected with the New York State Transmission System or with the Distribution System. ~~For purposes of the Interconnection Request, a facility comprised of multiple Generators behind the same Point of Interconnection may be considered a single Generating Facility, provided the Interconnection Request identifies a single Interconnection Customer.~~

**Interconnection Study** shall mean any of the following studies: the Optional Interconnection Feasibility Study, the Interconnection System Reliability Impact Study, and the Interconnection Facilities Study described in the Standard Large Facility Interconnection Procedures.

**Interconnection System Reliability Impact Study ("SRIS")** shall mean an engineering study, conducted in accordance with Section 30.7 of the Standard Large Facility Interconnection Procedures, that evaluates the impact of a proposed Generating Facility on the safety and reliability of the New York State Transmission System and, if applicable, an Affected System, to determine what Attachment Facilities, Distribution Upgrades and System Upgrade Facilities are

needed for the proposed Generating Facility of the Developer to connect reliably to the New York State Transmission System or to the Distribution System in a manner that meets the NYISO Minimum Interconnection Standard in Attachment X to the ISO OATT.

IRS shall mean the Internal Revenue Service.

~~ISO Services Tariff shall mean the NYISO Market Administration and Control Area Tariff, as filed with the Commission, and as amended or supplemented from time to time, or any successor tariff thereto.~~

~~ISO OATT shall mean the NYISO Open Access Transmission Tariff, as filed with the Commission, and as amended or supplemented from time to time, or any successor tariff.~~

Material Modification shall mean those modifications that have a material impact on the cost or timing of any Interconnection Request with ~~an equal or~~ later ~~Queue Position~~queue priority date.

Metering Equipment shall mean all metering equipment installed or to be installed at ~~the~~a Generating Facility pursuant to this Agreement at the metering points, including but not limited to instrument transformers, MWh-meters, data acquisition equipment, transducers, remote terminal unit, communications equipment, phone lines, and fiber optics.

NERC shall mean the North American Electric Reliability Council or its successor organization.

New York State Transmission System shall mean the entire New York State electric transmission system, which includes (i) the Transmission Facilities Under ISO Operational Control; (ii) the Transmission Facilities Requiring ISO Notification; and (iii) all remaining transmission facilities within the New York Control Area.

Notice of Dispute shall mean a written notice of a dispute or claim ~~pursuant to Article 27.1 of this Agreement~~ that arises out of or in connection with this Agreement or its performance.

NPCC shall mean the Northeast Power Coordinating Council or its successor organization.

NYISO ~~Tariffs~~ shall mean the ~~ISO OATT and ISO Services Tariff~~New York Independent System Operator, Inc. or its successor.

**NYISO Deliverability Interconnection Standard** - The standard that must be met, unless otherwise provided for by Attachment S to the ISO OATT, by (i) any generation facility larger than 2 MW in order for that facility to obtain CRIS; (ii) any Class Year Transmission Project; (iii) any entity requesting External CRIS Rights, and (iv) any entity requesting a CRIS transfer pursuant to Section 25.9.5 of Attachment S to the ISO OATT. To meet the NYISO Deliverability Interconnection Standard, the Developer must, in accordance with the rules in Attachment S to the ISO OATT, fund or commit to fund any System Deliverability Upgrades identified for its project in the Class Year Deliverability Study.

**NYISO Minimum Interconnection Standard** - The reliability standard that must be met by any generation facility or Class Year Transmission Project that is subject to NYISO's Large Facility Interconnection Procedures in Attachment X to the ISO OATT or the NYISO's Small Generator Interconnection Procedures in Attachment Z, that is proposing to connect to the New York State Transmission System or Distribution System, to obtain ERIS. The Minimum Interconnection Standard is designed to ensure reliable access by the proposed project to the New York State Transmission System or to the Distribution System. The Minimum Interconnection Standard does not impose any deliverability test or deliverability requirement on the proposed interconnection.

NYSRC shall mean the New York State Reliability Council or its successor organization.

OATT shall mean the Tariff.

**Other Interfaces** shall mean the following interfaces into Capacity Regions: Lower Hudson Valley [*i.e.*, Rest of State (Load Zones A-F) to Lower Hudson Valley (Load Zones G, H and I)]; New York City [*i.e.*, Lower Hudson Valley (Load Zones G, H and I) to New York City (Load Zone J)]; and Long Island [*i.e.*, Lower Hudson Valley (Load Zones G, H and I) to Long Island (Load Zone K)], and the following Interfaces between the NYCA and adjacent Control Areas: PJM to NYISO, ISO-NE to NYISO, Hydro-Quebec to NYISO, and Norwalk Harbor (Connecticut) to Northport (Long Island) Cable.

**Party or Parties** shall mean ~~NYISO~~, Connecting Transmission Owner, Developer, or ~~Interconnection Customer or any combination of the above~~both.

**Point of Change of Ownership** shall mean the point, as set forth in Appendix A to this Agreement, where the ~~Interconnection Customer~~Developer's Attachment Facilities connect to the Connecting Transmission Owner's Attachment Facilities. ~~—The Point of Change of Ownership is set forth in Appendix A to this Agreement.~~

**Point of Interconnection** shall mean the point, as set forth in Appendix A to this Agreement, where the Attachment Facilities connect to the New York State Transmission System or to the Distribution System. ~~—The Point of Interconnection is set forth in Appendix A to this Agreement.~~

**Provisional Interconnection Service** shall mean interconnection service provided by the ~~NYISO~~ISO associated with interconnecting the ~~Interconnection Customer~~Developer's Large Facility to the New York State Transmission System (or Distribution System as applicable) and enabling the transmission system to receive electric energy from the Large Facility at the Point of Interconnection, pursuant to the terms of the Provisional ~~Standard~~Large Facility Interconnection Agreement and, if applicable, the ISO OATT.

**Provisional ~~Standard~~Large Facility Interconnection Agreement** shall mean the interconnection agreement for Provisional Interconnection Service established between the ~~NYISO~~ISO, Connecting Transmission Owner(s), and the ~~Interconnection Customer~~Developer. This agreement shall take the form of the ~~Standard~~Large Generator Interconnection Agreement, modified for provisional purposes and type of facility.

**Reasonable Efforts** shall mean, with respect to an action required to be attempted or taken by a Party under this Agreement, efforts that are timely and consistent with Good Utility Practice and are otherwise substantially equivalent to those a Party would use to protect its own interests.

**Retired** ~~shall mean a:~~ A Generator that has permanently ceased operating on or after May 1, 2015 either: i) pursuant to applicable notice; or ii) as a result of the expiration of its Mothball Outage or its ICAP Ineligible Forced Outage.

~~**Site Control** shall mean the necessary land right sufficient to develop, construct, operate, and maintain the Facility over a term of at least ten (10) years from the date of submission of the Interconnection Request. Site Control may be demonstrated by documentation establishing: (1) ownership of, a leasehold interest in, or a right to develop a site of sufficient size to construct and operate the Facility; (2) an option to purchase or acquire a leasehold site of sufficient size to construct and operate the Facility; or (3) any other documentation that clearly demonstrates the right of Interconnection Customer to occupy a site of sufficient size to construct and operate the Facility. The term "necessary land right" restricts the use of the site for mutually exclusive projects, but does not restrict multi-use applications of the site in addition to its use for the Facility, such as agriculture, ranching, etc. The ISO will maintain acreage requirements and other applicable parameters for each facility type on its OASIS or public website~~

**Services Tariff** shall mean the NYISO Market Administration and Control Area Tariff, as filed with the Commission, and as amended or supplemented from time to time, or any successor tariff thereto.

**Stand Alone System Upgrade Facilities** shall mean System Upgrade Facilities that are not part of an Affected System ~~that an Interconnection Customer~~the Developer may construct without affecting day-to-day operations of the New York State Transmission System during their construction. The ~~ISO, the~~ Connecting Transmission Owner, and the ~~Interconnection Customer~~Developer must agree as to what constitutes Stand Alone System Upgrade Facilities and identify them in Appendix A to ~~the Standard Interconnection~~this Agreement. If ~~the~~the ISO NYISO, the Connecting Transmission Owner, and the ~~Interconnection Customer~~Developer disagree about whether a particular System Upgrade Facility is a Stand Alone System Upgrade Facility, ~~the ISO NYISO~~ and the Connecting Transmission Owner must provide the ~~Interconnection Customer~~Developer a written technical explanation outlining why ~~the~~the ISO NYISO and the Connecting Transmission Owner ~~do~~does not consider the System Upgrade Facility to be a Stand Alone System Upgrade Facility within fifteen (15) ~~Business Days~~days of its determination.

~~**Standard Interconnection Agreement (“IA”)** shall mean this agreement, which is the form of interconnection agreement applicable to an Interconnection Request pertaining to a Generating Facility, Class Year Transmission Project, or Cluster Study Transmission Project, that is included in Attachment HH of the ISO OATT.~~

~~**Standard Interconnection Procedures (“Interconnection Procedures” or “SIP”)** shall mean the interconnection procedures applicable to an Interconnection Request pertaining to a Generating Facility or Cluster Study Transmission Project that are included in this Attachment HH of the ISO OATT.~~

**Standard Large Facility Interconnection Procedures (“Large Facility Interconnection Procedures” or “LFIP”)** shall mean the interconnection procedures applicable to an Interconnection Request pertaining to a ~~Large~~ Generating Facility ~~or Class Year Transmission Project~~ that are included in Attachment X of the ISO OATT.

~~**Standard Upgrade Construction Agreement** shall mean the agreement contained in Appendix 16 to Attachment HH that is made, as applicable, among: (i) the ISO, (ii) the Affected System Operator or Affected Transmission Owner, and (iii) the Interconnection Customer or Affected System Interconnection Customer to facilitate the construction of and to set forth cost responsibility for necessary System Upgrades Facilities, System Deliverability Upgrades, or Affected System Network Upgrades on the New York State Transmission System or Distribution System.~~

~~**Standard Multiparty Upgrade Construction Agreement** shall mean the agreement contained in Appendix 17 to Attachment HH that is made, as applicable, among (i) the ISO, (ii) the Affected System Operator or Affected Transmission Owner, and (iii) multiple Interconnection Customers or Affected System Interconnection Customers to facilitate the construction of and to set forth cost responsibility for necessary System Upgrade Facilities, System Deliverability~~

~~Upgrades, or Affected System Network Upgrades on the New York State Transmission System or Distribution System.~~

~~Synchronization Date shall mean the date upon which the Generating Facility, Class Year Transmission Project, or Cluster Study Transmission Project is initially synchronized and upon which Trial Operation begins, notice of which must be provided by the Interconnection Customer to the NYISO and Connecting Transmission Owner in the form provided in Appendix E-1. Synchronization Date shall include the term Initial Synchronization Date as that term is used in Attachments S, X, and Z to the ISO OATT.~~**System Deliverability Upgrades** shall mean the least costly configuration of commercially available components of electrical equipment that can be used, consistent with Good Utility Practice and Applicable Reliability Requirements, to make the modifications or additions to Byways and Highways and Other Interfaces on the existing New York State Transmission System and Distribution System that are required for the proposed project to connect reliably to the system in a manner that meets the NYISO Deliverability Interconnection Standard at the requested level of Capacity Resource Interconnection Service.

**System Protection Facilities** shall mean the equipment, including necessary protection signal communications equipment, required to (1) protect the New York State Transmission System from faults or other electrical disturbances occurring at ~~the~~ Generating Facility and (2) protect the Generating Facility from faults or other electrical system disturbances occurring on the New York State Transmission System or on other delivery systems or other generating systems to which the New York State Transmission System is directly connected.

**System Upgrade Facilities** shall mean the least costly configuration of commercially available components of electrical equipment that can be used, consistent with Good Utility Practice and Applicable Reliability Requirements, to make the modifications to the existing transmission system that are required to maintain system reliability due to: (i) changes in the system, including such changes as load growth and changes in load pattern, to be addressed in the form of generic generation or transmission projects; and (ii) proposed interconnections. In the case of proposed interconnection projects, System Upgrade Facilities are the modifications or additions to the existing New York State Transmission System that are required for the proposed project to connect reliably to the system in a manner that meets the NYISO Minimum Interconnection Standard.

**Tariff** shall mean the NYISO Open Access Transmission Tariff (“OATT”), as filed with the Commission, and as amended or supplemented from time to time, or any successor tariff.

**Trial Operation** shall mean the period during which ~~Interconnection Customer~~ Developer is engaged in on-site test operations and commissioning of ~~the~~ Generating Facility prior to Commercial Operation.

## ARTICLE 2. EFFECTIVE DATE, TERM AND TERMINATION

### 2.1 Effective Date.

This Agreement shall become effective upon execution by the Parties, subject to acceptance by FERC, or if filed unexecuted, upon the date specified by FERC. The ~~NYISO and~~ Connecting Transmission Owner shall promptly file this Agreement with FERC upon execution in accordance with Article 3.

### 2.2 Term of Agreement.

Subject to the provisions of Article 2.3, this Agreement shall remain in effect for a period of ~~ten (10)~~ 15 years from the Effective Date or such other longer period as the ~~Interconnection-Customer~~ Developer may request ~~(Term to be Specified in Individual Agreements)}~~ and shall be automatically renewed for each successive one-year period thereafter.

### 2.3 Termination.

#### 2.3.1 Written Notice.

This Agreement may be terminated:-  
(i) by the ~~Interconnection-Customer~~ Developer after giving the ~~NYISO and~~ Connecting Transmission Owner ninety (90) Calendar Days advance written notice; or  
(ii) by the ~~NYISO and~~ Connecting Transmission Owner ~~by providing written notice to Interconnection-Customer~~ notifying FERC after, ~~as applicable, the both~~ both Generating ~~Facility-~~ Facilities are Retired ~~or the Class Year Transmission Project or Cluster Study Transmission-Project permanently ceases Commercial Operation.~~

#### 2.3.2 Default.

~~Any~~ Either Party may terminate this Agreement in accordance with Article 17.

#### 2.3.3 Compliance.

Notwithstanding Articles 2.3.1 and 2.3.2, no termination of this Agreement shall become effective until the Parties have complied with all Applicable Laws and Regulations applicable to such termination, including the filing with FERC of a notice of termination of this Agreement, which notice has been accepted for filing by FERC.

### 2.4 Termination Costs.

If a Party elects to terminate this Agreement pursuant to Article 2.3.1 above, the terminating Party shall pay all costs incurred (including any cancellation costs relating to orders or contracts for Attachment Facilities and equipment) or charges assessed by the other ~~Parties~~ Party, as of the date of the other ~~Parties~~ Party's receipt of such notice of termination, that

are the responsibility of the terminating Party under this Agreement. In the event of termination by a Party, ~~all~~both Parties shall use commercially ~~Reasonable Efforts~~reasonable efforts to mitigate the costs, damages and charges arising as a consequence of termination. Upon termination of this Agreement, unless otherwise ordered or approved by FERC:

**2.4.1** With respect to any portion of the Connecting Transmission Owner's Attachment Facilities that have not yet been constructed or installed, the Connecting Transmission Owner shall to the extent possible and with ~~Interconnection-Customer~~Developer's authorization cancel any pending orders of, or return, any materials or equipment for, or contracts for construction of, such facilities; provided that in the event ~~Interconnection-Customer~~Developer elects not to authorize such cancellation, ~~Interconnection-Customer~~Developer shall assume all payment obligations with respect to such materials, equipment, and contracts, and the Connecting Transmission Owner shall deliver such material and equipment, and, if necessary, assign such contracts, to ~~Interconnection-Customer~~Developer as soon as practicable, at ~~Interconnection-Customer~~Developer's expense. To the extent that ~~Interconnection-Customer~~Developer has already paid Connecting Transmission Owner for any or all such costs of materials or equipment not taken by ~~Interconnection-Customer~~Developer, Connecting Transmission Owner shall promptly refund such amounts to ~~Interconnection-Customer~~Developer, less any costs, including penalties incurred by the Connecting Transmission Owner to cancel any pending orders of or return such materials, equipment, or contracts.

If ~~Interconnection-Customer~~Developer terminates this Agreement, it shall be responsible for all costs incurred in association with ~~Interconnection-Customer~~Developer's interconnection, including any cancellation costs relating to orders or contracts for Attachment Facilities and equipment, and other expenses including any System Upgrade Facilities and System Deliverability Upgrades for which the Connecting Transmission Owner has incurred expenses and was unable to mitigate or avoid using commercially reasonable efforts and has not been reimbursed by the ~~Interconnection-Customer~~Developer.

**2.4.2** Connecting Transmission Owner may, at its option, retain any portion of such materials, equipment, or facilities that ~~Interconnection-Customer~~Developer chooses not to accept delivery of, in which case Connecting Transmission Owner shall be responsible for all costs associated with procuring such materials, equipment, or facilities.

**2.4.3** With respect to any portion of the Attachment Facilities, and any other facilities already installed or constructed pursuant to the terms of this Agreement, ~~Interconnection-Customer~~Developer shall be responsible for all costs associated with the removal, relocation or other disposition or retirement of such materials, equipment, or facilities.

## **2.5 Disconnection.**

Upon termination of this Agreement, ~~Interconnection-Customer~~Developer and Connecting Transmission Owner will take all appropriate steps to disconnect the ~~Interconnection-Customer's Facility~~Developer's Generating Facilities from the New York State Transmission-~~System or Distribution~~ System. All costs required to effectuate such disconnection shall be

borne by the terminating Party, unless such termination resulted from the non-terminating Party's Default of this Agreement or such non-terminating Party otherwise is responsible for these costs under this Agreement.

## **2.6 Survival.**

This Agreement shall continue in effect after termination to the extent necessary to provide for final billings and payments and for costs incurred hereunder; including billings and payments pursuant to this Agreement; to permit the determination and enforcement of liability and indemnification obligations arising from acts or events that occurred while this Agreement was in effect; and to permit ~~Interconnection Customer~~Developer and Connecting Transmission Owner each to have access to the lands of the other pursuant to this Agreement or other applicable agreements, to disconnect, remove or salvage its own facilities and equipment.

## **ARTICLE 3. REGULATORY FILINGS**

~~NYISO and~~ Connecting Transmission Owner shall file this Agreement (and any amendment hereto) with the appropriate Governmental Authority, if required. Any information related to studies for interconnection asserted by ~~Interconnection Customer~~Developer to contain Confidential Information shall be treated in accordance with Article 22 of this Agreement and Attachment F to the ISO OATT. If the ~~Interconnection Customer~~Developer has executed this Agreement, or any amendment thereto, ~~Interconnection Customer~~the Developer shall reasonably cooperate with ~~NYISO and~~ Connecting Transmission Owner with respect to such filing and to provide any information reasonably requested by ~~NYISO and~~ Connecting Transmission Owner needed to comply with Applicable Laws and Regulations.

## **ARTICLE 4. SCOPE OF INTERCONNECTION SERVICE**

### **4.1 Provision of Service.**

The Parties understand that the NYISO will provide ~~Interconnection Customer~~Developer with interconnection service of the following type for the term of this Agreement.

#### **4.1.1 Product.**

~~Subject to Article 4.1.2, The Parties understand that the~~ NYISO will provide [~~\_\_\_\_\_~~  
~~\_\_\_\_\_~~]Energy Resource Interconnection Service and/or Capacity Resource  
Interconnection Service to ~~Interconnection Customer~~Developer at the Point of Interconnection.

#### **~~4.1.2 Execution of Agreement Prior to Completion of Class Year Study or Cluster Study.~~**

~~If the Agreement, including a Provisional Standard Interconnection Agreement, is executed prior to the completion of, as applicable, the Class Year Study or Cluster Study for the Facility, Interconnection Customer shall, as applicable: (i) in the Class Year Study decision process accept the Project Cost Allocation and post Security for any System Upgrade Facilities that are identified for the Facility and cost allocated in the Class Year Study, or (ii) in the Cluster~~

~~Study decision process accept the Project Cost Allocation and post Security for any Connecting-Transmission Owner's Attachment Facilities, System Upgrade Facilities, and Distribution Upgrades that are identified for the Facility and cost allocated in the Cluster Study.— Interconnection Customer must accept such cost allocation and post the required Security even if the Project Cost Allocation exceeds the estimate included in this Agreement and includes equipment not identified in the Agreement.— Unless Interconnection Customer otherwise obtains CRIS in accordance with the requirements in Attachments S or HH to the OATT, Interconnection Customer cannot participate as an Installed Capacity Supplier until after, as applicable, the Class-Year Study or Cluster Study is completed and (1) the project is deemed deliverable and Interconnection Customer accepts its Deliverable MWs, or (2) the Interconnection Customer accepts its Project Cost Allocation and posts Security for any required System Deliverability Upgrades.— If the upgrades or cost estimates identified in the Class Year Study or Cluster Study or otherwise determined in accordance with Attachments S or HH differ from the amounts and description in this Agreement, the Parties shall amend the Agreement, pursuant to Articles 29.11 and 29.12 of this Agreement, to reflect the results of, as applicable, the Class Year Study or Cluster Study.~~

#### **~~4.1.3—Interconnection Customer~~**

4.1.2 Developer is responsible for ensuring that its actual Generating Facility output matches the scheduled delivery from ~~the~~that Generating Facility to the New York State Transmission System, consistent with the scheduling requirements of the NYISO's FERC-approved market structure, including ramping into and out of such scheduled delivery, as measured at the Point of Interconnection, consistent with the scheduling requirements of the ISO OATT and any applicable FERC-approved market structure.

#### **4.2 No Transmission Delivery Service.**

The execution of this Agreement does not constitute a request for, nor agreement to provide, any Transmission Service under the ISO OATT, and does not convey any right to deliver electricity to any specific customer or Point of Delivery. If ~~Interconnection-Customer~~Developer wishes to obtain Transmission Service on the New York State Transmission System, then ~~Interconnection-Customer~~Developer must request such Transmission Service in accordance with the provisions of the ISO OATT.

#### **4.3 No Other Services.**

The execution of this Agreement does not constitute a request for, nor agreement to provide Energy, any Ancillary Services or Installed Capacity under the ~~ISO~~NYISO Market Administration and Control Area Services Tariff ("Services Tariff"). If ~~Interconnection-Customer~~Developer wishes to supply Energy, Installed Capacity or Ancillary Services, then ~~Interconnection-Customer~~Developer will make application to do so in accordance with the ~~ISO~~NYISO Services Tariff.

## ARTICLE 5. INTERCONNECTION FACILITIES ENGINEERING, PROCUREMENT, AND CONSTRUCTION

### 5.1 Options.

Unless otherwise mutually agreed to by ~~Interconnection Customer~~Developer and Connecting Transmission Owner, ~~Interconnection Customer~~Developer shall select the In-Service Date, ~~Initial Backfeed Date~~, Synchronization Date, and Commercial Operation Date; and either the Standard Option or Alternate Option set forth below, and such dates and selected option shall be set forth in Appendix B hereto. At the same time, ~~Interconnection Customer~~Developer shall indicate whether it elects to exercise the Option to Build set forth in Article 5.1.3 below. If the dates designated by ~~Interconnection Customer~~the Developer are not acceptable to the Connecting Transmission Owner, the Connecting Transmission Owner shall so notify ~~Interconnection Customer~~the Developer within thirty (30) Calendar Days. Upon receipt of the notification that ~~Interconnection Customer~~Developer's designated dates are not acceptable to the Connecting Transmission Owner, ~~Interconnection Customer~~the Developer shall notify the Connecting Transmission Owner within thirty (30) Calendar Days whether it elects to exercise the Option to Build if it has not already elected to exercise the Option to Build.

#### 5.1.1 Standard Option.

The Connecting Transmission Owner shall design, procure, and construct the Connecting Transmission Owner's Attachment Facilities; and System Upgrade Facilities and System Deliverability Upgrades, using Reasonable Efforts to complete the Connecting Transmission Owner's Attachment Facilities; and System Upgrade Facilities and System Deliverability Upgrades by the dates set forth in Appendix B hereto. The Connecting Transmission Owner shall not be required to undertake any action which is inconsistent with its standard safety practices, its material and equipment specifications, its design criteria and construction procedures, its labor agreements, and Applicable Laws and Regulations. In the event the Connecting Transmission Owner reasonably expects that it will not be able to complete the Connecting Transmission Owner's Attachment Facilities; and System Upgrade Facilities and System Deliverability Upgrades by the specified dates, the Connecting Transmission Owner shall promptly provide written notice to ~~Interconnection Customer and NYISO~~the Developer, and shall undertake Reasonable Efforts to meet the earliest dates thereafter.

#### 5.1.2 Alternate Option.

If the dates designated by ~~Interconnection Customer~~Developer are acceptable to Connecting Transmission Owner, the Connecting Transmission Owner shall so notify ~~Interconnection Customer and NYISO~~Developer within thirty (30) Calendar Days, and shall assume responsibility for the design, procurement and construction of the Connecting Transmission Owner's Attachment Facilities by the designated dates. If Connecting Transmission Owner subsequently fails to complete Connecting Transmission Owner's Attachment Facilities by the ~~Initial Backfeed~~-Service Date, to the extent necessary to provide back feed power; or fails to complete System Upgrade Facilities or System Deliverability Upgrades by the Initial Synchronization Date to the extent necessary to allow for Trial Operation

at full power output, unless other arrangements are made by ~~Interconnection Customer~~the Developer and Connecting Transmission Owner for such Trial Operation; or fails to complete the System Upgrade Facilities and System Deliverability Upgrades by the Commercial Operation Date, as such dates are reflected in Appendix B hereto; Connecting Transmission Owner shall pay ~~Interconnection Customer~~Developer liquidated damages in accordance with Article 5.3, Liquidated Damages, provided, however, the dates designated by ~~Interconnection Customer~~Developer shall be extended day for day for each day that NYISO refuses to grant clearances to install equipment.

### 5.1.3 Option to Build.

~~Individual or multiple Interconnection Customer(s)~~Developer shall have the option to assume responsibility for the design, procurement and construction of Connecting Transmission Owner's Attachment Facilities and Stand Alone System Upgrade Facilities on the dates specified in Article 5.1.2 ~~if the requirements in this Article 5.1.3 are met. When multiple Interconnection Customers may agree to exercise this option, multiple Interconnection Customers may agree to exercise this option provided (1) all Connecting Transmission Owner's; provided that if an Attachment Facilities and Facility or Stand Alone System Upgrade Facilities constructed under this option are only required for Interconnection Customers in a single Cluster and (2) all impacted Interconnection Customers execute and provide to the NYISO and Connecting Transmission Owner an agreement regarding responsibilities and payments for the construction of the Connecting Transmission Owner's Attachment Facilities and Stand Alone System Upgrade Facilities planned to be built under this option~~Facility is needed for more than one Developer's project, Developer's option to build such facility shall be contingent on the agreement of all other affected Developers. NYISO, Connecting Transmission Owner, and the individual Interconnection Customer or each of the multiple Interconnection CustomersDeveloper must agree as to what constitutes Stand Alone System Upgrade Facilities and identify such Stand Alone System Upgrade Facilities in Appendix A hereto. Except for Stand Alone System Upgrade Facilities, ~~Interconnection Customer~~Developer shall have no right to construct System Upgrade Facilities ~~or System Deliverability Upgrades~~ under this option.

### 5.1.4 Negotiated Option.

If the dates designated by ~~Interconnection Customer~~Developer are not acceptable to the Connecting Transmission Owner, ~~Interconnection Customer~~the Developer and Connecting Transmission Owner shall in good faith attempt to negotiate terms and conditions (including revision of the specified dates and liquidated damages, the provision of incentives or the procurement and construction of all facilities other than the Connecting Transmission Owner's Attachment Facilities and Stand Alone System Upgrade Facilities if ~~Interconnection Customer~~the Developer elects to exercise the Option to Build under Article 5.1.3. If the two Parties are unable to reach agreement on such terms and conditions, then, pursuant to Article 5.1.1 (Standard Option), Connecting Transmission Owner shall assume responsibility for the design, procurement and construction of all facilities other than the Connecting Transmission Owner's Attachment Facilities and Stand Alone System Upgrade Facilities if ~~Interconnection Customer~~the Developer elects to exercise the Option to Build.

## 5.2 General Conditions Applicable to Option to Build.

If ~~Interconnection Customer~~Developer assumes responsibility for the design, procurement and construction of the Connecting Transmission Owner's Attachment Facilities and Stand Alone System Upgrade Facilities, the following conditions apply:

5.2.1 ~~Interconnection Customer~~Developer shall engineer, procure equipment, and construct the Connecting Transmission Owner's Attachment Facilities and Stand Alone System Upgrade Facilities (or portions thereof) using Good Utility Practice and using standards and specifications provided in advance by the Connecting Transmission Owner;

5.2.2 ~~Interconnection Customer~~Developer's engineering, procurement and construction of the Connecting Transmission Owner's Attachment Facilities and Stand Alone System Upgrade Facilities shall comply with all requirements of law to which Connecting Transmission Owner would be subject in the engineering, procurement or construction of the Connecting Transmission Owner's Attachment Facilities and Stand Alone System Upgrade Facilities;

5.2.3 Connecting Transmission Owner shall review and approve the engineering design, equipment acceptance tests, and the construction of the Connecting Transmission Owner's Attachment Facilities and Stand Alone System Upgrade Facilities;

5.2.4 Prior to ~~the~~ commencement of construction, ~~Interconnection Customer~~Developer shall provide to Connecting Transmission Owner and NYISO a schedule for construction of the Connecting Transmission Owner's Attachment Facilities and Stand Alone System Upgrade Facilities, and shall promptly respond to requests for information from Connecting Transmission Owner or NYISO;

5.2.5 At any time during construction, Connecting Transmission Owner shall have the right to gain unrestricted access to the Connecting Transmission Owner's Attachment Facilities and Stand Alone System Upgrade Facilities and to conduct inspections of the same;

5.2.6 At any time during construction, should any phase of the engineering, equipment procurement, or construction of the Connecting Transmission Owner's Attachment Facilities and Stand Alone System Upgrade Facilities not meet the standards and specifications provided by Connecting Transmission Owner, ~~Interconnection Customer~~the Developer shall be obligated to remedy deficiencies in that portion of the Connecting Transmission Owner's Attachment Facilities and Stand Alone System Upgrade Facilities;

5.2.7 ~~Interconnection Customer~~Developer shall indemnify Connecting Transmission Owner and NYISO for claims arising from ~~Interconnection Customer~~the Developer's construction of Connecting Transmission Owner's Attachment Facilities, ~~and~~ Stand Alone System Upgrade Facilities under procedures applicable to Article 18.1 Indemnity;

5.2.8 ~~Interconnection Customer~~Developer shall transfer control of Connecting Transmission Owner's Attachment Facilities and Stand Alone System Upgrade Facilities to the Connecting Transmission Owner;

5.2.9 Unless ~~Interconnection Customer~~the Developer and Connecting Transmission Owner otherwise agree, ~~Interconnection Customer~~Developer shall transfer ownership of Connecting Transmission Owner's Attachment Facilities and Stand Alone System Upgrade Facilities to Connecting Transmission Owner;

5.2.10 Connecting Transmission Owner shall approve and accept for operation and maintenance the Connecting Transmission Owner's Attachment Facilities and Stand Alone System Upgrade Facilities to the extent engineered, procured, and constructed in accordance with this Article 5.2; and

5.2.11 ~~Interconnection Customer~~Developer shall deliver to NYISO and Connecting Transmission Owner "as built" drawings, information, and any other documents that are reasonably required by NYISO or Connecting Transmission Owner to assure that the Attachment Facilities and Stand Alone System Upgrade Facilities are built to the standards and specifications required by Connecting Transmission Owner; ~~and~~

~~5.2.12 If Interconnection Customer exercises the Option to Build pursuant to Article 5.1.3, Interconnection Customer shall pay the Connecting Transmission Owner the agreed upon amount of [\$ PLACEHOLDER] for the Connecting Transmission Owner to execute the responsibilities enumerated to Connecting Transmission Owner under Article 5.2. The Connecting Transmission Owner shall invoice Interconnection Customer for this total amount to be divided on a monthly basis pursuant to Article 12.~~

### 5.3 Liquidated Damages.

The actual damages to ~~Interconnection Customer~~the Developer, in the event the Connecting Transmission Owner's Attachment Facilities; ~~or~~ and System Upgrade Facilities or System Deliverability Upgrades are not completed by the dates designated by ~~Interconnection Customer~~the Developer and accepted by the Connecting Transmission Owner pursuant to subparagraphs 5.1.2 or 5.1.4, above, may include ~~Interconnection Customer~~Developer's fixed operation and maintenance costs and lost opportunity costs. Such actual damages are uncertain and impossible to determine at this time. Because of such uncertainty, any liquidated damages paid by the Connecting Transmission Owner to ~~Interconnection Customer~~the Developer in the event that Connecting Transmission Owner does not complete any portion of the Connecting Transmission Owner's Attachment Facilities, System Upgrade Facilities or System Deliverability Upgrades by the applicable dates, shall be an amount equal to 1/2 of 1 percent per day of the actual cost of the Connecting Transmission Owner's Attachment Facilities; ~~and~~ and System Upgrade Facilities and System Deliverability Upgrades, in the aggregate, for which Connecting Transmission Owner has assumed responsibility to design, procure and construct.

However, in no event shall the total liquidated damages exceed 20 percent of the actual cost of the Connecting Transmission Owner's Attachment Facilities; ~~and~~ and System Upgrade Facilities and System Deliverability Upgrades for which the Connecting Transmission Owner has assumed responsibility to design, procure, and construct. The foregoing payments will be made by the Connecting Transmission Owner to ~~Interconnection Customer~~the Developer as just compensation for the damages caused to ~~Interconnection Customer~~the Developer, which actual

damages are uncertain and impossible to determine at this time, and as reasonable liquidated damages, but not as a penalty or a method to secure performance of this Agreement. Liquidated damages, when ~~Interconnection Customer~~the Developer and Connecting Transmission Owner agree to them, are the exclusive remedy for the Connecting Transmission Owner's failure to meet its schedule.

Further, Connecting Transmission Owner shall not pay liquidated damages to ~~Interconnection Customer~~Developer if: (1) ~~Interconnection Customer~~Developer is not ready to commence use of the Connecting Transmission Owner's Attachment Facilities, ~~or~~ or System Upgrade Facilities or System Deliverability Upgrades to take the delivery of power for the ~~Interconnection Customer's Facility's~~ Trial Operation of a Generating Facility or to export power from ~~Interconnection Customer's~~ the Generating Facility on the specified dates, unless ~~Interconnection Customer~~the Developer would have been able to commence use of the Connecting Transmission Owner's Attachment Facilities, ~~or~~ or System Upgrade Facilities or System Deliverability Upgrades to take the delivery of power for ~~Interconnection Customer's~~ the Generating Facility's Trial Operation or to export power from the ~~Interconnection Customer's~~ Generating Facility, but for Connecting Transmission Owner's delay; (2) the Connecting Transmission Owner's failure to meet the specified dates is the result of the action or inaction of ~~Interconnection Customer~~the Developer or any other ~~Interconnection Customer~~Developer who has entered into ~~an interconnection agreement~~ a Large Generator Interconnection Agreement with the Connecting Transmission Owner or has entered into a Standard Large Generator Interconnection Agreement with the Connecting Transmission Owner and NYISO, or action or inaction by ~~any~~ the other Party, or any other cause beyond Connecting Transmission Owner's reasonable control or reasonable ability to cure; (3) ~~Interconnection Customer~~the Developer has assumed responsibility for the design, procurement and construction of the Connecting Transmission Owner's Attachment Facilities and Stand Alone System Upgrade Facilities; or (4) the Connecting Transmission Owner and ~~Interconnection Customer~~Developer have otherwise agreed. In no event shall NYISO have any liability whatever to ~~Interconnection Customer~~Developer for liquidated damages associated with the engineering, procurement or construction of Attachment Facilities, ~~or~~ or System Upgrade Facilities or System Deliverability Upgrades.

#### 5.4 Power System Stabilizers.

~~Interconnection Customer~~The Developer shall procure, install, maintain and operate Power System Stabilizers in accordance with the requirements identified in the ~~Class Year Study or Cluster Study conducted for~~ Interconnection Customer's Studies conducted for a Generating Facility. ~~NYISO and~~ Connecting Transmission Owner ~~reserve~~ reserves the right to reasonably establish minimum acceptable settings for any installed Power System Stabilizers, subject to the design and operating limitations of the Generating Facility. If the Generating Facility's Power System Stabilizers are removed from service or not capable of automatic operation, ~~Interconnection Customer~~the Developer shall immediately notify the Connecting Transmission Owner ~~and NYISO~~. The requirements of this paragraph shall not apply to wind generators.

## 5.5 ~~Design and~~ Equipment Procurement.

If responsibility for construction of the Connecting Transmission Owner's Attachment Facilities, ~~Distribution Upgrades, or~~ System Upgrade Facilities, or System Deliverability Upgrades is to be borne by the Connecting Transmission Owner, then the Connecting Transmission Owner shall commence design of the ~~applicable facilities for which it is responsible~~ Connecting Transmission Owner's Attachment Facilities or System Upgrade Facilities or System Deliverability Upgrades and procure necessary equipment as soon as practicable after all of the following conditions are satisfied, unless ~~Interconnection Customer~~ the Developer and Connecting Transmission Owner otherwise agree in writing:

5.5.1 NYISO and ~~/or~~ Connecting Transmission Owner, as applicable, have completed the ~~Class-Year-Study or Cluster~~ Interconnection Facilities Study pursuant to the Interconnection Facilities Study Agreement;

5.5.2 The NYISO has completed the required cost allocation analyses, and ~~Interconnection Customer~~ Developer has accepted its ~~Project Cost Allocation for, as applicable, the Connecting Transmission Owner's Attachment Facilities, Distribution Upgrades,~~ share of the costs for necessary System Upgrade Facilities, and System Deliverability Upgrades ~~required for the Facility~~ in accordance with the provisions of Attachment S ~~or HH~~ of the ISO OATT;

5.5.3 The Connecting Transmission Owner has received written authorization to proceed with design and procurement from ~~Interconnection Customer~~ the Developer by the date specified in Appendix B hereto; and

5.5.4 ~~Interconnection Customer~~ The Developer has provided security to the Connecting Transmission Owner ~~for the design and procurement of the applicable facilities~~ in accordance with Article 11.5 by the ~~date(s)~~ dates specified in Appendix B hereto.

## 5.6 Construction Commencement.

The Connecting Transmission Owner shall commence construction of the Connecting Transmission Owner's Attachment Facilities, ~~Distribution Upgrades, and~~ System Upgrade Facilities, and System Deliverability Upgrades for which it is responsible as soon as practicable after the following additional conditions are satisfied:

5.6.1 Approval of the appropriate Governmental Authority has been obtained for any facilities requiring regulatory approval;

5.6.2 Necessary real property rights and rights-of-way have been obtained, to the extent required for the construction of a discrete aspect of the Connecting Transmission Owner's Attachment Facilities, and System Upgrade Facilities, and System Deliverability Upgrades;

5.6.3 The Connecting Transmission Owner has received written authorization to proceed with construction from ~~Interconnection Customer~~ the Developer by the date specified in Appendix B hereto; and

**5.6.4** ~~Interconnection Customer~~The Developer has provided security to the Connecting Transmission Owner ~~for the construction of the applicable facilities~~ in accordance with Article 11.5 by the ~~date(s)~~dates specified in Appendix B hereto.

## **5.7 Work Progress.**

~~Interconnection Customer~~The Developer and Connecting Transmission Owner will keep each other, and NYISO, advised periodically as to the progress of their respective design, procurement and construction efforts. ~~Any~~Either Party may, at any time, request a progress report from ~~Interconnection Customer~~the Developer or Connecting Transmission Owner. If, at any time, ~~Interconnection Customer~~the Developer determines that the completion of the Connecting Transmission Owner's Attachment Facilities will not be required until after the specified ~~Initial Backfeed Service~~ Date, ~~Interconnection Customer~~the Developer will provide written notice to the Connecting Transmission Owner and NYISO of such later date upon which the completion of the Connecting Transmission Owner's Attachment Facilities will be required.

## **5.8 Information Exchange.**

As soon as reasonably practicable after the Effective Date, ~~Interconnection Customer~~the Developer and Connecting Transmission Owner shall exchange information, and provide NYISO the same information, regarding the design and compatibility of their respective Attachment Facilities and compatibility of the Attachment Facilities with the New York State Transmission System, and shall work diligently and in good faith to make any necessary design changes.

## **5.9 Other Interconnection Options**

### **5.9.1 Limited Operation.**

If any of the Connecting Transmission Owner's Attachment Facilities, ~~or~~ System Upgrade Facilities, ~~or~~ System Deliverability Upgrades are not reasonably expected to be completed prior to the Commercial Operation Date of ~~Interconnection Customer's~~a Generating Facility, NYISO ~~shall~~may, upon the request and at the expense of ~~Interconnection Customer~~Developer, in conjunction with the Connecting Transmission Owner, perform operating studies on a timely basis to determine the extent to which ~~Interconnection Customer's~~the Generating Facility and the ~~Interconnection Customer~~Developer's Attachment Facilities may operate prior to the completion of the Connecting Transmission Owner's Attachment Facilities, ~~or~~ System Upgrade Facilities, ~~or~~ System Deliverability Upgrades consistent with Applicable Laws and Regulations, Applicable Reliability Standards, Good Utility Practice, and this Agreement. Connecting Transmission Owner ~~and NYISO~~ shall permit ~~Interconnection Customer~~Developer to operate ~~Interconnection Customer's~~the Generating Facility and ~~Interconnection Customer~~the Developer's Attachment Facilities in accordance with the results of such studies.

### **5.9.2 Provisional Interconnection Service.**

Prior to: ~~(i) Interconnection Customer's eligibility under~~ the completion of the ~~Standard Large Facility Interconnection Procedures or Standard Interconnection Procedures pursuant to which it may enter into an interconnection agreement before the completion of the Class Year Study or Cluster Study and~~ (ii) the prior to completion of requisite Attachment Facilities, Distribution Upgrades, System Upgrade Facilities, System Distribution Upgrades, or System Protection Facilities, ~~Interconnection Customer~~ the Developer may request an evaluation for Provisional Interconnection Service. NYISO, in conjunction with the Connecting Transmission Owner, shall determine, through available studies or additional studies as necessary, whether stability, short circuit, thermal, and/or voltage issues would arise if ~~Interconnection Customer~~ the Developer interconnects without modifications to ~~the a Generating~~ Facility or the New York State Transmission System (or Distribution System as applicable). NYISO, in conjunction with the Connecting Transmission Owner, shall determine whether any Attachment Facilities, Distribution Upgrades, System Upgrade Facilities, System Deliverability Upgrades, or System Protection Facilities, which are necessary to meet Applicable Laws and Regulations, Applicable Reliability Standards, and Good Utility Practice, are in place prior to the commencement of interconnection service from the Large Facility. Where available studies indicate that the Attachment Facilities, Distribution Upgrades, System Upgrade Facilities, System Deliverability Upgrades, or System Protection Facilities are required for the interconnection of a new, modified and/or expanded Large Facility but such facilities are not currently in place, NYISO, in conjunction with the Connecting Transmission Owner, will perform a study, at ~~Interconnection Customer~~ the Developer's expense, to confirm the facilities that are required for Provisional Interconnection Service. The maximum permissible output of the Large Facility in the Provisional ~~Standard Large Facility~~ Interconnection Agreement shall be studied, at the ~~Interconnection Customer~~ Developer's expense, and updated annually. The NYISO shall issue the study's findings in writing to ~~Interconnection Customer~~ the Developer and Connecting Transmission Owner(s). Following a determination by NYISO, in conjunction with the Connecting Transmission Owner, that ~~Interconnection Customer~~ the Developer may reliably provide Provisional Interconnection Service, NYISO shall tender to ~~Interconnection Customer~~ the Developer and Connecting Transmission Owner, a Provisional ~~Standard Large Facility~~ Interconnection Agreement. NYISO, ~~Interconnection Customer~~ Developer, and Connecting Transmission Owner may execute the Provisional ~~Standard Large Facility~~ Interconnection Agreement, or ~~Interconnection Customer~~ the Developer may request the filing of an unexecuted Provisional ~~Standard Large Facility~~ Interconnection Agreement with the Commission. ~~Interconnection Customer~~ The Developer shall assume all risk and liabilities with respect to changes between the Provisional ~~Standard Large Facility~~ Interconnection Agreement and the ~~Standard Large Generator~~ Interconnection Agreement, including changes in output limits and the cost responsibilities for the Attachment Facilities, System Upgrade Facilities, System Deliverability Upgrades, and/or System Protection Facilities.

#### 5.10 ~~Interconnection Customer~~ Developer's Attachment Facilities (“~~ICAF~~ DAF”).

~~Interconnection Customer~~ Developer shall, at its expense, design, procure, construct, own and install the DAF, as set forth in Appendix A hereto.

### **5.10.1 ~~ICAF~~DAF Specifications.**

~~Interconnection Customer~~Developer shall submit initial specifications for the ~~ICAF~~DAF, including System Protection Facilities, to Connecting Transmission Owner and NYISO at least one hundred eighty (180) Calendar Days prior to the Initial Synchronization Date; and final specifications for review and comment at least ninety (90) Calendar Days prior to the Initial Synchronization Date. Connecting Transmission Owner ~~and NYISO~~ shall review, and the NYISO may review, such specifications to ensure that the ~~ICAF~~DAF are compatible with the technical specifications, operational control, and safety requirements of the Connecting Transmission Owner and NYISO and comment on such specifications within thirty (30) Calendar Days of ~~Interconnection Customer~~Developer's submission. All specifications provided hereunder shall be deemed to be Confidential Information.

### **5.10.2 No Warranty.**

The review of ~~Interconnection Customer~~Developer's final specifications by Connecting Transmission Owner and NYISO shall not be construed as confirming, endorsing, or providing a warranty as to the design, fitness, safety, durability or reliability of ~~the~~ a Generating Facility, or the ~~ICAF~~DAF. ~~Interconnection Customer~~Developer shall make such changes to the ~~ICAF~~DAF as may reasonably be required by Connecting Transmission Owner or NYISO, in accordance with Good Utility Practice, to ensure that the ~~ICAF~~DAF are compatible with the technical specifications, operational control, and safety requirements of the Connecting Transmission Owner and NYISO.

### **5.10.3 ~~ICAF~~DAF Construction.**

The DAF shall be designed and constructed in accordance with Good Utility Practice. Within one hundred twenty (120) Calendar Days after the Commercial Operation Date, unless ~~Interconnection Customer~~the Developer and Connecting Transmission Owner agree on another mutually acceptable deadline, ~~Interconnection Customer~~the Developer shall deliver to the Connecting Transmission Owner and NYISO "as-built" drawings, information and documents for the ~~ICAF~~DAF, such as: a one-line diagram, a site plan showing ~~the~~ each Generating Facility and the ~~ICAF~~DAF, plan and elevation drawings showing the layout of the ~~ICAF~~DAF, a relay functional diagram, relaying AC and DC schematic wiring diagrams and relay settings for all facilities associated with ~~Interconnection Customer~~the Developer's step-up transformers, the facilities connecting ~~the~~ each Generating Facility to the step-up transformers and the ~~ICAF~~DAF, and the impedances (determined by factory tests) for the associated step-up transformers and ~~the~~ each Generating Facility. ~~Interconnection Customer~~The Developer shall provide to, and coordinate with, Connecting Transmission Owner and NYISO with respect to proposed specifications for the excitation system, automatic voltage regulator, Generating Facility control and protection settings, transformer tap settings, and communications, if applicable.

## **5.11 Connecting Transmission Owner's Attachment Facilities Construction.**

The Connecting Transmission Owner's Attachment Facilities shall be designed and constructed in accordance with Good Utility Practice. Upon request, within one hundred twenty (120) Calendar Days after the Commercial Operation Date, unless the Connecting Transmission

Owner and ~~Interconnection Customer~~Developer agree on another mutually acceptable deadline, the Connecting Transmission Owner shall deliver to ~~Interconnection Customer~~the Developer “as-built” drawings, relay diagrams, information and documents for the Connecting Transmission Owner’s Attachment Facilities set forth in Appendix A.

~~The Connecting Transmission Owner [shall/shall not] transfer operational control of the Connecting Transmission Owner’s Attachment Facilities and Stand Alone System Upgrade Facilities to the NYISO upon completion of such facilities~~

## **5.12 Access Rights.**

Upon reasonable notice and supervision by the Granting Party, and subject to any required or necessary regulatory approvals, either the Connecting Transmission Owner or ~~Interconnection Customer~~Developer (“Granting Party”) shall furnish to the other of those two Parties (“Access Party”) at no cost any rights of use, licenses, rights of way and easements with respect to lands owned or controlled by the Granting Party, its agents (if allowed under the applicable agency agreement), or any Affiliate, that are necessary to enable the Access Party to obtain ~~the~~ ingress and egress at the Point of Interconnection to construct, operate, maintain, repair, test (or witness testing), inspect, replace or remove facilities and equipment to: (i) interconnect ~~the~~ each Generating Facility with the New York State Transmission System ~~or Distribution System~~; (ii) operate and maintain ~~the~~ each Generating Facility, the Attachment Facilities, and the New York State Transmission System; and (iii) disconnect or remove the Access Party’s facilities and equipment upon termination of this Agreement. In exercising such licenses, rights of way and easements, the Access Party shall not unreasonably disrupt or interfere with normal operation of the Granting Party’s business and shall adhere to the safety rules and procedures established in advance, as may be changed from time to time, by the Granting Party and provided to the Access Party. The Access Party shall indemnify the Granting Party against all claims of injury or damage from third parties resulting from the exercise of the access rights provided for herein.

## **5.13 Lands of Other Property Owners.**

If any part of the Connecting Transmission Owner’s Attachment Facilities, and/or System Upgrade Facilities, and/or System Deliverability Upgrades is to be installed on property owned by persons other than ~~Interconnection Customer~~Developer or Connecting Transmission Owner, the Connecting Transmission Owner shall at ~~Interconnection Customer~~Developer’s expense use efforts, similar in nature and extent to those that it typically undertakes for its own or affiliated generation, including use of its eminent domain authority, and to the extent consistent with state law, to procure from such persons any rights of use, licenses, rights of way and easements that are necessary to construct, operate, maintain, test, inspect, replace or remove the Connecting Transmission Owner’s Attachment Facilities, and/or System Upgrade Facilities, and/or System Deliverability Upgrades upon such property.

#### 5.14 Permits.

~~NYISO~~, Connecting Transmission Owner, and ~~Interconnection Customer~~the Developer shall cooperate with each other in good faith in obtaining all permits, licenses and authorizations that are necessary to accomplish the interconnection in compliance with Applicable Laws and Regulations. With respect to this paragraph, Connecting Transmission Owner shall provide permitting assistance to ~~Interconnection Customer~~the Developer comparable to that provided to the Connecting Transmission Owner's own, or an Affiliate's generation, if any.

#### 5.15 Early Construction of Base Case Facilities.

~~Interconnection Customer~~Developer may request Connecting Transmission Owner to construct, and Connecting Transmission Owner shall construct, subject to a binding cost allocation agreement reached in accordance with Attachment S ~~or HH~~ to the ISO OATT, including Section 25.8.7 ~~or 40.17~~ thereof, using Reasonable Efforts to accommodate ~~Interconnection Customer's Initial Backfeed~~Developer's In-Service Date, all or any portion of any System Upgrade Facilities or System Deliverability Upgrades required for ~~Interconnection Customer~~Developer to be interconnected to the New York State Transmission System which are included in the Base Case of the Class Year Study ~~or Cluster Study~~ for ~~Interconnection Customer~~the Developer, and which also are required to be constructed for another ~~Interconnection Customer~~Developer, but where such construction is not scheduled to be completed in time to achieve ~~Interconnection Customer's Initial Backfeed~~Developer's In-Service Date.

#### 5.16 Suspension.

~~Interconnection Customer~~Developer reserves the right, upon written notice to Connecting Transmission Owner ~~and NYISO~~, to suspend at any time all work by Connecting Transmission Owner ~~or Interconnection Customer, as applicable~~, associated with the construction and installation of Connecting Transmission Owner's Attachment Facilities, ~~and/or~~ System Upgrade Facilities, and/or System Deliverability Upgrades required for only that ~~Interconnection Customer~~Developer under this Agreement with the condition that the New York State Transmission System shall be left in a safe and reliable condition in accordance with Good Utility Practice and the safety and reliability criteria of Connecting Transmission Owner and NYISO. In such event, ~~Interconnection Customer~~Developer shall be responsible for all reasonable and necessary costs and/or obligations in accordance with Attachment ~~HHS~~S to the ISO OATT including those which Connecting Transmission Owner (i) has incurred pursuant to this Agreement prior to the suspension and (ii) incurs ~~as a result of the suspension of~~in suspending such work, including any costs incurred ~~by the Connecting Transmission Owner~~ to perform such work as may be necessary to ensure the safety of persons and property and the integrity of the New York State Transmission System during such suspension and, if applicable, any costs incurred in connection with the cancellation or suspension of material, equipment, and labor contracts which Connecting Transmission Owner cannot reasonably avoid; provided, however, that prior to canceling or suspending any such material, equipment, or labor contract, Connecting Transmission Owner shall obtain ~~Interconnection Customer~~Developer's authorization to do so. ~~Interconnection Customer's election to suspend work pursuant to this Article 5.16 shall not toll the time period by which an Interconnection Customer may extend the~~

~~Commercial Operation Date for the Facility without such extension being a Material Modification pursuant to Attachment HH to the OATT.~~

Connecting Transmission Owner shall invoice ~~Interconnection Customer~~Developer for such costs pursuant to Article 12 and shall use due diligence to minimize its costs. ~~If: (i) pursuant to this Article 5.16, Interconnection Customer~~In the event Developer suspends work ~~associated with the construction and installation of by~~ Connecting Transmission Owner's ~~Attachment Facilities, System Upgrade Facilities, and/or System Deliverability Upgrades that is~~ required under this Agreement pursuant to this Article 5.16, and ~~(ii) Interconnection Customer has, as applicable, either not recommenced work or~~has not requested Connecting Transmission Owner to recommence ~~its~~the work required under this Agreement on or before the expiration of three (3) years following commencement of such suspension, this Agreement shall be deemed terminated. The three-year period shall begin on the date the suspension is requested, or the date of the written notice to Connecting Transmission Owner ~~and NYISO~~, if no effective date is specified.

## **5.17 Taxes.**

~~If the Facility is a Class Year Transmission Project or a Cluster Study Transmission Project, Appendix C to this Agreement shall include any project specific variations from the tax requirements established in this Article 5.17 that are appropriate for the transmission facility.—~~

### **5.17.1 ~~Interconnection Customer~~Developer Payments Not Taxable.**

~~Interconnection Customer~~The Developer and Connecting Transmission Owner intend that all payments or property transfers made by ~~Interconnection Customer~~Developer to Connecting Transmission Owner for the installation of the Connecting Transmission Owner's Attachment Facilities and the System Upgrade Facilities and the System Deliverability Upgrades shall be non-taxable, either as contributions to capital, or as an advance, in accordance with the Internal Revenue Code and any applicable state income tax laws and shall not be taxable as contributions in aid of construction or otherwise under the Internal Revenue Code and any applicable state income tax laws.

### **5.17.2 Representations and Covenants.**

In accordance with IRS Notice 2001-82 and IRS Notice 88-129, ~~Interconnection Customer~~Developer represents and covenants that (i) ownership of the electricity generated at ~~the each~~ Generating Facility will pass to another party prior to the transmission of the electricity on the New York State Transmission System, (ii) for income tax purposes, the amount of any payments and the cost of any property transferred to the Connecting Transmission Owner for the Connecting Transmission Owner's Attachment Facilities will be capitalized by ~~Interconnection Customer~~Developer as an intangible asset and recovered using the straight-line method over a useful life of twenty (20) years, and (iii) any portion of the Connecting Transmission Owner's Attachment Facilities that is a "dual-use intertie," within the meaning of IRS Notice 88-129, is reasonably expected to carry only a de minimis amount of electricity in the direction of the

Generating ~~Facility~~Facilities. For this purpose, “de minimis amount” means no more than 5 percent of the total power flows in both directions, calculated in accordance with the “5 percent test” set forth in IRS Notice 88-129. This is not intended to be an exclusive list of the relevant conditions that must be met to conform to IRS requirements for non-taxable treatment.

At Connecting Transmission Owner’s request, ~~Interconnection-Customer~~Developer shall provide Connecting Transmission Owner with a report from an independent engineer confirming its representation in clause (iii), above. Connecting Transmission Owner represents and covenants that the cost of the Connecting Transmission Owner’s Attachment Facilities paid for by ~~Interconnection-Customer~~Developer will have no net effect on the base upon which rates are determined.

#### **5.17.3 Indemnification for the Cost Consequences of Current Tax Liability Imposed Upon the Connecting Transmission Owner.**

Notwithstanding Article 5.17.1, ~~Interconnection-Customer~~Developer shall protect, indemnify and hold harmless Connecting Transmission Owner from the cost consequences of any current tax liability imposed against Connecting Transmission Owner as the result of payments or property transfers made by ~~Interconnection-Customer~~Developer to Connecting Transmission Owner under this Agreement, as well as any interest and penalties, other than interest and penalties attributable to any delay caused by Connecting Transmission Owner.

Connecting Transmission Owner shall not include a gross-up for the cost consequences of any current tax liability in the amounts it charges ~~Interconnection-Customer~~Developer under this Agreement unless (i) Connecting Transmission Owner has determined, in good faith, that the payments or property transfers made by ~~Interconnection-Customer~~Developer to Connecting Transmission Owner should be reported as income subject to taxation or (ii) any Governmental Authority directs Connecting Transmission Owner to report payments or property as income subject to taxation; provided, however, that Connecting Transmission Owner may require ~~Interconnection-Customer~~Developer to provide security, in a form reasonably acceptable to Connecting Transmission Owner (such as a parental guarantee or a letter of credit), in an amount equal to the cost consequences of any current tax liability under this Article 5.17. ~~Interconnection-Customer~~Developer shall reimburse Connecting Transmission Owner for such costs on a fully grossed-up basis, in accordance with Article 5.17.4, within thirty (30) Calendar Days of receiving written notification from Connecting Transmission Owner of the amount due, including detail about how the amount was calculated.

This indemnification obligation shall terminate at the earlier of (1) the expiration of the ten-year testing period and the applicable statute of limitation, as it may be extended by the Connecting Transmission Owner upon request of the IRS, to keep these years open for audit or adjustment, or (2) the occurrence of a subsequent taxable event and the payment of any related indemnification obligations as contemplated by this Article 5.17.

#### **5.17.4 Tax Gross-Up Amount.**

~~Interconnection-Customer~~Developer’s liability for the cost consequences of any current tax liability under this Article 5.17 shall be calculated on a fully grossed-up basis. Except as may otherwise be agreed to by the parties, this means that ~~Interconnection-Customer~~Developer

will pay Connecting Transmission Owner, in addition to the amount paid for the Attachment Facilities and System Upgrade Facilities and System Deliverability Upgrades, an amount equal to (1) the current taxes imposed on Connecting Transmission Owner (“Current Taxes”) on the excess of (a) the gross income realized by Connecting Transmission Owner as a result of payments or property transfers made by ~~Interconnection-Customer~~Developer to Connecting Transmission Owner under this Agreement (without regard to any payments under this Article 5.17) (the “Gross Income Amount”) over (b) the present value of future tax deductions for depreciation that will be available as a result of such payments or property transfers (the “Present Value Depreciation Amount”), plus (2) an additional amount sufficient to permit the Connecting Transmission Owner to receive and retain, after the payment of all Current Taxes, an amount equal to the net amount described in clause (1).

For this purpose, (i) Current Taxes shall be computed based on Connecting Transmission Owner’s composite federal and state tax rates at the time the payments or property transfers are received and Connecting Transmission Owner will be treated as being subject to tax at the highest marginal rates in effect at that time (the “Current Tax Rate”), and (ii) the Present Value Depreciation Amount shall be computed by discounting Connecting Transmission Owner’s anticipated tax depreciation deductions as a result of such payments or property transfers by Connecting Transmission Owner’s current weighted average cost of capital. Thus, the formula for calculating ~~Interconnection-Customer~~Developer’s liability to Connecting Transmission Owner pursuant to this Article 5.17.4 can be expressed as follows:  $(\text{Current Tax Rate} \times (\text{Gross Income Amount} - \text{Present Value Depreciation Amount})) / (1 - \text{Current Tax Rate})$ . ~~Interconnection-Customer~~Developer’s estimated tax liability in the event taxes are imposed shall be stated in Appendix A, Attachment Facilities and System Upgrade Facilities and System Deliverability Upgrades.

#### **5.17.5 Private Letter Ruling or Change or Clarification of Law.**

At ~~Interconnection-Customer~~Developer’s request and expense, Connecting Transmission Owner shall file with the IRS a request for a private letter ruling as to whether any property transferred or sums paid, or to be paid, by ~~Interconnection-Customer~~Developer to Connecting Transmission Owner under this Agreement are subject to federal income taxation. ~~Interconnection-Customer~~Developer will prepare the initial draft of the request for a private letter ruling, and will certify under penalties of perjury that all facts represented in such request are true and accurate to the best of ~~Interconnection-Customer~~Developer’s knowledge. Connecting Transmission Owner and ~~Interconnection-Customer~~Developer shall cooperate in good faith with respect to the submission of such request.

Connecting Transmission Owner shall keep ~~Interconnection-Customer~~Developer fully informed of the status of such request for a private letter ruling and shall execute either a privacy act waiver or a limited power of attorney, in a form acceptable to the IRS, that authorizes ~~Interconnection-Customer~~Developer to participate in all discussions with the IRS regarding such request for a private letter ruling. Connecting Transmission Owner shall allow ~~Interconnection-Customer~~Developer to attend all meetings with IRS officials about the request and shall permit ~~Interconnection-Customer~~Developer to prepare the initial drafts of any follow-up letters in connection with the request.

#### **5.17.6 Subsequent Taxable Events.**

If, within 10 years from the date on which the relevant Connecting Transmission Owner Attachment Facilities are placed in service, (i) ~~Interconnection Customer~~Developer Breaches the covenants contained in Article 5.17.2, (ii) a “disqualification event” occurs within the meaning of IRS Notice 88-129, or (iii) this Agreement terminates and Connecting Transmission Owner retains ownership of the Attachment Facilities and System Upgrade Facilities and System Deliverability Upgrades, ~~Interconnection Customer~~the Developer shall pay a tax gross-up for the cost consequences of any current tax liability imposed on Connecting Transmission Owner, calculated using the methodology described in Article 5.17.4 and in accordance with IRS Notice 90-60.

#### **5.17.7 Contests.**

In the event any Governmental Authority determines that Connecting Transmission Owner’s receipt of payments or property constitutes income that is subject to taxation, Connecting Transmission Owner shall notify ~~Interconnection Customer~~Developer, in writing, within thirty (30) Calendar Days of receiving notification of such determination by a Governmental Authority. Upon the timely written request by ~~Interconnection Customer~~Developer and at ~~Interconnection Customer~~Developer’s sole expense, Connecting Transmission Owner may appeal, protest, seek abatement of, or otherwise oppose such determination. Upon ~~Interconnection Customer~~Developer’s written request and sole expense, Connecting Transmission Owner may file a claim for refund with respect to any taxes paid under this Article 5.17, whether or not it has received such a determination. Connecting Transmission Owner reserves the right to make all decisions with regard to the prosecution of such appeal, protest, abatement or other contest, including the selection of counsel and compromise or settlement of the claim, but Connecting Transmission Owner shall keep ~~Interconnection Customer~~Developer informed, shall consider in good faith suggestions from ~~Interconnection Customer~~Developer about the conduct of the contest, and shall reasonably permit ~~Interconnection Customer~~Developer or an ~~Interconnection Customer~~Developer representative to attend contest proceedings.

~~Interconnection Customer~~Developer shall pay to Connecting Transmission Owner on a periodic basis, as invoiced by Connecting Transmission Owner, Connecting Transmission Owner’s documented reasonable costs of prosecuting such appeal, protest, abatement or other contest, including any costs associated with obtaining the opinion of independent tax counsel described in this Article 5.17.7. The Connecting Transmission Owner may abandon any contest if ~~Interconnection Customer~~the Developer fails to provide payment to the Connecting Transmission Owner within thirty (30) Calendar Days of receiving such invoice. At any time during the contest, Connecting Transmission Owner may agree to a settlement either with ~~Interconnection Customer~~Developer’s consent or after obtaining written advice from nationally-recognized tax counsel, selected by Connecting Transmission Owner, but reasonably acceptable to ~~Interconnection Customer~~Developer, that the proposed settlement represents a reasonable settlement given the hazards of litigation. ~~Interconnection Customer~~Developer’s obligation shall be based on the amount of the settlement agreed to by ~~Interconnection Customer~~Developer, or if a higher amount, so much of the settlement that is supported by the written advice from nationally-recognized tax counsel selected under the terms of the preceding sentence. The

settlement amount shall be calculated on a fully grossed-up basis to cover any related cost consequences of the current tax liability. The Connecting Transmission Owner may also settle any tax controversy without receiving ~~Interconnection-Customer~~the Developer's consent or any such written advice; however, any such settlement will relieve ~~Interconnection-Customer~~the Developer from any obligation to indemnify Connecting Transmission Owner for the tax at issue in the contest (unless the failure to obtain written advice is attributable to ~~Interconnection-Customer~~the Developer's unreasonable refusal to the appointment of independent tax counsel).

#### **5.17.8 Refund.**

In the event that (a) a private letter ruling is issued to Connecting Transmission Owner which holds that any amount paid or the value of any property transferred by ~~Interconnection-Customer~~Developer to Connecting Transmission Owner under the terms of this Agreement is not subject to federal income taxation, (b) any legislative change or administrative announcement, notice, ruling or other determination makes it reasonably clear to Connecting Transmission Owner in good faith that any amount paid or the value of any property transferred by ~~Interconnection-Customer~~Developer to Connecting Transmission Owner under the terms of this Agreement is not taxable to Connecting Transmission Owner, (c) any abatement, appeal, protest, or other contest results in a determination that any payments or transfers made by ~~Interconnection-Customer~~Developer to Connecting Transmission Owner are not subject to federal income tax, or (d) if Connecting Transmission Owner receives a refund from any taxing authority for any overpayment of tax attributable to any payment or property transfer made by ~~Interconnection-Customer~~Developer to Connecting Transmission Owner pursuant to this Agreement, Connecting Transmission Owner shall promptly refund to ~~Interconnection-Customer~~Developer the following:

- (i) Any payment made by ~~Interconnection-Customer~~Developer under this Article 5.17 for taxes that is attributable to the amount determined to be non-taxable, together with interest thereon,
- (ii) Interest on any amounts paid by ~~Interconnection-Customer~~Developer to Connecting Transmission Owner for such taxes which Connecting Transmission Owner did not submit to the taxing authority, calculated in accordance with the methodology set forth in FERC's regulations at 18 C.F.R. §35.19a(a)(2)(iii) from the date payment was made by ~~Interconnection-Customer~~Developer to the date Connecting Transmission Owner refunds such payment to ~~Interconnection-Customer~~Developer, and
- (iii) With respect to any such taxes paid by Connecting Transmission Owner, any refund or credit Connecting Transmission Owner receives or to which it may be entitled from any Governmental Authority, interest (or that portion thereof attributable to the payment described in clause (i), above) owed to the Connecting Transmission Owner for such overpayment of taxes (including any reduction in interest otherwise payable by Connecting Transmission Owner to any Governmental Authority resulting from an offset or credit); provided, however, that Connecting Transmission Owner will remit such amount promptly to ~~Interconnection-Customer~~Developer only after and to the extent that Connecting Transmission Owner has received a tax refund, credit or offset from any Governmental Authority for any

applicable overpayment of income tax related to the Connecting Transmission Owner's Attachment Facilities.

The intent of this provision is to leave both ~~Interconnection Customer~~ the Developer and Connecting Transmission Owner, to the extent practicable, in the event that no taxes are due with respect to any payment for Attachment Facilities and System Upgrade Facilities and System Deliverability Upgrades hereunder, in the same position they would have been in had no such tax payments been made.

#### **5.17.9 Taxes Other Than Income Taxes.**

Upon the timely request by ~~Interconnection Customer~~ Developer, and at ~~Interconnection Customer~~ Developer's sole expense, Connecting Transmission Owner shall appeal, protest, seek abatement of, or otherwise contest any tax (other than federal or state income tax) asserted or assessed against Connecting Transmission Owner for which ~~Interconnection Customer~~ Developer may be required to reimburse Connecting Transmission Owner under the terms of this Agreement. ~~Interconnection Customer~~ Developer shall pay to Connecting Transmission Owner on a periodic basis, as invoiced by Connecting Transmission Owner, Connecting Transmission Owner's documented reasonable costs of prosecuting such appeal, protest, abatement, or other contest. ~~Interconnection Customer~~ Developer and Connecting Transmission Owner shall cooperate in good faith with respect to any such contest. Unless the payment of such taxes is a prerequisite to an appeal or abatement or cannot be deferred, no amount shall be payable by ~~Interconnection Customer~~ Developer to Connecting Transmission Owner for such taxes until they are assessed by a final, non-appealable order by any court or agency of competent jurisdiction. In the event that a tax payment is withheld and ultimately due and payable after appeal, ~~Interconnection Customer~~ Developer will be responsible for all taxes, interest and penalties, other than penalties attributable to any delay caused by Connecting Transmission Owner.

#### **5.18 Tax Status; Non-Jurisdictional Entities.**

##### **5.18.1 Tax Status.**

Each Party shall cooperate with the other Parties to maintain the other ~~Parties~~ Party's tax status. Nothing in this Agreement is intended to adversely affect the tax status of ~~any~~ either Party ~~including the status of NYISO~~, or the status of any Connecting Transmission Owner with respect to the issuance of bonds including, but not limited to, Local Furnishing Bonds. Notwithstanding any other provisions of this Agreement, LIPA, NYPA and Consolidated Edison Company of New York, Inc. shall not be required to comply with any provisions of this Agreement that would result in the loss of tax-exempt status of any of their Tax-Exempt Bonds or impair their ability to issue future tax-exempt obligations. For purposes of this provision, Tax-Exempt Bonds shall include the obligations of the Long Island Power Authority, NYPA and Consolidated Edison Company of New York, Inc., the interest on which is not included in gross income under the Internal Revenue Code.

### 5.18.2 Non-Jurisdictional Entities.

LIPA and NYPA do not waive their exemptions, pursuant to Section 201(f) of the FPA, from Commission jurisdiction with respect to the Commission's exercise of the FPA's general ratemaking authority.

## 5.19 Modification.

### 5.19.1 General.

Either ~~Interconnection Customer~~the Developer or Connecting Transmission Owner may undertake modifications to its facilities covered by this Agreement; ~~provided, however, that if Interconnection Customer seeks to undertake any modifications for the Facility, Interconnection Customer must comply with the modification requirements for Facilities, including for extensions of the Commercial Operation Date, set forth in the ISO OATT and ISO Procedures.~~ If either ~~Interconnection Customer~~the Developer or Connecting Transmission Owner plans to undertake a modification that reasonably may be expected to affect the other Party's facilities, that Party shall provide to the other Party, and to NYISO, sufficient information regarding such modification so that the other Party and NYISO may evaluate the potential impact of such modification prior to commencement of the work. Such information shall be deemed to be Confidential Information hereunder and shall include information concerning the timing of such modifications and whether such modifications are expected to interrupt the flow of electricity from ~~the~~a Generating Facility. The Party desiring to perform such work shall provide the relevant drawings, plans, and specifications to the other Party and NYISO at least ninety (90) Calendar Days in advance of the commencement of the work or such shorter period upon which the Parties may agree, which agreement shall not unreasonably be withheld, conditioned or delayed.

In the case of Generating Facility modifications that do not require ~~Interconnection Customer~~Developer to submit an Interconnection Request, ~~the NYISO~~Connecting Transmission Owner shall provide, within sixty (60) Calendar Days (or such other time as the Parties may agree), an estimate of any additional modifications to the New York State Transmission System, Connecting Transmission Owner's Attachment Facilities or System Upgrade Facilities or System Deliverability Upgrades necessitated by such ~~Interconnection Customer~~Developer modification and a good faith estimate of the costs thereof. The ~~Interconnection Customer~~Developer shall be responsible for the cost of any such additional modifications, including the cost of studying the impact of the ~~Interconnection Customer~~Developer modification.

### 5.19.2 Standards.

Any additions, modifications, or replacements made to a Party's facilities shall be designed, constructed and operated in accordance with this Agreement, NYISO requirements and Good Utility Practice.

### 5.19.3 Modification Costs.

~~Interconnection-Customer~~Developer shall not be assigned the costs of any additions, modifications, or replacements that Connecting Transmission Owner makes to the Connecting Transmission Owner's Attachment Facilities or the New York State Transmission System to facilitate the interconnection of a third party to the Connecting Transmission Owner's Attachment Facilities or the New York State Transmission System, or to provide Transmission Service to a third party under the ISO OATT, except in accordance with the cost allocation procedures in Attachment ~~HHS~~ of the ISO OATT. ~~Interconnection-Customer~~Developer shall be responsible for the costs of any additions, modifications, or replacements to the ~~Interconnection-Customer~~Developer's Attachment Facilities that may be necessary to maintain or upgrade such ~~Interconnection-Customer~~Developer's Attachment Facilities consistent with Applicable Laws and Regulations, Applicable Reliability Standards or Good Utility Practice.

## ARTICLE 6. TESTING AND INSPECTION

### 6.1 Pre-Commercial Operation Date Testing and Modifications.

Prior to the Commercial Operation Date, the Connecting Transmission Owner shall test the Connecting Transmission Owner's Attachment Facilities (including required control technologies and protection systems); and System Upgrade Facilities; and System Deliverability Upgrades and ~~Interconnection-Customer~~Developer shall test ~~the~~each Generating Facility and the ~~Interconnection-Customer~~Developer's Attachment Facilities to ensure their safe and reliable operation. Similar testing may be required after initial operation. ~~Interconnection-Customer~~Developer and Connecting Transmission Owner shall each make any modifications to its facilities that are found to be necessary as a result of such testing. ~~Interconnection-Customer~~Developer shall bear the cost of all such testing and modifications. ~~Interconnection-Customer~~Developer shall, ~~as applicable,~~ generate test energy at ~~or transit test energy over the~~ a Generating Facility only if it has arranged for the injection of such test energy in accordance with ~~ISO Procedures~~NYISO procedures.

### 6.2 Post-Commercial Operation Date Testing and Modifications.

~~Interconnection-Customer~~Developer and Connecting Transmission Owner shall each at its own expense perform routine inspection and testing of its facilities and equipment in accordance with Good Utility Practice and Applicable Reliability Standards as may be necessary to ensure the continued interconnection of ~~the~~each Generating Facility with the New York State Transmission System in a safe and reliable manner. ~~Interconnection-Customer~~Developer and Connecting Transmission Owner shall each have the right, upon advance written notice, to require reasonable additional testing of the other Party's facilities, at the requesting Party's expense, as may be in accordance with Good Utility Practice.

### 6.3 Right to Observe Testing.

~~Interconnection-Customer~~Developer and Connecting Transmission Owner shall each notify the other Party, and the NYISO, in advance of its performance of tests of its Attachment

Facilities. The other Party, and the NYISO, shall each have the right, at its own expense, to observe such testing.

#### **6.4 Right to Inspect.**

~~Interconnection-Customer~~Developer and Connecting Transmission Owner shall each have the right, but shall have no obligation to: (i) observe the other Party's tests and/or inspection of any of its System Protection Facilities and other protective equipment, including Power System Stabilizers; (ii) review the settings of the other Party's System Protection Facilities and other protective equipment; and (iii) review the other Party's maintenance records relative to the Attachment Facilities, the System Protection Facilities and other protective equipment. NYISO shall have these same rights of inspection as to the facilities and equipment of ~~Interconnection-Customer~~Developer and Connecting Transmission Owner. A Party may exercise these rights from time to time as it deems necessary upon reasonable notice to the other Party. The exercise or non-exercise by a Party of any such rights shall not be construed as an endorsement or confirmation of any element or condition of the Attachment Facilities or the System Protection Facilities or other protective equipment or the operation thereof, or as a warranty as to the fitness, safety, desirability, or reliability of same. Any information that a Party obtains through the exercise of any of its rights under this Article 6.4 shall be treated in accordance with Article 22 of this Agreement and Attachment F to the ISO OATT.

### **ARTICLE 7. METERING**

#### **7.1 General.**

~~Interconnection-Customer~~Developer and Connecting Transmission Owner shall each comply with applicable requirements of NYISO and the New York Public Service Commission when exercising its rights and fulfilling its responsibilities under this Article 7. Unless otherwise agreed by the Connecting Transmission Owner and NYISO approved meter service provider and ~~Interconnection-Customer~~Developer, the Connecting Transmission Owner shall install Metering Equipment at the Point of Interconnection prior to any operation of ~~the~~either Generating Facility and shall own, operate, test and maintain such Metering Equipment. Net power flows including MW and MVAR, MWHR and loss profile data to and from ~~the~~a Large Generating Facility shall be measured at the Point of Interconnection. Connecting Transmission Owner shall provide metering quantities, in analog and/or digital form, as required, to ~~Interconnection-Customer~~Developer or NYISO upon request. Where the Point of Interconnection for ~~the~~a Generating Facility is other than the generator terminal, the ~~Interconnection-Customer~~Developer shall also provide gross MW and MVAR quantities at the generator terminal ~~as required by NYISO. If the Facility is a Class Year Transmission Project or a Cluster Study Transmission Project, Appendix C to this Agreement shall include any project-specific variations from the metering requirements established in this Article 7 that are appropriate for the transmission facility.~~ Developer shall bear all reasonable documented costs associated with the purchase, installation, operation, testing and maintenance of the Metering Equipment.

## 7.2 Check Meters.

~~Interconnection-Customer~~[Developer](#), at its option and expense, may install and operate, on its premises and on its side of the Point of Interconnection, one or more check meters to check Connecting Transmission Owner's meters. Such check meters shall be for check purposes only and shall not be used for the measurement of power flows for purposes of this Agreement, except as provided in Article 7.4 below. The check meters shall be subject at all reasonable times to inspection and examination by Connecting Transmission Owner or its designee. The installation, operation and maintenance thereof shall be performed entirely by ~~Interconnection-Customer~~[Developer](#) in accordance with Good Utility Practice.

## 7.3 Standards.

Connecting Transmission Owner shall install, calibrate, and test revenue quality Metering Equipment including potential transformers and current transformers in accordance with applicable ANSI and PSC standards as detailed in the NYISO Control Center Communications Manual and in the NYISO Revenue Metering Requirements Manual.

## 7.4 Testing of Metering Equipment.

Connecting Transmission Owner shall inspect and test all of its Metering Equipment upon installation and at least once every two (2) years thereafter. If requested to do so by NYISO or ~~Interconnection-Customer~~[Developer](#), Connecting Transmission Owner shall, at ~~Interconnection-Customer~~[Developer](#)'s expense, inspect or test Metering Equipment more frequently than every two (2) years. Connecting Transmission Owner shall give reasonable notice of the time when any inspection or test shall take place, and ~~Interconnection-Customer~~[Developer](#) and NYISO may have representatives present at the test or inspection. If at any time Metering Equipment is found to be inaccurate or defective, it shall be adjusted, repaired or replaced at ~~Interconnection-Customer~~[Developer](#)'s expense, in order to provide accurate metering, unless the inaccuracy or defect is due to Connecting Transmission Owner's failure to maintain, then Connecting Transmission Owner shall pay. If Metering Equipment fails to register, or if the measurement made by Metering Equipment during a test varies by more than two percent from the measurement made by the standard meter used in the test, Connecting Transmission Owner shall adjust the measurements by correcting all measurements for the period during which Metering Equipment was in error by using ~~Interconnection-Customer~~[Developer](#)'s check meters, if installed. If no such check meters are installed or if the period cannot be reasonably ascertained, the adjustment shall be for the period immediately preceding the test of the Metering Equipment equal to one-half the time from the date of the last previous test of the Metering Equipment. The NYISO shall reserve the right to review all associated metering equipment installation on ~~Interconnection-Customer~~[the Developer](#)'s or Connecting Transmission Owner's property at any time.

## 7.5 Metering Data.

At ~~Interconnection-Customer~~[Developer](#)'s expense, the metered data shall be telemetered to one or more locations designated by Connecting Transmission Owner, ~~Interconnection-Customer~~[Developer](#) and NYISO. Such telemetered data shall be used, under normal operating

conditions, as the official measurement of the amount of energy delivered from ~~the~~each Generating Facility to the Point of Interconnection.

## ARTICLE 8. COMMUNICATIONS

### 8.1 ~~Interconnection-Customer~~Developer Obligations.

In accordance with applicable NYISO requirements, ~~Interconnection-Customer~~Developer shall maintain satisfactory operating communications with Connecting Transmission Owner and NYISO. ~~Interconnection-Customer~~Developer shall provide standard voice line ~~and~~, dedicated voice line and facsimile communications at ~~its~~ a Generating Facility's control room or central dispatch facility through use of either the public telephone system, or a voice communications system that does not rely on the public telephone system. ~~Interconnection-Customer~~Developer shall also provide the dedicated data circuit(s) necessary to provide ~~Interconnection-Customer~~Developer data to Connecting Transmission Owner and NYISO as set forth in Appendix D hereto. The data circuit(s) shall extend from the Generating Facility to the location(s) specified by Connecting Transmission Owner and NYISO. Any required maintenance of such communications equipment shall be performed by ~~Interconnection-Customer~~Developer. Operational communications shall be activated and maintained under, but not be limited to, the following events: system paralleling or separation, scheduled and unscheduled shutdowns, equipment clearances, and hourly and daily load data.

### 8.2 Remote Terminal Unit.

Prior to the Initial Synchronization Date of ~~the~~ a Generating Facility, a Remote Terminal Unit, or equivalent data collection and transfer equipment acceptable to the Parties, shall be installed by ~~Interconnection-Customer~~Developer, or by Connecting Transmission Owner at ~~Interconnection-Customer~~Developer's expense, to gather accumulated and instantaneous data to be telemetered to the location(s) designated by Connecting Transmission Owner and NYISO through use of a dedicated point-to-point data circuit(s) as indicated in Article 8.1. The communication protocol for the data circuit(s) shall be specified by Connecting Transmission Owner and NYISO. Instantaneous bi-directional analog real power and reactive power flow information must be telemetered directly to the location(s) specified by Connecting Transmission Owner and NYISO.

Each Party will promptly advise the ~~appropriate~~ other Party if it detects or otherwise learns of any metering, telemetry or communications equipment errors or malfunctions that require the attention and/or correction by ~~that~~the other Party. The Party owning such equipment shall correct such error or malfunction as soon as reasonably feasible.

### 8.3 No Annexation.

Any and all equipment placed on the premises of a Party shall be and remain the property of the Party providing such equipment regardless of the mode and manner of annexation or attachment to real property, unless otherwise mutually agreed by the Party providing such equipment and the Party receiving such equipment.

## ARTICLE 9. OPERATIONS

### 9.1 General.

Each Party shall comply with Applicable Laws and Regulations and Applicable Reliability Standards. Each Party shall provide to the other ~~Parties~~Party and the NYISO all information that may reasonably be required by the other ~~Parties~~Party and the NYISO to comply with Applicable Laws and Regulations, and Applicable Reliability Standards. ~~—If the Facility is a Class Year Transmission Project or a Cluster Study Transmission Project, Appendix C to this Agreement shall include any project-specific variations from the operating requirements established in this Article 9 that are appropriate for the transmission facility.~~

### 9.2 NYISO and Connecting Transmission Owner Obligations.

Connecting Transmission Owner and NYISO shall cause the New York State Transmission System and the Connecting Transmission Owner's Attachment Facilities to be operated, maintained and controlled in a safe and reliable manner in accordance with this Agreement and the NYISO Tariffs. Connecting Transmission Owner and NYISO may provide operating instructions to ~~Interconnection Customer~~Developer consistent with this Agreement, ~~the NYISO Tariffs, ISO Procedures,~~procedures and Connecting Transmission Owner's operating protocols and procedures, as ~~such requirements~~they may change from time to time. Connecting Transmission Owner and NYISO will consider changes to their respective operating protocols and procedures proposed by ~~Interconnection Customer~~Developer.

### 9.3 ~~Interconnection Customer~~Developer Obligations.

~~Interconnection Customer~~Developer shall at its own expense operate, maintain, and control ~~the—each Generating~~ Facility and the ~~Interconnection Customer~~Developer's Attachment Facilities in a safe and reliable manner and in accordance with this Agreement. ~~Interconnection Customer~~Developer shall operate ~~the—each Generating~~ Facility and the ~~Interconnection Customer~~Developer's Attachment Facilities in accordance with ~~any additional~~ NYISO and Connecting Transmission Owner requirements, as such requirements are set forth or referenced in Appendix C hereto. Appendix C will be modified to reflect changes to the requirements as they may change from time to time. ~~Any~~Either Party may request that the ~~appropriate~~ other Party ~~or Parties~~ provide copies of the requirements set forth or referenced in Appendix C hereto.

### 9.4 Start-Up and Synchronization.

Consistent with the mutually acceptable procedures of ~~Interconnection Customer~~the Developer and Connecting Transmission Owner, ~~Interconnection Customer~~the Developer is responsible for the proper synchronization of ~~the~~each Generating Facility to the New York State Transmission System in accordance with NYISO and Connecting Transmission Owner procedures and requirements.

## 9.5 Real and Reactive Power Control ~~and Primary Frequency Response.~~

### 9.5.1 Power Factor Design Criteria and Primary Frequency Response.

**9.5.1.1 Synchronous Generation.** ~~Interconnection Customer~~Developer shall design ~~the~~each Generating Facility to maintain effective composite power delivery at continuous rated power output at the Point of Interconnection at a power factor within the range of 0.95 leading to 0.95 lagging unless the NYISO or the Transmission Owner in whose Transmission District the Generating Facility interconnects has established different requirements that apply to all generators in the New York Control Area or Transmission District (as applicable) on a comparable basis, in accordance with Good Utility Practice.

~~Interconnection Customer~~The Developer shall design and maintain the plant auxiliary systems to operate safely throughout the entire real and reactive power design range.

**9.5.1.2 Non-Synchronous Generation.** ~~Interconnection Customer~~Developer shall design ~~the~~each Generating Facility to maintain composite power delivery at continuous rated power output at the high-side of the generator substation at a power factor within the range of 0.95 leading to 0.95 lagging, unless the NYISO or the Transmission Owner in whose Transmission District the Generating Facility interconnects has established a different power factor range that applies to all non-synchronous generators in the ~~New York~~ Control Area or Transmission District (as applicable) on a comparable basis, in accordance with Good Utility Practice. This power factor range standard shall be dynamic and can be met using, for example, power electronics designed to supply this level of reactive capability (taking into account any limitations due to voltage level, real power output, etc.) or fixed and switched capacitors, or a combination of the two. This requirement shall only apply to newly interconnection non-synchronous generators that have not yet executed a ~~Class Year Study Agreement or a~~ Cluster Facilities Study Agreement as of September 21, 2016.

~~Interconnection Customer~~The Developer shall design and maintain the plant auxiliary systems to operate safely throughout the entire real and reactive power design range.

### 9.5.2 Voltage Schedules.

Once ~~Interconnection Customer~~the Developer has synchronized ~~the~~a Generating Facility with the New York State Transmission System, ~~NYISO shall require Interconnection Customer Developer is required~~ to operate the Generating Facility to produce or absorb reactive power within the design capability of the Generating Facility set forth in Article 9.5.1 (Power Factor Design Criteria). The Parties understand that the NYISO's voltage schedules shall treat all sources of reactive power in the New York Control Area in an equitable and not unduly discriminatory manner. The Parties understand that the NYISO shall exercise Reasonable Efforts to provide ~~Interconnection Customer Developer~~ with such schedules in accordance with ~~ISO Procedures~~NYISO procedures, and may make changes to such schedules as necessary to maintain the reliability of the New York State Transmission System. ~~Interconnection Customer Developer~~ shall operate the Generating Facility to maintain the specified output voltage

or power factor at the Point of Interconnection within the design capability of the Generating Facility set forth in Article 9.5.1 (Power Factor Design Criteria) as directed by the Connecting Transmission Owner's system operator or the NYISO. If ~~Interconnection Customer~~Developer is unable to maintain the specified voltage or power factor, it shall promptly notify NYISO.

### **9.5.3 Payment for Reactive Power.**

~~NYISO shall pay Interconnection Customer~~The Parties understand that Developer shall be paid by the NYISO for reactive power or voltage support service that ~~Interconnection Customer~~Developer provides from ~~the~~a Generating Facility in accordance with the provisions of Rate Schedule 2 of the ~~ISO~~NYISO Services Tariff.

### **9.5.4 Voltage Regulators.**

Whenever ~~the~~a Generating Facility is operated in parallel with the New York State Transmission System, the automatic voltage regulators shall be in automatic operation at all times. If the Generating Facility's automatic voltage regulators are not capable of such automatic operation, ~~Interconnection Customer~~the Developer shall immediately notify NYISO, or its designated representative, and ensure that such Generating Facility's real and reactive power are within the design capability of the Generating Facility's generating unit(s) and steady state stability limits and NYISO system operating (thermal, voltage and transient stability) limits. ~~Interconnection Customer~~Developer shall not cause ~~its~~a Generating Facility to disconnect automatically or instantaneously from the New York State Transmission System or trip any generating unit comprising the Generating Facility for an under or over frequency condition unless the abnormal frequency condition persists for a time period beyond the limits set forth in ANSI/IEEE Standard C37.106, or such other standard as applied to other generators in the New York Control Area on a comparable basis.

### **9.5.5 Primary Frequency Response.**

~~Interconnection Customer~~Developer shall ensure the primary frequency response capability of ~~its~~each Generating Facility by installing, maintaining, and operating a functioning governor or equivalent controls. The term "functioning governor or equivalent controls" as used herein shall mean the required hardware and/or software that provides frequency responsive real power control with the ability to sense changes in system frequency and autonomously adjust the Generating Facility's real power output in accordance with the droop and deadband parameters and in the direction needed to correct frequency deviations. ~~Interconnection Customer~~Developer is required to install a governor or equivalent controls with the capability of operating: (1) with a maximum 5 percent droop  $\pm$  0.036 Hz deadband; or (2) in accordance with the relevant droop, deadband, and timely and sustained response settings from an approved Applicable Reliability Standard providing for equivalent or more stringent parameters. The droop characteristic shall be: (1) based on the nameplate capacity of the Generating Facility, and shall be linear in the range of frequencies between 59 and 61 Hz that are outside of the deadband parameter; or (2) based on an approved Applicable Reliability Standard providing for an equivalent or more stringent parameter. The deadband parameter shall be: the range of frequencies above and below nominal (60 Hz) in which the governor or equivalent controls is not expected to adjust the Generating Facility's real power output in response to frequency

deviations. The deadband shall be implemented: (1) without a step to the droop curve, that is, once the frequency deviation exceeds the deadband parameter, the expected change in the Generating Facility's real power output in response to frequency deviations shall start from zero and then increase (for under-frequency deviations) or decrease (for over-frequency deviations) linearly in proportion to the magnitude of the frequency deviation; or (2) in accordance with an approved Applicable Reliability Standard providing for an equivalent or more stringent parameter. ~~Interconnection-Customer~~Developer shall notify NYISO that the primary frequency response capability of the Generating Facility has been tested and confirmed during commissioning. Once ~~Interconnection-Customer~~Developer has synchronized the Generating Facility with the New York State Transmission System, ~~Interconnection-Customer~~Developer shall operate the Generating Facility consistent with the provisions specified in Articles 9.5.5.1 and 9.5.5.2 of this Agreement. The primary frequency response requirements contained herein shall apply to both synchronous and non-synchronous Generating Facilities.

#### **9.5.5.1 Governor or Equivalent Controls.**

Whenever ~~the~~ Generating Facility is operated in parallel with the New York State Transmission System, ~~Interconnection-Customer~~Developer shall operate the Generating Facility with its governor or equivalent controls in service and responsive to frequency. ~~Interconnection-Customer~~Developer shall: (1) in coordination with NYISO, set the deadband parameter to: (1) a maximum of  $\pm 0.036$  Hz and set the droop parameter to a maximum of 5 percent; or (2) implement the relevant droop and deadband settings from an approved Applicable Reliability Standard that provides for equivalent or more stringent parameters. ~~Interconnection-Customer~~Developer shall be required to provide the status and settings of the governor and equivalent controls to NYISO and/or the Connecting Transmission Owner upon request. If ~~Interconnection-Customer~~Developer needs to operate the Generating Facility with its governor or equivalent controls not in service, ~~Interconnection-Customer~~Developer shall immediately notify NYISO and the Connecting Transmission Owner, and provide both with the following information: (1) the operating status of the governor or equivalent controls (i.e., whether it is currently out of service or when it will be taken out of service); (2) the reasons for removing the governor or equivalent controls from service; and (3) a reasonable estimate of when the governor or equivalent controls will be returned to service. ~~Interconnection-Customer~~Developer shall make Reasonable Efforts to return its governor or equivalent controls into service as soon as practicable. ~~Interconnection-Customer~~Developer shall make Reasonable Efforts to keep outages of the Generating Facility's governor or equivalent controls to a minimum whenever the Generating Facility is operated in parallel with the New York State Transmission System.

#### **9.5.5.2 Timely and Sustained Response.**

~~Interconnection-Customer~~Developer shall ensure that ~~the~~ each Generating Facility's real power response to sustained frequency deviations outside of the deadband setting is automatically provided and shall begin immediately after frequency deviates outside of the deadband, and to the extent the Generating Facility has operating capability in the direction needed to correct the frequency deviation. ~~Interconnection-Customer~~Developer shall not block or otherwise inhibit the ability of the governor or equivalent controls to respond and shall ensure that the response is not inhibited, except under certain operational constraints including, but not limited to, ambient temperature limitations, physical energy limitations, outages of mechanical

equipment, or regulatory requirements. The Generating Facility shall sustain the real power response at least until system frequency returns to a value within the deadband setting of the governor or equivalent controls. An Applicable Reliability Standard with equivalent or more stringent requirements shall supersede the above requirements.

### **9.5.5.3 Exemptions.**

Generating Facilities that are regulated by the United States Nuclear Regulatory Commission shall be exempt from Articles 9.5.5, 9.5.5.1, and 9.5.5.2 of this Agreement. Generating Facilities that are behind the meter generation that is sized-to-load (i.e., the thermal load and the generation are near-balanced in real-time operation and the generation is primarily controlled to maintain the unique thermal, chemical, or mechanical output necessary for the operating requirements of its host facility) shall be required to install primary frequency response capability requirements in accordance with the droop and deadband capability requirements specified in Article 9.5.5, but shall be otherwise exempt from the operating requirements in Articles 9.5.5, 9.5.5.1, 9.5.5.2, and 9.5.5.4 of this Agreement.

### **9.5.5.4 Electric Storage Resources.**

~~Interconnecting Customer~~Developer interconnecting ~~a Facility that contains~~ an electric storage resource shall establish an operating range in Appendix C of ~~this Agreement~~its LGIA that specifies a minimum state of charge and a maximum state of charge between which the electric storage resource will be required to provide primary frequency response consistent with the conditions set forth in Articles 9.5.5, 9.5.5.1, 9.5.5.2, and 9.5.5.3 of this Agreement. Appendix C shall specify whether the operating range is static or dynamic, and shall consider (1) the expected magnitude of frequency deviations in the interconnection; (2) the expected duration that system frequency will remain outside of the deadband parameter in the interconnection; (3) the expected incidence of frequency deviations outside of the deadband parameter in the interconnection; (4) the physical capabilities of the electric storage resource; (5) operational limitations of the electric storage resources due to manufacturer specification; and (6) any other relevant factors agreed to by the NYISO, Connecting Transmission Owner, and ~~Interconnection Customer~~Developer. If the operating range is dynamic, then Appendix C must establish how frequently the operating range will be reevaluated and the factors that may be considered during its reevaluation.

~~Interconnection Customer~~Developer's electric storage resource is required to provide timely and sustained primary frequency response consistent with Article 9.5.5.2 of this Agreement when it is online and dispatched to inject electricity to the New York State Transmission System and/or receive electricity from the New York State Transmission System. This excludes circumstances when the electric storage resource is not dispatched to inject electricity to the New York State Transmission System and/or dispatched to receive electricity from the New York State Transmission System. If ~~Interconnection Customer~~Developer's electric storage resource is charging at the time of a frequency deviation outside of its deadband parameter, it is to increase (for over-frequency deviations) or decrease (for under-frequency deviations) the rate at which it is charging in accordance with its droop parameter. ~~Interconnection Customer~~Developer's electric storage resource is not required to change from

charging to discharging, or vice versa, unless the response necessitated by the droop and deadband settings requires it to do so and it is technically capable of making such a transition.

## **9.6 Outages and Interruptions.**

### **9.6.1 Outages.**

#### **9.6.1.1 Outage Authority and Coordination.**

~~Interconnection Customer~~[Developer](#) and Connecting Transmission Owner may each, in accordance with ~~ISO Procedures~~[NYISO procedures](#) and Good Utility Practice and in coordination with the other Party, remove from service any of its respective Attachment Facilities or System Upgrade Facilities and System Deliverability Upgrades that may impact the other Party's facilities as necessary to perform maintenance or testing or to install or replace equipment. Absent an Emergency State, the Party scheduling a removal of such facility(ies) from service will use Reasonable Efforts to schedule such removal on a date and time mutually acceptable to both the ~~Interconnection Customer~~[Developer](#) and the Connecting Transmission Owner. In all circumstances either Party planning to remove such facility(ies) from service shall use Reasonable Efforts to minimize the effect on the other Party of such removal.

#### **9.6.1.2 Outage Schedules.**

The Connecting Transmission Owner shall post scheduled outages of its transmission facilities on the NYISO OASIS. ~~Interconnection Customer~~[Developer](#) shall submit its planned maintenance schedules for ~~the~~[each](#) [Generating](#) Facility to Connecting Transmission Owner and NYISO for a minimum of a rolling thirty-six month period. ~~Interconnection Customer~~[Developer](#) shall update its planned maintenance schedules as necessary. NYISO may direct, or the Connecting Transmission Owner may request, ~~Interconnection Customer~~[Developer](#) to reschedule its maintenance as necessary to maintain the reliability of the New York State Transmission System. Compensation to ~~Interconnection Customer~~[Developer](#) for any additional direct costs that ~~Interconnection Customer~~[the Developer](#) incurs as a result of rescheduling maintenance, including any additional overtime, breaking of maintenance contracts or other costs above and beyond the cost ~~Interconnection Customer~~[the Developer](#) would have incurred absent the request to reschedule maintenance, shall be in accordance with the ISO OATT. ~~Interconnection Customer~~[Developer](#) will not be eligible to receive compensation, if during the twelve (12) months prior to the date of the scheduled maintenance, ~~Interconnection Customer~~[the Developer](#) had modified its schedule of maintenance activities other than at the direction of the NYISO or request of the Connecting Transmission Owner.

#### **9.6.1.3 Outage Restoration.**

If an outage on the Attachment Facilities or System Upgrade Facilities or System Deliverability Upgrades of the Connecting Transmission Owner or ~~Interconnection Customer~~[Developer](#) adversely affects the other Party's operations or facilities, the Party that owns the facility that is out of service shall use Reasonable Efforts to promptly restore such

facility(ies) to a normal operating condition consistent with the nature of the outage. The Party that owns the facility that is out of service shall provide the other Party and NYISO, to the extent such information is known, information on the nature of the Emergency State, an estimated time of restoration, and any corrective actions required. Initial verbal notice shall be followed up as soon as practicable with written notice explaining the nature of the outage.

**9.6.2 Interruption of Service.** If required by Good Utility Practice or Applicable Reliability Standards to do so, the NYISO or Connecting Transmission Owner may require ~~Interconnection Customer~~Developer to interrupt or reduce production ~~or transmission~~ of electricity if such production ~~or transmission~~ of electricity could adversely affect the ability of NYISO and Connecting Transmission Owner to perform such activities as are necessary to safely and reliably operate and maintain the New York State Transmission System. The following provisions shall apply to any interruption or reduction permitted under this Article 9.6.2:

**9.6.2.1** The interruption or reduction shall continue only for so long as reasonably necessary under Good Utility Practice;

**9.6.2.2** Any such interruption or reduction shall be made on an equitable, non-discriminatory basis with respect to all generating ~~and merchant transmission~~ facilities directly connected to the New York State Transmission System;

**9.6.2.3** When the interruption or reduction must be made under circumstances which do not allow for advance notice, NYISO or Connecting Transmission Owner shall notify ~~Interconnection Customer~~Developer by telephone as soon as practicable of the reasons for the curtailment, interruption, or reduction, and, if known, its expected duration. Telephone notification shall be followed by written notification as soon as practicable;

**9.6.2.4** Except during the existence of an Emergency State, when the interruption or reduction can be scheduled without advance notice, NYISO or Connecting Transmission Owner shall notify ~~Interconnection Customer~~Developer in advance regarding the timing of such scheduling and further notify ~~Interconnection Customer~~Developer of the expected duration. NYISO or Connecting Transmission Owner shall coordinate with each other and ~~Interconnection Customer~~the Developer using Good Utility Practice to schedule the interruption or reduction during periods of least impact to ~~Interconnection Customer~~the Developer, the Connecting Transmission Owner and the New York State Transmission System;

**9.6.2.5** The Parties shall cooperate and coordinate with each other to the extent necessary in order to restore ~~the~~either Large Generating Facility, Attachment Facilities, and the New York State Transmission System to their normal operating state, consistent with system conditions and Good Utility Practice.

### **9.6.3 ~~Ride-Through Capability and Performance~~ Under-Frequency and Over-Frequency Conditions.**

The New York State Transmission System is designed to automatically activate a load-shed program as required by the ~~Applicable Reliability Councils~~ NPCC in the event of an under-frequency system disturbance. ~~Interconnection Customer~~ Developer shall implement under-frequency and over-frequency relay set points for ~~the~~ each Generating Facility as required by the ~~Applicable Reliability Councils~~ NPCC to ensure ~~frequency~~ “ride through” capability of the New York State Transmission System. Generating Facility response to frequency deviations of predetermined magnitudes, both under-frequency and over-frequency deviations, shall be studied and coordinated with the NYISO and Connecting Transmission Owner in accordance with Good Utility Practice. ~~Interconnection Customer shall also implement under-voltage and over-voltage relay set points, or equivalent electronic controls, as required by the Applicable Reliability Councils to ensure voltage “ride through” capability of the New York State Transmission System.~~ The term “ride through” as used herein shall mean the ability of a Generating Facility to stay connected to and synchronized with the New York State Transmission System during system disturbances within a range of under-frequency, and over-frequency, ~~under-voltage, and over-voltage~~ conditions, in accordance with Good Utility Practice and ~~consistent with any standards and guidelines that are applied to other Generating Facilities in the Balancing Authority Area on a comparable basis unless the Transmission Owner in whose Transmission District the Facility interconnects has established different requirements that apply on a comparable basis in accordance with Good Utility Practice.~~ For abnormal frequency conditions and voltage conditions within the “no trip zone” as that term is defined by ERO NPCC Regional Reliability Standard PRC-024-3, any successor mandatory ride-through ERO reliability standards, or any more stringent NPCC or NYSRC requirements applicable to Generating Facilities in the Balancing Authority Area on a comparable basis, the non-synchronous Generating Facility must ensure that, within any physical limitations of the Generating Facility, its control and protection settings are configured or set to (1) continue active power production during disturbance and post-disturbance periods at pre-disturbance levels, unless reactive power priority mode is enabled or unless providing primary frequency response or fast frequency response; (2) minimize reductions in active power and remain within dynamic voltage and current limits, if reactive power priority mode is enabled, unless providing primary frequency response or fast frequency response; (3) not artificially limit dynamic reactive power capability during disturbances; and (4) return to pre-disturbance active power levels without artificial ramp-rate limits if active power is reduced, unless providing primary frequency response or fast frequency response Reference Directory # 12, or its successor.

### **9.6.4 System Protection and Other Control Requirements.**

**9.6.4.1 System Protection Facilities.** ~~Interconnection Customer~~ Developer shall, at its expense, install, operate and maintain System Protection Facilities as a part of ~~the~~ a Generating Facility or ~~Interconnection Customer~~ Developer’s Attachment Facilities. Connecting Transmission Owner shall install at ~~Interconnection Customer~~ Developer’s expense any System Protection Facilities that may be required on the Connecting Transmission Owner’s Attachment Facilities or the New York State Transmission System as a result of the interconnection of the Generating Facility and ~~Interconnection Customer~~ Developer’s Attachment Facilities.

9.6.4.2 The protection facilities of both ~~Interconnection Customer~~the Developer and Connecting Transmission Owner shall be designed and coordinated with other systems in accordance with Good Utility Practice and Applicable Reliability Standards.

9.6.4.3 ~~Interconnection Customer~~The Developer and Connecting Transmission Owner shall each be responsible for protection of its respective facilities consistent with Good Utility Practice and Applicable Reliability Standards.

9.6.4.4 The protective relay design of ~~Interconnection Customer~~the Developer and Connecting Transmission Owner shall each incorporate the necessary test switches to perform the tests required in Article 6 of this Agreement. The required test switches will be placed such that they allow operation of lockout relays while preventing breaker failure schemes from operating and causing unnecessary breaker operations and/or the tripping of ~~Interconnection Customer's~~either Generating Facility ~~or Connecting Transmission Owner's facilities.~~

9.6.4.5 ~~Interconnection Customer~~The Developer and Connecting Transmission Owner will each test, operate and maintain System Protection Facilities in accordance with Good Utility Practice, ~~ER~~NERC and NPCC criteria.

9.6.4.6 Prior to the ~~Initial Backfeed~~Service Date, and again prior to the Commercial Operation Date, ~~Interconnection Customer~~the Developer and Connecting Transmission Owner shall each perform, or their agents shall perform, a complete calibration test and functional trip test of the System Protection Facilities. At intervals suggested by Good Utility Practice and following any apparent malfunction of the System Protection Facilities, ~~Interconnection Customer~~the Developer and Connecting Transmission Owner shall each perform both calibration and functional trip tests of its System Protection Facilities. These tests do not require the tripping of any in-service generation unit. These tests do, however, require that all protective relays and lockout contacts be activated.

## 9.6.5 Requirements for Protection.

In compliance with NPCC requirements and Good Utility Practice, ~~Interconnection Customer~~Developer shall provide, install, own, and maintain relays, circuit breakers and all other devices necessary to remove any fault contribution of ~~the~~a Generating Facility to any short circuit occurring on the New York State Transmission System not otherwise isolated by Connecting Transmission Owner's equipment, such that the removal of the fault contribution shall be coordinated with the protective requirements of the New York State Transmission System. Such protective equipment shall include, without limitation, a disconnecting device or switch with load-interrupting capability located between the Generating Facility and the New York State Transmission System at a site selected upon mutual agreement (not to be unreasonably withheld, conditioned or delayed) of ~~Interconnection Customer~~the Developer and Connecting Transmission Owner. ~~Interconnection Customer~~Developer shall be responsible for protection of the Generating Facility and ~~Interconnection Customer~~Developer's other equipment from such conditions as negative sequence currents, over- or under-frequency, sudden load rejection, over- or under-voltage, and generator loss-of-field. ~~Interconnection Customer~~Developer shall be solely responsible to disconnect the Generating Facility and

~~Interconnection-Customer~~Developer's other equipment if conditions on the New York State Transmission System could adversely affect the Generating Facility.

#### **9.6.6 Power Quality.**

Neither the facilities of ~~Interconnection-Customer~~Developer nor the facilities of Connecting Transmission Owner shall cause excessive voltage flicker nor introduce excessive distortion to the sinusoidal voltage or current waves as defined by ANSI Standard C84.1-1989, in accordance with IEEE Standard 519, or any applicable superseding electric industry standard. In the event of a conflict between ANSI Standard C84.1-1989, or any applicable superseding electric industry standard, ANSI Standard C84.1-1989, or the applicable superseding electric industry standard, shall control.

#### **9.7 Switching and Tagging Rules.**

~~Interconnection-Customer~~The Developer and Connecting Transmission Owner shall each provide the other Party a copy of its switching and tagging rules that are applicable to the other Party's activities. Such switching and tagging rules shall be developed on a nondiscriminatory basis. The Parties shall comply with applicable switching and tagging rules, as amended from time to time, in obtaining clearances for work or for switching operations on equipment.

#### **9.8 Use of Attachment Facilities by Third Parties.**

##### **9.8.1 Purpose of Attachment Facilities.**

Except as may be required by Applicable Laws and Regulations, or as otherwise agreed to ~~among~~between the Parties, the Attachment Facilities shall be constructed for the sole purpose of interconnecting ~~the~~a Generating Facility to the New York State Transmission System and shall be used for no other purpose.

##### **9.8.2 Third Party Users.**

If required by Applicable Laws and Regulations or if the Parties mutually agree, such agreement not to be unreasonably withheld, to allow one or more third parties to use the Connecting Transmission Owner's Attachment Facilities, or any part thereof, ~~Interconnection-Customer~~Developer will be entitled to compensation for the capital expenses it incurred in connection with the Attachment Facilities based upon the pro rata use of the Attachment Facilities by Connecting Transmission Owner, all third party users, and ~~Interconnection-Customer~~Developer, in accordance with Applicable Laws and Regulations or upon some other mutually-agreed upon methodology. In addition, cost responsibility for ongoing costs, including operation and maintenance costs associated with the Attachment Facilities, will be allocated between ~~Interconnection-Customer~~Developer and any third party users based upon the pro rata use of the Attachment Facilities by Connecting Transmission Owner, all third party users, and ~~Interconnection-Customer~~Developer, in accordance with Applicable Laws and Regulations or upon some other mutually agreed upon methodology. If the issue of such compensation or allocation cannot be resolved through such negotiations, it shall be submitted to FERC for resolution.

## 9.9 Disturbance Analysis Data Exchange.

The Parties will cooperate with one another and the NYISO in the analysis of disturbances to either ~~the~~ Generating Facility or the New York State Transmission System by gathering and providing access to any information relating to any disturbance, including information from disturbance recording equipment, protective relay targets, breaker operations and sequence of events records, and any disturbance information required by Good Utility Practice.

## 9.10 Phasor Measurement Units

~~An Interconnection Customer~~ Developer shall install and maintain, at its expense, phasor measurement units (“PMUs”) if it meets the following criteria: (1) completed a Class Year ~~Study or Cluster Study~~ after Class Year 2017; and (2) proposes a new Large Facility that either (a) has a maximum net output equal to or greater than 100 MW or (b) requires, as Attachment Facilities or System Upgrade Facilities, a new substation of 230kV or above.

PMUs shall be installed on the Large Facility on the low side of the generator step-up transformer, unless it is a non-synchronous generation facility, in which case the PMUs shall be installed on the ~~Interconnection Customer~~ Developer side of the Point of Interconnection. The PMUs must be capable of performing phasor measurements at a minimum of 60 samples per second which are synchronized via a high-accuracy satellite clock. To the extent ~~Interconnection Customer~~ Developer installs similar quality equipment, such as relays or digital fault recorders, that can collect data at least at the same rate as PMUs and which data is synchronized via a high-accuracy satellite clock, such equipment would satisfy this requirement.

~~Interconnection Customer~~ Developer shall be required to install and maintain, at its expense, PMU equipment which includes the communication circuit capable of carrying the PMU data to a local data concentrator, and then transporting the information continuously to the Connecting Transmission Owner and the NYISO; as well as store the PMU data locally for thirty ~~(30) Calendar Days~~ ~~Interconnection Customer~~ days. Developer shall provide to Connecting Transmission Owner and the NYISO all necessary and requested information through the Connecting Transmission Owner’s and the NYISO’s synchrophasor system, including the following: (a) gross MW and MVAR measured at the ~~Interconnection Customer~~ Developer side of the generator step-up transformer (or, for a non-synchronous generation facility, to be measured at the ~~Interconnection Customer~~ Developer side of the Point of Interconnection); (b) generator terminal voltage and current magnitudes and angles; (c) generator terminal frequency and frequency rate of change; and (d) generator field voltage and current, where available; and (e) breaker status, if available. The Connecting Transmission Owner will provide for the ongoing support and maintenance of the network communications linking the data concentrator to the Connecting Transmission Owner and the NYISO, consistent with ISO Procedures detailing the obligations related to SCADA data.

## ARTICLE 10. MAINTENANCE

### 10.1 Connecting Transmission Owner Obligations.

Connecting Transmission Owner shall maintain its transmission facilities and Attachment Facilities in a safe and reliable manner and in accordance with this Agreement.

### 10.2 ~~Interconnection Customer~~Developer Obligations.

~~Interconnection Customer~~Developer shall maintain its ~~Facility~~Generating Facilities and Attachment Facilities in a safe and reliable manner and in accordance with this Agreement.

### 10.3 Coordination.

~~Interconnection Customer~~The Developer and Connecting Transmission Owner shall confer regularly to coordinate the planning, scheduling and performance of preventive and corrective maintenance on the ~~Facility~~Large Generating Facilities and the Attachment Facilities. ~~Interconnection Customer~~The Developer and Connecting Transmission Owner shall keep NYISO fully informed of the preventive and corrective maintenance that is planned, and shall schedule all such maintenance in accordance with ~~ISO Procedures~~NYISO procedures.

### 10.4 Secondary Systems.

~~Interconnection Customers~~The Developer and Connecting Transmission Owner shall each cooperate with the other in the inspection, maintenance, and testing of control or power circuits that operate below 600 volts, AC or DC, including, but not limited to, any hardware, control or protective devices, cables, conductors, electric raceways, secondary equipment panels, transducers, batteries, chargers, and voltage and current transformers that directly affect the operation of ~~Interconnection Customer's~~Developer or Connecting Transmission Owner's facilities and equipment which may reasonably be expected to impact the other Party. ~~Interconnection Customer~~The Developer and Connecting Transmission Owner shall each provide advance notice to the other Party, and to NYISO, before undertaking any work on such circuits, especially on electrical circuits involving circuit breaker trip and close contacts, current transformers, or potential transformers.

### 10.5 Operating and Maintenance Expenses.

Subject to the provisions herein addressing the use of facilities by others, and except for operations and maintenance expenses associated with modifications made for providing interconnection or transmission service to a third party and such third party pays for such expenses, ~~Interconnection Customer~~Developer shall be responsible for all reasonable expenses including overheads, associated with: (1) owning, operating, maintaining, repairing, and replacing ~~Interconnection Customer~~Developer's Attachment Facilities; and (2) operation, maintenance, repair and replacement of Connecting Transmission Owner's Attachment Facilities. The Connecting Transmission Owner shall be entitled to the recovery of incremental operating and maintenance expenses that it incurs associated with System Upgrade Facilities and

System Deliverability Upgrades if and to the extent provided for under Attachment ~~HH~~S to the ISO OATT.

## ARTICLE 11. PERFORMANCE OBLIGATION

### 11.1 ~~Interconnection Customer~~Developer's Attachment Facilities.

~~Interconnection Customer~~Developer shall design, procure, construct, install, own and/or control the ~~Interconnection Customer~~Developer's Attachment Facilities described in Appendix A hereto, at its sole expense.

### 11.2 Connecting Transmission Owner's Attachment Facilities.

Connecting Transmission Owner ~~or Interconnection Customer, as determined in accordance with Article 5 of this Agreement,~~ shall design, procure, construct, ~~and/or~~ install, own and/or control the Connecting Transmission Owner's Attachment Facilities described in Appendix A hereto, at the sole expense of the ~~Interconnection Customer.~~ ~~Connecting Transmission Owner shall own the Connecting Transmission Owner's Attachment Facilities~~Developer.

### 11.3 System Upgrade Facilities and System Deliverability Upgrades.

Connecting Transmission Owner ~~or Interconnection Customer, as determined in accordance with Article 5 of this Agreement,~~ shall design, procure, construct, ~~and/or~~ install, and own the System Upgrade Facilities and System Deliverability Upgrades described in Appendix A hereto. ~~Connecting Transmission Owner shall own the System Upgrade Facilities and System Deliverability Upgrades.~~ The responsibility of the ~~Interconnection Customer~~Developer for costs related to System Upgrade Facilities and System Deliverability Upgrades shall be determined in accordance with the provisions of Attachment ~~HH~~S to the ISO OATT.

### 11.4 ~~Upgrades on Affected Systems or Upgrades Required for Multiple Projects on Connecting Transmission Owner's System or~~Special Provisions for Affected Systems.

~~If any~~  
For the re-payment of amounts advanced to Affected System Operator for System Upgrade Facilities or System Deliverability Upgrades ~~are required on an~~, the Developer and Affected System ~~or Connecting Transmission Owner's system in connection with~~Operator shall enter into an agreement that provides for such re-payment, but only if responsibility for the interconnection cost of the Facility and are subject to the requirements to enter a Standard Upgrades Construction Agreement or a Standard Multiparty Upgrade Construction Agreement pursuant to the requirements in such System Upgrade Facilities or System Deliverability Upgrades is not to be allocated in accordance with Attachment ~~HH~~S to the ISO OATT, ~~the upgrades will be described in Appendix A to this Agreement and constructed in accordance with the applicable construction. The agreement. If shall specify the Facility is subject to an Affected System Study for potential impacts~~terms governing payments to be made by the Developer to an External the Affected System, Operator as well as the status of re-payment by the

Affected System ~~Study and any identified Affected System Network Upgrades on the External Affected System will be described in Appendix A to this Agreement~~Operator.

## 11.5 Provision of Security.

~~If this Agreement is for a Generating Facility or Cluster Study Transmission Project participating in a Cluster Study Process that accepted, or is agreeing under this Agreement to accept, as applicable its Project Cost Allocation for Connecting Transmission Owner's Attachment Facilities, Distribution Upgrades, System Upgrade Facilities, and/or System Deliverability Upgrades and has posted, or is agreeing to post, the related Security in the Cluster Study Process, this provision will be replaced with the following: Attachment HHH to the ISO OATT shall govern the Security that Interconnection Customer provided for, as applicable, Connecting Transmission Owner's Attachment Facilities, Distribution Upgrades, System Upgrade Facilities and/or System Deliverability Upgrades for a Generating Facility or Cluster Study Transmission Project that participated in a Cluster Study.]~~

At least thirty (30) Calendar Days prior to the commencement of the procurement, installation, or construction of a discrete portion of ~~a~~ Connecting Transmission Owner's Attachment Facilities, ~~Interconnection Customer~~Developer shall provide Connecting Transmission Owner, at ~~Interconnection Customer~~Developer's option, a guarantee, a surety bond, letter of credit or other form of security that is reasonably acceptable to Connecting Transmission Owner and is consistent with the Uniform Commercial Code of the jurisdiction identified in Article 14.2.1 of this Agreement. Such security for payment shall be in an amount sufficient to cover the cost for ~~Interconnection Customer~~the Developer's share of constructing, procuring and installing the applicable portion of Connecting Transmission Owner's Attachment Facilities, and shall be reduced on a dollar-for-dollar basis for payments made to Connecting Transmission Owner for these purposes.

In addition:

**11.5.1** The guarantee must be made by an entity that meets the commercially reasonable creditworthiness requirements of Connecting Transmission Owner, and contains terms and conditions that guarantee payment of any amount that may be due from ~~Interconnection Customer~~Developer, up to an agreed-to maximum amount.

**11.5.2** The letter of credit must be issued by a financial institution reasonably acceptable to Connecting Transmission Owner and must specify a reasonable expiration date.

### ~~11.5.3~~

**11.5.3** The surety bond must be issued by an insurer reasonably acceptable to Connecting Transmission Owner and must specify a reasonable expiration date.

**11.5.4** Attachment ~~HHH~~S to the ISO OATT shall govern the Security that ~~Interconnection Customer~~Developer provides for System Upgrade Facilities and System Deliverability Upgrades ~~for a Generating Facility or Class Year Transmission Project that participated in a Class Year Study.~~

## **11.6 ~~Interconnection Customer's~~Developer Compensation for Emergency Services.**

If, during an Emergency State, ~~Interconnection Customer~~the Developer provides services at the request or direction of the NYISO or Connecting Transmission Owner, ~~Interconnection Customer~~the Developer will be compensated for such services in accordance with the ~~ISO~~NYISO Services Tariff.

## **11.7 Line Outage Costs.**

Notwithstanding anything in the ISO OATT to the contrary, the Connecting Transmission Owner may propose to recover line outage costs associated with the installation of Connecting Transmission Owner's Attachment Facilities; ~~or~~ System Upgrade Facilities; or System Deliverability Upgrades on a case-by-case basis.

# **ARTICLE 12. INVOICE**

## **12.1 General.**

~~Interconnection Customer~~The Developer and Connecting Transmission Owner shall each submit to the other Party, on a monthly basis, invoices of amounts due for the preceding month. Each invoice shall state the month to which the invoice applies and fully describe the services and equipment provided. ~~Interconnection Customer~~The Developer and Connecting Transmission Owner may discharge mutual debts and payment obligations due and owing to each other on the same date through netting, in which case all amounts one Party owes to the other Party under this Agreement, including interest payments or credits, shall be netted so that only the net amount remaining due shall be paid by the owing Party.

## **12.2 Final Invoice.**

Within six months after completion of the construction of the Connecting Transmission Owner's Attachment Facilities; ~~and the~~ System Upgrade Facilities; and System Deliverability Upgrades, Connecting Transmission Owner shall provide an invoice of the final cost of the construction of the Connecting Transmission Owner's Attachment Facilities; ~~and the~~ System Upgrade Facilities; and System Deliverability Upgrades, determined in accordance with Attachment ~~HH~~S to the ISO OATT, and shall set forth such costs in sufficient detail to enable ~~Interconnection Customer~~Developer to compare the actual costs with the estimates and to ascertain deviations, if any, from the cost estimates. Connecting Transmission Owner shall refund to ~~Interconnection Customer~~Developer any amount by which the actual payment by ~~Interconnection Customer~~Developer for estimated costs exceeds the actual costs of construction within thirty (30) Calendar Days of the issuance of such final construction invoice.

## **12.3 Payment.**

Invoices shall be rendered to the paying Party at the address specified in Appendix F hereto. The Party receiving the invoice shall pay the invoice within thirty (30) Calendar Days of receipt. All payments shall be made in immediately available funds payable to the other Party,

or by wire transfer to a bank named and account designated by the invoicing Party. Payment of invoices will not constitute a waiver of any rights or claims the paying Party may have under this Agreement.

## **12.4 Disputes.**

In the event of a billing dispute between Connecting Transmission Owner and ~~Interconnection Customer~~Developer, Connecting Transmission Owner shall continue to perform under this Agreement as long as ~~Interconnection Customer~~Developer: (i) continues to make all payments not in dispute; and (ii) pays to Connecting Transmission Owner or into an independent escrow account the portion of the invoice in dispute, pending resolution of such dispute. If ~~Interconnection Customer~~Developer fails to meet these two requirements for continuation of service, then Connecting Transmission Owner may provide notice to ~~Interconnection Customer~~Developer of a Default pursuant to Article 17. Within thirty (30) Calendar Days after the resolution of the dispute, the Party that owes money to the other Party shall pay the amount due with interest calculated in ~~accord~~accordance with the methodology set forth in FERC's Regulations at 18 C.F.R. § 35.19a(a)(2)(iii).

## **ARTICLE 13. EMERGENCIES**

### **13.1 Obligations.**

Each Party shall comply with the Emergency State procedures of NYISO, the ~~Applicable~~applicable Reliability Councils, ~~of~~ Applicable Laws and Regulations, and any emergency procedures agreed to by the NYISO Operating Committee.

### **13.2 Notice.**

~~NYISO or, as applicable,~~ Connecting Transmission Owner shall notify ~~Interconnection Customer~~Developer promptly when it becomes aware of an Emergency State that affects the Connecting Transmission Owner's Attachment Facilities or the New York State Transmission System that may reasonably be expected to affect ~~Interconnection Customer~~Developer's operation of ~~the~~a Generating Facility or the ~~Interconnection Customer~~Developer's Attachment Facilities. ~~Interconnection Customer~~Developer shall notify NYISO and Connecting Transmission Owner promptly when it becomes aware of an Emergency State that affects ~~the~~a Generating Facility or the ~~Interconnection Customer~~Developer's Attachment Facilities that may reasonably be expected to affect the New York State Transmission System or the Connecting Transmission Owner's Attachment Facilities. To the extent information is known, the notification shall describe the Emergency State, the extent of the damage or deficiency, the expected effect on the operation of ~~Interconnection Customer~~Developer's or Connecting Transmission Owner's facilities and operations, its anticipated duration and the corrective action taken and/or to be taken. The initial notice shall be followed as soon as practicable with written notice.

### 13.3 Immediate Action.

Unless, in ~~Interconnection-CustomerDeveloper~~'s reasonable judgment, immediate action is required, ~~Interconnection-CustomerDeveloper~~ shall obtain the consent of Connecting Transmission Owner, such consent to not be unreasonably withheld, prior to performing any manual switching operations at ~~thea~~ Generating Facility or the ~~Interconnection-CustomerDeveloper~~'s Attachment Facilities in response to an Emergency State either declared by NYISO, Connecting Transmission Owner or otherwise regarding New York State Transmission System.

### 13.4 NYISO and Connecting Transmission Owner Authority.

#### 13.4.1 General.

NYISO or Connecting Transmission Owner may take whatever actions with regard to the New York State Transmission System or the Connecting Transmission Owner's Attachment Facilities it deems necessary during an Emergency State in order to (i) preserve public health and safety, (ii) preserve the reliability of the New York State Transmission System or the Connecting Transmission Owner's Attachment Facilities, (iii) limit or prevent damage, and (iv) expedite restoration of service.

~~NYISO and~~ Connecting Transmission Owner shall use Reasonable Efforts to minimize the effect of such actions or inactions on ~~thea~~ Generating Facility or the ~~Interconnection-CustomerDeveloper's Attachment Facilities~~. The Parties understand that any actions that NYISO is authorized to take under this Article 13.4.1 are conditioned upon NYISO's use of Reasonable Efforts to minimize the effect of such actions or inactions on the Generating Facility or the Developer's Attachment Facilities. NYISO or Connecting Transmission Owner may, on the basis of technical considerations, require the Generating Facility to mitigate an Emergency State by taking actions necessary and limited in scope to remedy the Emergency State, including, but not limited to, directing ~~Interconnection-CustomerDeveloper~~ to shut-down, start-up, increase or decrease the real or reactive power output of the Generating Facility; implementing a reduction or disconnection pursuant to Article 13.4.2; directing ~~Interconnection-Customer~~the Developer to assist with blackstart (if available) or restoration efforts; or altering the outage schedules of the Generating Facility and the ~~Interconnection-CustomerDeveloper~~'s Attachment Facilities. ~~Interconnection-CustomerDeveloper~~ shall comply with all of the NYISO and Connecting Transmission Owner's operating instructions concerning Generating Facility real power and reactive power output within the manufacturer's design limitations of the Generating Facility's equipment that is in service and physically available for operation at the time, in compliance with Applicable Laws and Regulations.

#### 13.4.2 Reduction and Disconnection.

NYISO or Connecting Transmission Owner may reduce ~~generation or transmission from Energy Resource Interconnection Service~~ or disconnect ~~thea~~ Generating Facility or the ~~Interconnection-CustomerDeveloper~~'s Attachment Facilities, when such reduction or disconnection is necessary under Good Utility Practice due to an Emergency State. These rights are separate and distinct from any right of Curtailment of NYISO pursuant to the ISO OATT.

When ~~NYISO or~~ Connecting Transmission Owner can schedule the reduction or disconnection in advance, ~~NYISO or~~ Connecting Transmission Owner shall notify ~~Interconnection-Customer~~Developer of the reasons, timing and expected duration of the reduction or disconnection. ~~NYISO or~~ Connecting Transmission Owner shall coordinate with ~~Interconnection-Customer~~the Developer using Good Utility Practice to schedule the reduction or disconnection during periods of least impact to ~~Interconnection-Customer~~the Developer and the New York State Transmission System. The Parties understand that any actions that NYISO is authorized to take under this Article 13.4.2 are conditioned upon NYISO's: (i) notification to the Developer of the reasons, timing and expected duration of the reduction or disconnection when NYISO can schedule the reduction or disconnection in advance, and (ii) coordination with the Developer using Good Utility Practice to schedule the reduction or disconnection during periods of least impact to the Developer and the New York State Transmission System. Any reduction or disconnection shall continue only for so long as reasonably necessary under Good Utility Practice. The Parties shall cooperate with each other to restore ~~the~~ the Generating Facility, the Attachment Facilities, and the New York State Transmission System to their normal operating state as soon as practicable consistent with Good Utility Practice.

### **13.5 ~~Interconnection-Customer~~Developer Authority.**

Consistent with Good Utility Practice and this Agreement, ~~Interconnection-Customer~~the Developer may take whatever actions or inactions with regard to ~~the~~ the Generating Facility or the ~~Interconnection-Customer~~Developer's Attachment Facilities during an Emergency State in order to (i) preserve public health and safety, (ii) preserve the reliability of the Generating Facility or the ~~Interconnection-Customer~~Developer's Attachment Facilities, (iii) limit or prevent damage, and (iv) expedite restoration of service. ~~Interconnection-Customer~~Developer shall use Reasonable Efforts to minimize the effect of such actions or inactions on the New York State Transmission System and the Connecting Transmission Owner's Attachment Facilities. ~~NYISO and~~ Connecting Transmission Owner shall use Reasonable Efforts to assist ~~Interconnection-Customer~~Developer in such actions.

### **13.6 Limited Liability.**

Except as otherwise provided in Article 11.6 of this Agreement, ~~neither~~ Party shall be liable to ~~another~~the other Party for any action it takes in responding to an Emergency State so long as such action is made in good faith and is consistent with Good Utility Practice and the NYISO Tariffs.

## **ARTICLE 14. REGULATORY REQUIREMENTS AND GOVERNING LAW**

### **14.1 Regulatory Requirements.**

Each Party's obligations under this Agreement shall be subject to its receipt of any required approval or certificate from one or more Governmental Authorities in the form and substance satisfactory to the applying Party, or the Party making any required filings with, or providing notice to, such Governmental Authorities, and the expiration of any time period associated therewith. Each Party shall in good faith seek and use its Reasonable Efforts to obtain such other approvals. Nothing in this Agreement shall require ~~Interconnection-~~

~~Customer~~Developer to take any action that could result in its inability to obtain, or its loss of, status or exemption under the Federal Power Act or the Public Utility Holding Company Act of 2005 or the Public Utility Regulatory Policies Act of 1978, as amended.

## **14.2 Governing Law.**

**14.2.1** The validity, interpretation and performance of this Agreement and each of its provisions shall be governed by the laws of the state of New York, without regard to its conflicts of law principles.

**14.2.2** This Agreement is subject to all Applicable Laws and Regulations.

**14.2.3** Each Party expressly reserves the right to seek changes in, appeal, or otherwise contest any laws, orders, rules, or regulations of a Governmental Authority.

## **ARTICLE 15. NOTICES**

### **15.1 General.**

Unless otherwise provided in this Agreement, any notice, demand or request required or permitted to be given by a Party to the other ~~Parties~~Party and any instrument required or permitted to be tendered or delivered by a Party in writing to the other ~~Parties~~Party shall be effective when delivered and may be so given, tendered or delivered, by recognized national courier, or by depositing the same with the United States Postal Service with postage prepaid, for delivery by certified or registered mail, addressed to the Party, or personally delivered to the Party, at the address set out in Appendix F hereto.

A Party may change the notice information in this Agreement by giving five (5) Business Days written notice prior to the effective date of the change.

### **15.2 Billings and Payments.**

Billings and payments shall be sent to the addresses set out in Appendix F hereto.

### **15.3 Alternative Forms of Notice.**

Any notice or request required or permitted to be given by a Party to the other ~~Parties~~Party and not required by this Agreement to be given in writing may be so given by telephone, facsimile or email to the telephone numbers and email addresses set out in Appendix F hereto.

### **15.4 Operations and Maintenance Notice.**

~~Interconnection-Customer~~Developer and Connecting Transmission Owner shall each notify the other Party, and NYISO, in writing of the identity of the person(s) that it designates as the point(s) of contact with respect to the implementation of Articles 9 and 10 of this Agreement.

## ARTICLE 16. FORCE MAJEURE

16.1 Economic hardship is not considered a Force Majeure event.

16.2 A Party shall not be responsible or liable, or deemed, in Default with respect to any obligation hereunder, (including obligations under Article 4 of this Agreement) , other than the obligation to pay money when due, to the extent the Party is prevented from fulfilling such obligation by Force Majeure. A Party unable to fulfill any obligation hereunder (other than an obligation to pay money when due) by reason of Force Majeure shall give notice and the full particulars of such Force Majeure to the other ~~Parties~~Party in writing or by telephone as soon as reasonably possible after the occurrence of the cause relied upon. Telephone notices given pursuant to this Article shall be confirmed in writing as soon as reasonably possible and shall specifically state full particulars of the Force Majeure, the time and date when the Force Majeure occurred and when the Force Majeure is reasonably expected to cease. The Party affected shall exercise due diligence to remove such disability with reasonable dispatch, but shall not be required to accede or agree to any provision not satisfactory to it in order to settle and terminate a strike or other labor disturbance.

## ARTICLE 17. DEFAULT

### 17.1 General.

No Breach shall exist where such failure to discharge an obligation (other than the payment of money) is the result of Force Majeure as defined in this Agreement or the result of an act or omission of the other ~~Parties~~Party. Upon a Breach, the non-Breaching ~~Parties~~Party shall give written notice of such to the Breaching Party. The Breaching Party shall have thirty (30) Calendar Days from receipt of the Breach notice within which to cure such Breach; provided however, if such Breach is not capable of cure within thirty (30) Calendar Days, the Breaching Party shall commence such cure within thirty (30) Calendar Days after notice and continuously and diligently complete such cure within ninety (90) Calendar Days from receipt of the Breach notice; and, if cured within such time, the Breach specified in such notice shall cease to exist.

### 17.2 Right to Terminate.

If a Breach is not cured as provided in this Article 17, or if a Breach is not capable of being cured within the period provided for herein, the non-Breaching ~~Parties acting together~~Party shall thereafter have the right to declare a Default and terminate this Agreement by written notice at any time until cure occurs, and be relieved of any further obligation hereunder and, whether or not ~~those Parties terminate~~that Party terminates this Agreement, to recover from the defaulting Party all amounts due hereunder, plus all other damages and remedies to which they are entitled at law or in equity. The provisions of this Article will survive termination of this Agreement.

## ARTICLE 18. INDEMNITY, CONSEQUENTIAL DAMAGES AND INSURANCE

### 18.1 Indemnity.

Each Party (the “Indemnifying Party”) shall at all times indemnify, defend, and save harmless, as applicable, the other ~~Parties (each an~~ Party (the “Indemnified Party”) from, any and all damages, losses, claims, including claims and actions relating to injury to or death of any person or damage to property, the alleged violation of any Environmental Law, or the release or threatened release of any Hazardous Substance, demand, suits, recoveries, costs and expenses, court costs, attorney fees, and all other obligations by or to third parties (any and all of these a “Loss”), arising out of or resulting from (i) the Indemnified Party’s performance of its obligations under this Agreement on behalf of the Indemnifying Party, except in cases where the Indemnifying Party can demonstrate that the Loss of the Indemnified Party was caused by the gross negligence or intentional wrongdoing of the Indemnified Party or (ii) the violation by the Indemnifying Party of any Environmental Law or the release by the Indemnifying Party of any Hazardous Substance.

#### 18.1.1 Indemnified Party.

If a Party is entitled to indemnification under this Article 18 as a result of a claim by a third party, and the Indemnifying Party fails, after notice and reasonable opportunity to proceed under Article 18.1.3, to assume the defense of such claim, such Indemnified Party may at the expense of the Indemnifying Party contest, settle or consent to the entry of any judgment with respect to, or pay in full, such claim.

#### 18.1.2 Indemnifying Party.

If ~~an~~the Indemnifying Party is obligated to indemnify and hold ~~any~~the Indemnified Party harmless under this Article 18, the amount owing to the Indemnified Party shall be the amount of such Indemnified Party’s actual Loss, net of any insurance or other recovery.

#### 18.1.3 Indemnity Procedures.

Promptly after receipt by ~~an~~the Indemnified Party of any claim or notice of the commencement of any action or administrative or legal proceeding or investigation as to which the indemnity provided for in Article 18.1 may apply, the Indemnified Party shall notify the Indemnifying Party of such fact. Any failure of or delay in such notification shall not affect a Party’s indemnification obligation unless such failure or delay is materially prejudicial to the Indemnifying Party.

Except as stated below, the Indemnifying Party shall have the right to assume the defense thereof with counsel designated by such Indemnifying Party and reasonably satisfactory to the Indemnified Party. If the defendants in any such action include ~~one or more~~the Indemnified ~~Parties~~Party and the Indemnifying Party and if the Indemnified Party reasonably concludes that there may be legal defenses available to it ~~and/or other Indemnified Parties~~ which are different from or additional to those available to the Indemnifying Party, the Indemnified Party shall have the right to select separate counsel to assert such legal defenses and to otherwise participate in

the defense of such action on its own behalf. In such instances, the Indemnifying Party shall only be required to pay the fees and expenses of one additional attorney to represent ~~an~~the Indemnified Party ~~or Indemnified Parties~~ having such differing or additional legal defenses.

The Indemnified Party shall be entitled, at its expense, to participate in any such action, suit or proceeding, the defense of which has been assumed by the Indemnifying Party. Notwithstanding the foregoing, the Indemnifying Party (i) shall not be entitled to assume and control the defense of any such action, suit or proceedings if and to the extent that, in the opinion of the Indemnified Party and its counsel, such action, suit or proceeding involves the potential imposition of criminal liability on the Indemnified Party, or there exists a conflict or adversity of interest between the Indemnified Party and the Indemnifying Party, in such event the Indemnifying Party shall pay the reasonable expenses of the Indemnified Party, and (ii) shall not settle or consent to the entry of any judgment in any action, suit or proceeding without the consent of the Indemnified Party, which shall not be unreasonably withheld, conditioned or delayed.

## **18.2 No Consequential Damages.**

Other than the liquidated damages heretofore described and the indemnity obligations set forth in Article 18.1, in no event shall ~~any~~either Party be liable under any provision of this Agreement for any losses, damages, costs or expenses for any special, indirect, incidental, consequential, or punitive damages, including but not limited to loss of profit or revenue, loss of the use of equipment, cost of capital, cost of temporary equipment or services, whether based in whole or in part in contract, in tort, including negligence, strict liability, or any other theory of liability; provided, however, that damages for which a Party may be liable to ~~another~~the other Party under separate agreement will not be considered to be special, indirect, incidental, or consequential damages hereunder.

## **18.3 Insurance.**

~~Interconnection Customer~~Developer and Connecting Transmission Owner shall each, at its own expense, procure and maintain in force throughout the period of this Agreement and until released by the other ~~Parties~~Party, the following minimum insurance coverages, with insurance companies licensed to write insurance or approved eligible surplus lines carriers in the state of New York with a minimum A.M. Best rating of A or better for financial strength, and an A.M. Best financial size category of VIII or better:

**18.3.1** Employers' Liability and Workers' Compensation Insurance providing statutory benefits in accordance with the laws and regulations of New York State.

**18.3.2** Commercial General Liability ("CGL") Insurance including premises and operations, personal injury, broad form property damage, broad form blanket contractual liability coverage, products and completed operations coverage, coverage for explosion, collapse and underground hazards, independent contractors coverage, coverage for pollution to the extent normally available and punitive damages to the extent normally available using Insurance Services Office, Inc. Commercial General Liability Coverage ("ISO CG") Form CG 00 01 04 13 or a form equivalent to or better than CG 00 01 04 13, with minimum limits of Two Million

Dollars (\$2,000,000) per occurrence and Two Million Dollars (\$2,000,000) aggregate combined single limit for personal injury, bodily injury, including death and property damage. [This limit requirement may be satisfied with a combination of primary and excess liability.](#)

**18.3.3** Comprehensive Automobile Liability Insurance for coverage of owned and non-owned and hired vehicles, trailers or semi-trailers designed for travel on public roads, with a minimum, combined single limit of One Million Dollars (\$1,000,000) per occurrence for bodily injury, including death, and property damage.

**18.3.4** If applicable, the Commercial General Liability and Comprehensive Automobile Liability Insurance policies should include contractual liability for work in connection with construction or demolition work on or within 50 feet of a railroad, or a separate Railroad Protective Liability Policy should be provided.

**18.3.5** Excess Liability Insurance over and above the Employers' Liability, Commercial General Liability and Comprehensive Automobile Liability Insurance coverages, with a minimum combined single limit of Twenty Million Dollars (\$20,000,000) per occurrence and Twenty Million Dollars (\$20,000,000) aggregate. The Excess policies should contain the same extensions listed under the Primary policies.

**18.3.6** The Commercial General Liability Insurance, Comprehensive Automobile Insurance and Excess Liability Insurance policies of ~~Interconnection Customer~~[Developer](#) and Connecting Transmission Owner shall name the other Party, its parent, associated and Affiliate companies and their respective directors, officers, agents, servants and employees ("Other Party Group") as additional insureds using ISO CG Endorsements: CG 20 33 04 13, and CG 20 37 04 13 or CG 20 10 04 13 and CG 20 37 04 13 or equivalent to or better forms. All policies shall contain provisions whereby the insurers waive all rights of subrogation in accordance with the provisions of this Agreement against the Other Party Group and provide thirty (30) Calendar days advance written notice to the Other Party Group prior to anniversary date of cancellation or any material change in coverage or condition.

**18.3.7** The Commercial General Liability Insurance, Comprehensive Automobile Liability Insurance and Excess Liability Insurance policies shall contain provisions that specify that the policies are primary and non-contributory. ~~Interconnection Customer~~[Developer](#) and Connecting Transmission Owner shall each be responsible for its respective deductibles or retentions.

**18.3.8** The Commercial General Liability Insurance, Comprehensive Automobile Liability Insurance and Excess Liability Insurance policies, if written on a Claims First Made Basis, shall be maintained in full force and effect for at least three (3) years after termination of this Agreement, which coverage may be in the form of tail coverage or extended reporting period coverage if agreed by ~~Interconnection Customer~~[the Developer](#) and Connecting Transmission Owner.

**18.3.9** If applicable, Pollution Liability Insurance in an amount no less than \$7,500,000 per occurrence and \$7,500,000 in the aggregate. The policy will provide coverage for claims resulting from pollution or other environmental impairment arising out of or in

connection with work performed on the premises by the other party, its contractors and and/or subcontractors. Such insurance is to include coverage for, but not be limited to, cleanup, third party bodily injury and property damage and remediation and will be written on an occurrence basis. The policy shall name the Other Party Group as additional insureds, be primary and contain a waiver of subrogation.

**18.3.10** The requirements contained herein as to the types and limits of all insurance to be maintained by ~~Interconnection Customer~~the Developer and Connecting Transmission Owner are not intended to and shall not in any manner, limit or qualify the liabilities and obligations assumed by those Parties under this Agreement.

**18.3.11** Within ~~[insert term stipulated by the Parties]~~ Calendar Days ~~ten (10) days~~ following execution of this Agreement, and as soon as practicable after the end of each fiscal year or at the renewal of the insurance policy and in any event within ninety (90) ~~Calendar Days~~days thereafter, ~~Interconnection Customer~~Developer and Connecting Transmission Owner shall provide ~~certificate~~certificates of insurance for all insurance required in this Agreement, executed by each insurer or by an authorized representative of each insurer.

**18.3.12** Notwithstanding the foregoing, ~~Interconnection Customer~~Developer and Connecting Transmission Owner may each self-insure to meet the minimum insurance requirements of Articles 18.3.1 through 18.3.9 to the extent it maintains a self-insurance program; provided that, such Party's senior debt is rated at investment grade, or better, by Standard & Poor's and that its self-insurance program meets the minimum insurance requirements of Articles 18.3.1 through 18.3.9. In the event that a Party is permitted to self-insure pursuant to this Article 18.3.12, it shall notify the other Party that it meets the requirements to self-insure and that its self-insurance program meets the minimum insurance requirements in a manner consistent with that specified in Articles 18.3.1 through 18.3.9 and provide evidence of such coverages. For any period of time that a Party's senior debt is unrated by Standard & Poor's or is rated at less than investment grade by Standard & Poor's, such Party shall comply with the insurance requirements applicable to it under Articles 18.3.1 through 18.3.9.

**18.3.13** ~~Interconnection Customer~~Developer and Connecting Transmission Owner agree to report to each other in writing as soon as practical all accidents or occurrences resulting in injuries to any person, including death, and any property damage arising out of this Agreement.

**18.3.14** Subcontractors of each party must maintain the same insurance requirements stated under Articles 18.3.1 through 18.3.9 and comply with the Additional Insured requirements herein. In addition, their policies must state that they are primary and non-contributory and contain a waiver of subrogation.

## **ARTICLE 19. ASSIGNMENT**

This Agreement may be assigned by a Party only with the written consent of the other ~~Parties~~Party; provided that a Party may assign this Agreement without the consent of the other ~~Parties~~Party to any Affiliate of the assigning Party with an equal or greater credit rating and with

the legal authority and operational ability to satisfy the obligations of the assigning Party under this Agreement; provided further that a Party may assign this Agreement without the consent of the other ~~Parties~~Party in connection with the sale, merger, restructuring, or transfer of a substantial portion or all of its assets, including the Attachment Facilities it owns, so long as the assignee in such a transaction directly assumes in writing all rights, duties and obligations arising under this Agreement; and provided further that ~~Interconnection Customer~~the Developer shall have the right to assign this Agreement, without the consent of the NYISO or Connecting Transmission Owner, for collateral security purposes to aid in providing financing for ~~the~~a Generating Facility, provided that ~~Interconnection Customer~~the Developer will promptly notify the NYISO and Connecting Transmission Owner of any such assignment. Any financing arrangement entered into by ~~Interconnection Customer~~the Developer pursuant to this Article will provide that prior to or upon the exercise of the secured party's, trustee's or mortgagee's assignment rights pursuant to said arrangement, the secured creditor, the trustee or mortgagee will notify the NYISO and Connecting Transmission Owner of the date and particulars of any such exercise of assignment right(s) and will provide the NYISO and Connecting Transmission Owner with proof that it meets the requirements of Articles 11.5 and 18.3. ~~If the Facility is made up of more than one resource, a Party may only assign this Agreement for the entire Facility and may not divide the Agreement into separate agreements for the individual resources that constitute the Facility.~~ Any attempted assignment that violates this Article is void and ineffective. Any assignment under this Agreement shall not relieve a Party of its obligations, nor shall a Party's obligations be enlarged, in whole or in part, by reason thereof. Where required, consent to assignment will not be unreasonably withheld, conditioned or delayed.

## **ARTICLE 20. SEVERABILITY**

If any provision in this Agreement is finally determined to be invalid, void or unenforceable by any court or other Governmental Authority having jurisdiction, such determination shall not invalidate, void or make unenforceable any other provision, agreement or covenant of this Agreement; provided that if ~~Interconnection Customer~~the Developer (or any third party, but only if such third party is not acting at the direction of the Connecting Transmission Owner) seeks and obtains such a final determination with respect to any provision of the Alternate Option (Article 5.1.2), or the Negotiated Option (Article 5.1.4), then none of these provisions shall thereafter have any force or effect and the rights and obligations of ~~Interconnection Customer~~Developer and Connecting Transmission Owner shall be governed solely by the Standard Option (Article 5.1.1).

## **ARTICLE 21. COMPARABILITY**

The Parties will comply with all applicable comparability and code of conduct laws, rules and regulations, as amended from time to time.

## **ARTICLE 22. CONFIDENTIALITY**

### **22.1 Confidentiality.**

Certain information exchanged by the Parties during the term of this Agreement shall constitute confidential information (“Confidential Information”) and shall be subject to this Article 22.

If requested by a Party receiving information, the Party supplying the information shall provide in writing, the basis for asserting that the information referred to in this Article warrants confidential treatment, and the requesting Party may disclose such writing to the appropriate Governmental Authority. Each Party shall be responsible for the costs associated with affording confidential treatment to its information.

### **22.2 Term.**

During the term of this Agreement, and for a period of three (3) years after the expiration or termination of this Agreement, except as otherwise provided in this Article 22, each Party shall hold in confidence and shall not disclose to any person Confidential Information.

### **22.3 Confidential Information.**

The following shall constitute Confidential Information: (1) any non-public information that is treated as confidential by the disclosing Party and which the disclosing Party identifies as Confidential Information in writing at the time, or promptly after the time, of disclosure; or (2) information designated as Confidential Information by the NYISO Code of Conduct contained in Attachment F to the ISO OATT.

### **22.4 Scope.**

Confidential Information shall not include information that the receiving Party can demonstrate: (1) is generally available to the public other than as a result of a disclosure by the receiving Party; (2) was in the lawful possession of the receiving Party on a non-confidential basis before receiving it from the disclosing Party; (3) was supplied to the receiving Party without restriction by a third party, who, to the knowledge of the receiving Party after due inquiry, was under no obligation to the disclosing Party to keep such information confidential; (4) was independently developed by the receiving Party without reference to Confidential Information of the disclosing Party; (5) is, or becomes, publicly known, through no wrongful act or omission of the receiving Party or Breach of this Agreement; or (6) is required, in accordance with Article 22.9 of this Agreement, Order of Disclosure, to be disclosed by any Governmental Authority or is otherwise required to be disclosed by law or subpoena, or is necessary in any legal proceeding establishing rights and obligations under this Agreement. Information designated as Confidential Information will no longer be deemed confidential if the Party that designated the information as confidential notifies the other Party that it no longer is confidential.

## **22.5 Release of Confidential Information.**

~~No~~Neither Party shall release or disclose Confidential Information to any other person, except to its Affiliates (limited by FERC Standards of Conduct requirements), subcontractors, employees, consultants, or to parties who may be considering providing financing to or equity participation with ~~Interconnection-Customer~~Developer, or to potential purchasers or assignees of a Party, on a need-to-know basis in connection with this Agreement, unless such person has first been advised of the confidentiality provisions of this Article 22 and has agreed to comply with such provisions. Notwithstanding the foregoing, a Party providing Confidential Information to any person shall remain primarily responsible for any release of Confidential Information in contravention of this Article 22.

## **22.6 Rights.**

Each Party retains all rights, title, and interest in the Confidential Information that each Party discloses to the other Party. The disclosure by each Party to the other ~~Parties~~Party of Confidential Information shall not be deemed a waiver by ~~any~~either Party or any other person or entity of the right to protect the Confidential Information from public disclosure.

## **22.7 No Warranties.**

By providing Confidential Information, ~~no~~neither Party makes any warranties or representations as to its accuracy or completeness. In addition, by supplying Confidential Information, ~~no~~neither Party obligates itself to provide any particular information or Confidential Information to the other ~~Parties~~Party nor to enter into any further agreements or proceed with any other relationship or joint venture.

## **22.8 Standard of Care.**

Each Party shall use at least the same standard of care to protect Confidential Information it receives as it uses to protect its own Confidential Information from unauthorized disclosure, publication or dissemination. Each Party may use Confidential Information solely to fulfill its obligations to the other ~~Parties~~Party under this Agreement or its regulatory requirements, including the ISO OATT and ~~ISO~~NYISO Services Tariff. The Parties understand that the NYISO shall, in all cases, treat the information it receives in accordance with the requirements of Attachment F to the ISO OATT.

## **22.9 Order of Disclosure.**

If a court or a Government Authority or entity with the right, power, and apparent authority to do so requests or requires ~~any~~either Party, by subpoena, oral deposition, interrogatories, requests for production of documents, administrative order, or otherwise, to disclose Confidential Information, that Party shall provide the other ~~Parties~~Party with prompt notice of such request(s) or requirement(s) so that the other ~~Parties~~Party may seek an appropriate protective order or waive compliance with the terms of this Agreement. Notwithstanding the absence of a protective order or waiver, the Party may disclose such Confidential Information which, in the opinion of its counsel, the Party is legally compelled to disclose. Each Party will

use Reasonable Efforts to obtain reliable assurance that confidential treatment will be accorded any Confidential Information so furnished.

## **22.10 Termination of Agreement.**

Upon termination of this Agreement for any reason, each Party shall, within ten (10) Calendar Days of receipt of a written request from the other ~~Parties~~Party, use Reasonable Efforts to destroy, erase, or delete (with such destruction, erasure, and deletion certified in writing to the other ~~Parties~~Party) or return to the other ~~Parties~~Party, without retaining copies thereof, any and all written or electronic Confidential Information received from the other ~~Parties~~Party pursuant to this Agreement.

## **22.11 Remedies.**

The Parties agree that monetary damages would be inadequate to compensate a Party for ~~another~~the other Party's Breach of its obligations under this Article 22. Each Party accordingly agrees that the other ~~Parties~~Party shall be entitled to equitable relief, by way of injunction or otherwise, if the first Party Breaches or threatens to Breach its obligations under this Article 22, which equitable relief shall be granted without bond or proof of damages, and the receiving Party shall not plead in defense that there would be an adequate remedy at law. Such remedy shall not be deemed an exclusive remedy for the Breach of this Article 22, but shall be in addition to all other remedies available at law or in equity. The Parties further acknowledge and agree that the covenants contained herein are necessary for the protection of legitimate business interests and are reasonable in scope. ~~No~~Neither Party, however, shall be liable for indirect, incidental, or consequential or punitive damages of any nature or kind resulting from or arising in connection with this Article 22.

## **22.12 Disclosure to FERC, its Staff, or a State.**

Notwithstanding anything in this Article 22 to the contrary, and pursuant to 18 C.F.R. section 1b.20, if FERC or its staff, during the course of an investigation or otherwise, requests information from one of the Parties that is otherwise required to be maintained in confidence pursuant to this Agreement or the ISO OATT, the Party shall provide the requested information to FERC or its staff, within the time provided for in the request for information. In providing the information to FERC or its staff, the Party must, consistent with 18 C.F.R. section 388.112, request that the information be treated as confidential and non-public by FERC and its staff and that the information be withheld from public disclosure. ~~Parties are~~Each Party is prohibited from notifying the other ~~Parties~~Party to this Agreement prior to the release of the Confidential Information to the Commission or its staff. The Party shall notify the other ~~Parties~~Party to the Agreement when it is notified by FERC or its staff that a request to release Confidential Information has been received by FERC, at which time the Parties may respond before such information would be made public, pursuant to 18 C.F.R. section 388.112. Requests from a state regulatory body conducting a confidential investigation shall be treated in a similar manner if consistent with the applicable state rules and regulations. A Party shall not be liable for any losses, consequential or otherwise, resulting from that Party divulging Confidential Information pursuant to a FERC or state regulatory body request under this paragraph.

### **22.13 Required Notices Upon Requests or Demands for Confidential Information**

Except as otherwise expressly provided herein, ~~neither~~ Party shall disclose Confidential Information to any person not employed or retained by the Party possessing the Confidential Information, except to the extent disclosure is (i) required by law; (ii) reasonably deemed by the disclosing Party to be required to be disclosed in connection with a dispute between ~~or among~~ the Parties, or the defense of litigation or dispute; (iii) otherwise permitted by consent of the other Party, such consent not to be unreasonably withheld; or (iv) necessary to fulfill its obligations under this Agreement, the ISO OATT or the ~~ISO~~NYISO Services Tariff. Prior to any disclosures of a Party's Confidential Information under this subparagraph, or if any third party or Governmental Authority makes any request or demand for any of the information described in this subparagraph, the disclosing Party agrees to promptly notify the other Party in writing and agrees to assert confidentiality and cooperate with the other Party in seeking to protect the Confidential Information from public disclosure by confidentiality agreement, protective order or other reasonable measures.

### **ARTICLE 23. ~~INTERCONNECTION CUSTOMER~~DEVELOPER AND CONNECTING TRANSMISSION OWNER NOTICES OF ENVIRONMENTAL RELEASES**

~~Interconnection Customer~~Developer and Connecting Transmission Owner shall each notify the other Party, first orally and then in writing, of the release of any Hazardous Substances, any asbestos or lead abatement activities, or any type of remediation activities related to ~~the a~~ Generating Facility or the Attachment Facilities, each of which may reasonably be expected to affect the other Party. The notifying Party shall: (i) provide the notice as soon as practicable, provided such Party makes a good faith effort to provide the notice no later than twenty-four hours after such Party becomes aware of the occurrence; and (ii) promptly furnish to the other Party copies of any publicly available reports filed with any Governmental Authorities addressing such events.

### **ARTICLE 24. INFORMATION REQUIREMENT**

#### **24.1 Information Acquisition.**

Connecting Transmission Owner and ~~Interconnection Customer~~Developer shall each submit specific information regarding the electrical characteristics of their respective facilities to the other, and to NYISO, as described below and in accordance with Applicable Reliability Standards.

#### **24.2 Information Submission by Connecting Transmission Owner.**

The initial information submission by Connecting Transmission Owner shall occur no later than one hundred eighty (180) Calendar Days prior to ~~the Synchronization Date~~Trial Operation and shall include New York State Transmission System information necessary to allow ~~Interconnection Customer~~the Developer to select equipment and meet any system protection and stability requirements, unless otherwise mutually agreed to by ~~Interconnection-~~

~~Customer~~the Developer and Connecting Transmission Owner ~~and set forth in the Milestones table in Appendix B to this Agreement.~~ On a monthly basis, Connecting Transmission Owner ~~or Interconnection Customer, as applicable,~~ shall provide ~~the other Parties with~~Developer and NYISO a status report on the construction and installation of ~~the~~ Connecting Transmission Owner's Attachment Facilities; and System Upgrade Facilities; and System Deliverability Upgrades ~~for which it is responsible,~~ including, but not limited to, the following information: (1) progress to date; (2) a description of the activities since the last report; (3) a description of the action items for the next period; and (4) the delivery status of equipment ordered.

#### **24.3 Updated Information Submission by ~~Interconnection Customer~~Developer.**

The updated information submission by ~~Interconnection Customer~~the Developer, including manufacturer information, shall occur no later than one hundred eighty (180) Calendar Days prior to the ~~Synchronization Date, unless otherwise mutually agreed to by Interconnection Customer and Connecting Transmission Owner and set forth in the Milestone table in Appendix B to this Agreement.~~ ~~Interconnection Customer~~Trial Operation. Developer shall submit a completed copy of the Generating Facility data requirements contained in, ~~as applicable,~~ Appendix 1 to the Standard Large Facility Interconnection Procedures ~~in Attachment X to the OATT or Appendix 1 to the Standard Interconnection Procedures in Attachment HH to the OATT.~~ It shall also include any additional information provided to Connecting Transmission Owner for the ~~Class Year Study or Cluster~~Interconnection Facilities Study. Information in this submission shall be the most current Generating Facility design or expected performance data. Information submitted for stability models shall be compatible with NYISO standard models. If there is no compatible model, ~~Interconnection Customer~~the Developer will work with a consultant mutually agreed to by the Parties to develop and supply a standard model and associated information.

If ~~Interconnection Customer~~the Developer's data is different from what ~~Interconnection Customer~~was originally provided to Connecting Transmission Owner and NYISO ~~in its Interconnection Request or, if applicable,~~ pursuant to an ~~Class Year~~Interconnection Study Agreement among Connecting Transmission Owner, NYISO and ~~Interconnection Customer~~Developer and this difference may be reasonably expected to affect the other ~~Parties~~Party's facilities or the New York State Transmission System, but does not require the submission of a new Interconnection Request, then NYISO ~~will~~may conduct appropriate studies to determine the impact on the New York State Transmission System based on the actual data submitted pursuant to this Article 24.3. Such studies will provide an estimate of any additional modifications to the New York State Transmission System, Connecting Transmission Owner's Attachment Facilities or System Upgrade Facilities or System Deliverability Upgrades based on the actual data and a good faith estimate of the costs thereof. The ~~Interconnection Customer~~Developer shall not begin Trial Operation until such studies are completed. The ~~Interconnection Customer~~Developer shall be responsible for the cost of any modifications required by the actual data, including the cost of any required studies.

#### **24.4 Information Supplementation.**

Prior to the Commercial Operation Date, ~~Interconnection Customer~~the Developer and Connecting Transmission Owner shall supplement their information submissions described

above in this Article 24 with any and all “as-built” Generating Facility information or “as-tested” performance information that differs from the initial submissions or, alternatively, written confirmation that no such differences exist. ~~If the Facility is a Class Year Transmission Project or Cluster Study Transmission Project, Appendix C to this Agreement shall include any project-specific variations from the testing requirements established in this Article 24.4 that are appropriate for the transmission facility.~~

~~Interconnection Customer~~The Developer shall conduct tests on ~~the~~each Generating Facility as required by Good Utility Practice such as an open circuit “step voltage” test on the Generating Facility to verify proper operation of the Generating Facility’s automatic voltage regulator.

Unless otherwise agreed, the test conditions shall include: (1) the Generating Facility at synchronous speed; (2) automatic voltage regulator on and in voltage control mode; and (3) a five percent change in Generating Facility terminal voltage initiated by a change in the voltage regulators reference voltage. ~~Interconnection Customer~~Developer shall provide validated test recordings showing the responses of Generating Facility terminal and field voltages. In the event that direct recordings of these voltages is impractical, recordings of other voltages or currents that mirror the response of the Generating Facility’s terminal or field voltage are acceptable if information necessary to translate these alternate quantities to actual Generating Facility terminal or field voltages is provided. Generating Facility testing shall be conducted and results provided to the Connecting Transmission Owner and NYISO for each individual generating unit in a station.

Subsequent to the Commercial Operation Date, ~~Interconnection Customer~~the Developer shall provide Connecting Transmission Owner and NYISO any information changes due to equipment replacement, repair, or adjustment. Connecting Transmission Owner shall provide ~~Interconnection Customer~~the Developer and NYISO any information changes due to equipment replacement, repair or adjustment in the directly connected substation or any adjacent Connecting Transmission Owner substation that may affect the ~~Interconnection Customer’s~~Developer Attachment Facilities equipment ratings, protection or operating requirements. ~~Interconnection Customer~~The Developer and Connecting Transmission Owner shall provide such information no later than thirty (30) Calendar Days after the date of the equipment replacement, repair or adjustment.

## **ARTICLE 25. INFORMATION ACCESS AND AUDIT RIGHTS**

### **25.1 Information Access.**

Each Party (“Disclosing Party”) shall make available to ~~another~~the other Party (“Requesting Party”) information that is in the possession of the Disclosing Party and is necessary in order for the Requesting Party to: (i) verify the costs incurred by the Disclosing Party for which the Requesting Party is responsible under this Agreement; and (ii) carry out its obligations and responsibilities under this Agreement. The Parties shall not use such information for purposes other than those set forth in this Article 25.1 of this Agreement and to enforce their rights under this Agreement.

## **25.2 Reporting of Non-Force Majeure Events.**

Each Party (the “Notifying Party”) shall notify the other ~~Parties~~Party when the Notifying Party becomes aware of its inability to comply with the provisions of this Agreement for a reason other than a Force Majeure event. The Parties agree to cooperate with each other and provide necessary information regarding such inability to comply, including the date, duration, reason for the inability to comply, and corrective actions taken or planned to be taken with respect to such inability to comply. Notwithstanding the foregoing, notification, cooperation or information provided under this Article shall not entitle the Party receiving such notification to allege a cause for anticipatory breach of this Agreement.

## **25.3 Audit Rights.**

Subject to the requirements of confidentiality under Article 22 of this Agreement, each Party shall have the right, during normal business hours, and upon prior reasonable notice to ~~another~~the other Party, to audit at its own expense the other Party’s accounts and records pertaining to the other Party’s performance or satisfaction of its obligations under this Agreement. Such audit rights shall include audits of the other Party’s costs, calculation of invoiced amounts, and each Party’s actions in an Emergency State. Any audit authorized by this Article shall be performed at the offices where such accounts and records are maintained and shall be limited to those portions of such accounts and records that relate to the Party’s performance and satisfaction of obligations under this Agreement. Each Party shall keep such accounts and records for a period equivalent to the audit rights periods described in Article 25.4 of this Agreement.

## **25.4 Audit Rights Periods.**

### **25.4.1 Audit Rights Period for Construction-Related Accounts and Records.**

Accounts and records related to the design, engineering, procurement, and construction of Connecting Transmission Owner’s Attachment Facilities; ~~and~~and System Upgrade Facilities; and System Deliverability Upgrades shall be subject to audit for a period of twenty-four months following Connecting Transmission Owner’s issuance of a final invoice in accordance with Article 12.2 of this Agreement.

### **25.4.2 Audit Rights Period for All Other Accounts and Records.**

Accounts and records related to a Party’s performance or satisfaction of its obligations under this Agreement other than those described in Article 25.4.1 of this Agreement shall be subject to audit as follows: (i) for an audit relating to cost obligations, the applicable audit rights period shall be twenty-four months after the auditing Party’s receipt of an invoice giving rise to such cost obligations; and (ii) for an audit relating to all other obligations, the applicable audit rights period shall be twenty-four months after the event for which the audit is sought.

## **25.5 Audit Results.**

If an audit by a Party determines that an overpayment or an underpayment has occurred, a notice of such overpayment or underpayment shall be given to the other Party together with those records from the audit which support such determination.

## **ARTICLE 26. SUBCONTRACTORS**

### **26.1 General.**

Nothing in this Agreement shall prevent a Party from utilizing the services of any subcontractor as it deems appropriate to perform its obligations under this Agreement; provided, however, that each Party shall require its subcontractors to comply with all applicable terms and conditions of this Agreement in providing such services and each Party shall remain primarily liable to the other ~~Parties~~Party for the performance of such subcontractor.

### **26.2 Responsibility of Principal.**

The creation of any subcontract relationship shall not relieve the hiring Party of any of its obligations under this Agreement. The hiring Party shall be fully responsible to the other ~~Parties~~Party for the acts or omissions of any subcontractor the hiring Party hires as if no subcontract had been made; provided, however, that in no event shall the NYISO or Connecting Transmission Owner be liable for the actions or inactions of ~~Interconnection Customer~~the Developer or its subcontractors with respect to obligations of ~~Interconnection Customer~~the Developer under Article 5 of this Agreement. Any applicable obligation imposed by this Agreement upon the hiring Party shall be equally binding upon, and shall be construed as having application to, any subcontractor of such Party.

### **26.3 No Limitation by Insurance.**

The obligations under this Article 26 will not be limited in any way by any limitation of subcontractor's insurance.

## **ARTICLE 27. DISPUTES**

### **27.1 Submission.**

In the event ~~any~~either Party has a dispute, or asserts a claim, that arises out of or in connection with this Agreement or its performance (a "Dispute"), such Party shall provide the other ~~Parties~~Party with written notice of the Dispute ("Notice of Dispute"). Such Dispute shall be referred to a designated senior representative of each Party for resolution on an informal basis as promptly as practicable after receipt of the Notice of Dispute by the other ~~Parties~~Party. In the event the designated representatives are unable to resolve the Dispute through unassisted or assisted negotiations within thirty (30) Calendar Days of the other ~~Parties~~Party's receipt of the Notice of Dispute, such Dispute may, upon mutual agreement of the Parties, be submitted to arbitration and resolved in accordance with the arbitration procedures set forth below. In the

event the Parties do not agree to submit such Dispute to arbitration, each Party may exercise whatever rights and remedies it may have in equity or at law consistent with the terms of this Agreement.

## **27.2 External Arbitration Procedures.**

Any arbitration initiated under this Agreement shall be conducted before a single neutral arbitrator appointed by the Parties. If the Parties fail to agree upon a single arbitrator within ten (10) Calendar Days of the submission of the Dispute to arbitration, ~~each Party~~ then the arbitration shall choose one arbitrator who shall sit on be conducted by a three-member arbitration panel. For purposes of the three-member arbitration panel, one arbitrator shall be selected by Connecting Transmission Owner and another arbitrator shall be selected by Developer, in each case within twenty (20) Calendar Days of the submission of the Dispute to arbitration. A third arbitrator shall be selected by the first two arbitrators within ten (10) Calendar Days after the later of: (a) the date Connecting Transmission Owner selected an arbitrator; and (b) the date Developer selected an arbitrator. If either Connecting Transmission Owner or Developer fails to select an arbitrator, then the arbitrator selected shall select the remaining two arbitrators. If arbitrators selected by Connecting Transmission Owner and Developer have not agreed on the selection of the third arbitrator within such ten (10) Calendar Day period, the third arbitrator shall be expeditiously selected in accordance with the rules of the American Arbitration Association.

In each case, the arbitrator(s) shall be knowledgeable in electric utility matters, including electric transmission and bulk power issues, and shall not have any current or past substantial business or financial relationships with any party to the arbitration (except prior arbitration). The arbitrator(s) shall provide each of the Parties an opportunity to be heard and, except as otherwise provided herein, shall conduct the arbitration in accordance with the Commercial Arbitration Rules of the American Arbitration Association ("Arbitration Rules") and any applicable FERC regulations or RTO rules; provided, however, in the event of a conflict between the Arbitration Rules and the terms of this Article 27, the terms of this Article 27 shall prevail.

## **27.3 Arbitration Decisions.**

Unless otherwise agreed by the Parties, the arbitrator(s) shall render a decision within ninety (90) Calendar Days of appointment and shall notify the Parties in writing of such decision and the reasons therefor. The arbitrator(s) shall be authorized only to interpret and apply the provisions of this Agreement and shall have no power to modify or change any provision of this Agreement in any manner. The decision of the arbitrator(s) shall be final and binding upon the Parties, and judgment on the award may be entered in any court having jurisdiction. The decision of the arbitrator(s) may be appealed solely on the grounds that the conduct of the arbitrator(s), or the decision itself, violated the standards set forth in the Federal Arbitration Act or the Administrative Dispute Resolution Act. The final decision of the arbitrator must also be filed with FERC if it affects jurisdictional rates, terms and conditions of service, Attachment Facilities, System Upgrade Facilities, or System Deliverability Upgrades.

## **27.4 Costs.**

Each Party shall be responsible for its own costs incurred during the arbitration process and for the following costs, if applicable: (1) the cost of the arbitrator chosen by the Party to sit on the three ~~member~~ panel; ~~or~~ (2) one ~~third~~ half of the cost of the ~~single~~ third arbitrator jointly chosen by the ~~Parties~~ two selected arbitrators or chosen in accordance with the rules of the American Arbitration Association; and/or (3) one-half of the cost of the two arbitrators chosen by the sole arbitrator selected by one Party in the absence of the selection of an arbitrator by the other Party.

## **27.5 Termination.**

Notwithstanding the provisions of this Article 27, ~~any~~ either Party may terminate this Agreement in accordance with its provisions or pursuant to an action at law or equity. The issue of whether such a termination is proper shall not be considered a Dispute hereunder.

# **ARTICLE 28. REPRESENTATIONS, WARRANTIES AND COVENANTS**

## **28.1 General.**

Each Party makes the following representations, warranties and covenants:

### **28.1.1 Good Standing.**

Such Party is duly organized, validly existing and in good standing under the laws of the state in which it is organized, formed, or incorporated, as applicable; that it is qualified to do business in the state or states in which ~~the~~ a Generating Facility, Attachment Facilities; and System Upgrade Facilities; and System Deliverability Upgrades owned by such Party, as applicable, are located ~~or interconnect~~; and that it has the corporate power and authority to own its properties, to carry on its business as now being conducted; and to enter into this Agreement and carry out the transactions contemplated hereby; ~~and to~~ perform and carry out all covenants and obligations on its part to be performed under and pursuant to this Agreement.

### **28.1.2 Authority.**

Such Party has the right, power and authority to enter into this Agreement, to become a Party hereto and to perform its obligations hereunder. This Agreement is a legal, valid and binding obligation of such Party, enforceable against such Party in accordance with its terms, except as the enforceability thereof may be limited by applicable bankruptcy, insolvency, reorganization or other similar laws affecting creditors' rights generally and by general equitable principles (regardless of whether enforceability is sought in a proceeding in equity or at law).

### **28.1.3 No Conflict.**

The execution, delivery and performance of this Agreement does not violate or conflict with the organizational or formation documents, or bylaws or operating agreement, of such

Party, or any judgment, license, permit, order, material agreement or instrument applicable to or binding upon such Party or any of its assets.

#### **28.1.4 Consent and Approval.**

Such Party has sought or obtained, or, in accordance with this Agreement will seek or obtain, each consent, approval, authorization, order, or acceptance by any Governmental Authority in connection with the execution, delivery and performance of this Agreement, and ~~the~~ Party it will provide to any Governmental Authority notice of any actions under this Agreement that are required by Applicable Laws and Regulations.

### **ARTICLE 29. MISCELLANEOUS**

#### **29.1 Binding Effect.**

This Agreement and the rights and obligations hereof, shall be binding upon and shall inure to the benefit of the successors and permitted assigns of the Parties hereto.

#### **29.2 Conflicts.**

If there is a discrepancy or conflict between or among the terms and conditions of this cover agreement and the Appendices hereto, the terms and conditions of this cover agreement shall be given precedence over the Appendices, except as otherwise expressly agreed to in writing by the Parties.

#### **29.3 Rules of Interpretation.**

This Agreement, unless a clear contrary intention appears, shall be construed and interpreted as follows: (1) the singular number includes the plural number and vice versa; (2) reference to any person includes such person's successors and assigns but, in the case of a Party, only if such successors and assigns are permitted by this Agreement, and reference to a person in a particular capacity excludes such person in any other capacity or individually; (3) reference to any agreement (including this Agreement), document, instrument or tariff means such agreement, document, instrument, or tariff as amended or modified and in effect from time to time in accordance with the terms thereof and, if applicable, the terms hereof; (4) reference to any Applicable Laws and Regulations means such Applicable Laws and Regulations as amended, modified, codified, or reenacted, in whole or in part, and in effect from time to time, including, if applicable, rules and regulations promulgated thereunder; (5) unless expressly stated otherwise, reference to any Article, Section or Appendix means such Article of this Agreement or such Appendix to this Agreement, or such Section to the Standard Large Facility Interconnection Procedures or such Appendix to the Standard Large Facility Interconnection Procedures, as the case may be; (6) "hereunder", "hereof", "herein", "hereto" and words of similar import shall be deemed references to this Agreement as a whole and not to any particular Article or other provision hereof or thereof; (7) "including" (and with correlative meaning "include") means including without limiting the generality of any description preceding such term; and (8) relative to the determination of any period of time, "from" means "from and including", "to" means "to but excluding" and "through" means "through and including".

#### **29.4 Compliance.**

Each Party shall perform its obligations under this Agreement in accordance with Applicable Laws and Regulations, Applicable Reliability Standards, the ISO OATT, ~~ISO-Procedures~~, and Good Utility Practice. To the extent a Party is required or prevented or limited in taking any action by such regulations and standards, such Party shall not be deemed to be in Breach of this Agreement for its compliance therewith. When ~~any~~either Party becomes aware of such a situation, it shall notify the other ~~Parties~~Party promptly so that the Parties can discuss the amendment to this Agreement that is appropriate under the circumstances.

#### **29.5 Joint and Several Obligations.**

Except as otherwise stated herein, the obligations of ~~NYISO, Interconnection-Customer,~~Developer and Connecting Transmission Owner are several, and are neither joint nor joint and several.

#### **29.6 Entire Agreement.**

This Agreement, including all Appendices and Schedules attached hereto, constitutes the entire agreement ~~among~~between the Parties with reference to the subject matter hereof, and supersedes all prior and contemporaneous understandings or agreements, oral or written, ~~among~~between the Parties with respect to the subject matter of this Agreement. There are no other agreements, representations, warranties, or covenants ~~that~~which constitute any part of the consideration for, or any condition to, either Party's compliance with its obligations under this Agreement.

#### **29.7 No Third Party Beneficiaries.**

This Agreement is not intended to and does not create rights, remedies, or benefits of any character whatsoever in favor of any persons, corporations, associations, or entities other than the Parties, and the obligations herein assumed are solely for the use and benefit of the Parties, their successors in interest and permitted their assigns.

#### **29.8 Waiver.**

The failure of a Party to this Agreement to insist, on any occasion, upon strict performance of any provision of this Agreement will not be considered a waiver of any obligation, right, or duty of, or imposed upon, such Party. Any waiver at any time by ~~any~~either Party of its rights with respect to this Agreement shall not be deemed a continuing waiver or a waiver with respect to any other failure to comply with any other obligation, right, duty of this Agreement. Termination or Default of this Agreement for any reason by ~~Interconnection-Customer~~the Developer shall not constitute a waiver of ~~Interconnection-Customer~~the Developer's legal rights to obtain Capacity Resource Interconnection Service and Energy Resource Interconnection Service from the NYISO and Connecting Transmission Owner in accordance with the provisions of the ISO OATT. Any waiver of this Agreement shall, if requested, be provided in writing.

## **29.9 Headings.**

The descriptive headings of the various Articles of this Agreement have been inserted for convenience of reference only and are of no significance in the interpretation or construction of this Agreement.

## **29.10 Multiple Counterparts.**

This Agreement may be executed in two or more counterparts, each of which is deemed an original but all constitute one and the same instrument.

## **29.11 Amendment.**

The Parties may by mutual agreement amend this Agreement, by a written instrument duly executed by ~~all three~~both of the Parties.

## **29.12 Modification by the Parties.**

The Parties may by mutual agreement amend the Appendices to this Agreement, by a written instrument duly executed by ~~all three~~both of the Parties. Such an amendment shall become effective and a part of this Agreement upon satisfaction of all Applicable Laws and Regulations.

## **29.13 Reservation of Rights.**

~~NYISO and~~ Connecting Transmission Owner shall have the right to make unilateral filings with FERC to modify this Agreement with respect to any rates, terms and conditions, charges, classifications of service, rule or regulation under section 205 or any other applicable provision of the Federal Power Act and FERC's rules and regulations thereunder, and ~~Interconnection Customer~~Developer shall have the right to make a unilateral filing with FERC to modify this Agreement pursuant to section 206 or any other applicable provision of the Federal Power Act and FERC's rules and regulations thereunder; provided that each Party shall have the right to protest any such filing by ~~another~~the other Party and to participate fully in any proceeding before FERC in which such modifications may be considered. Nothing in this Agreement shall limit the rights of the Parties or of FERC under sections 205 or 206 of the Federal Power Act and FERC's rules and regulations thereunder, except to the extent that the Parties otherwise mutually agree as provided herein.

## **29.14 No Partnership.**

This Agreement shall not be interpreted or construed to create an association, joint venture, agency relationship, or partnership ~~among~~between the Parties or to impose any partnership obligation or partnership liability upon ~~any~~either Party. ~~No~~Neither Party shall have any right, power or authority to enter into any agreement or undertaking for, or act on behalf of, or to act as or be an agent or representative of, or to otherwise bind, ~~any~~the other Party.

## 29.15 Other Transmission Rights.

Notwithstanding any other provision of this Agreement, nothing herein shall be construed as relinquishing or foreclosing any rights, including but not limited to firm transmission rights, capacity rights, or transmission congestion rights that ~~Interconnection-Customer~~the Developer shall be entitled to, now or in the future under any other agreement or tariff as a result of, or otherwise associated with, the transmission capacity, if any, created by the System Upgrade Facilities and System Deliverability Upgrades.

## ~~29.16 Modifications Related to NYISO's Compliance with Order No. 2023~~

~~If, as part of the NYISO's compliance proceeding at the Commission in response to Order No. 2023, the Commission directs that the NYISO modify the *pro forma* Standard Interconnection Agreement located in Appendix 15 of Attachment HH to the ISO OATT, the Parties shall amend and restate this Agreement to incorporate the modifications; *provided, however*, the Parties may agree to include in the amended and restated agreement non-conforming changes to any terms of the *pro forma* Standard Interconnection Agreement that have been modified to comply with the Commission's order, which non-conforming modifications must be filed with the Commission for its acceptance.~~

IN WITNESS WHEREOF, the Parties have executed this Agreement in duplicate originals, each of which shall constitute and be an original effective Agreement between the Parties.

~~New York Independent System Operator, Inc.~~

By: \_\_\_\_\_

Name: \_\_\_\_\_

Title: \_\_\_\_\_

Date: \_\_\_\_\_

~~{Insert Name of Connecting Transmission Owner}~~

Niagara Mohawk Power Corporation d/b/a National Grid

By: \_\_\_\_\_

Name: Vishal Ahirrao

Title: —

Title: Director, Customer Energy Integration and Commercial Services, NY

Date: \_\_\_\_\_

Curtis/Palmer Hydroelectric Company L.P.

By: \_\_\_\_\_

Name: Pascale Tremblay

Title: Chief Asset Officer

Date: \_\_\_\_\_

**~~{Insert Name of Interconnection Customer}~~**

By: \_\_\_\_\_

Name: \_\_\_\_\_

Title: \_\_\_\_\_

Date: \_\_\_\_\_

\_\_\_\_\_

## APPENDICES

### Appendix A

~~Facility~~, Attachment Facilities, and ~~Upgrades~~[System Upgrade Facilities](#)

### Appendix B

Milestones

### Appendix C

[Interconnection Details](#)

### [Appendix C-1](#)

~~Operating~~ Requirements [to Operate](#)

### Appendix D

Security Arrangements Details

### Appendix E-1

[Initial](#) Synchronization Date

### Appendix E-2

Commercial Operation Date

### Appendix F

Addresses for Delivery of Notices and Billings

### [Appendix G](#)

[Operation and Maintenance](#)

### [Appendix H](#)

[List of Non-Applicable Pro-Forma LGIA Provisions](#)

## APPENDIX A

### ~~FACILITY,~~ ATTACHMENT FACILITIES, AND ~~UPGRADES~~ SYSTEM UPGRADE FACILITIES

#### ~~1. Description of Facility~~

*~~[Insert description of Facility]~~*

#### ~~2. Point(s) of Interconnection and Point(s) of Change of Ownership~~

~~(a) Point(s) of Interconnection (“POI”).~~ *~~[Insert description of Point of Interconnection]~~*

~~(b) Point(s) of Change of Ownership (“PCO”).~~ *~~[Insert description of Point of Change of Ownership]~~*

The POI and PCO are detailed on the simplified one-line diagram in Appendix A.

~~3~~

#### 1. Attachment Facilities:

##### ~~(a) Interconnection~~

##### a.) Interconnecting Customer’s ~~Attachment Facilities (“ICAFs”)~~

*~~[Insert description of any Interconnection Customer~~ (Developer’s) Attachment Facilities]*

##### ~~(b) Connecting Transmission Owner’s Attachment Facilities (“CTOAFs”)~~

*~~[Insert description of any Connecting Transmission Owner’s Attachment Facilities]~~*

~~4. System Upgrade Facilities (“SUFs”):~~

~~(a) Stand Alone System Upgrade Facilities~~

~~[Insert description of any Stand Alone SUFs.]~~

~~(b) Other System Upgrade Facilities~~

~~[Insert description of any Other System Upgrade Facilities]~~

~~5. Distribution Upgrades~~

~~[Insert description of any Distribution Upgrades]~~

~~6. Affected Systems~~

~~[Insert description of any System Upgrade Facilities for Affected Systems and reference-related Standard Upgrades Construction Agreement and Standard Multiparty Upgrades Construction Agreement]~~

~~7. External Affected Systems~~

~~[Insert description of any upgrades required on External Affected Systems.]~~

**8**

The Developer receives 115kV service from the Company’s local 115kV transmission system via a single circuit tap from the Company’s Spier-West #9 line. The Developer’s facility includes a receiving structure, a line trap and Capacitor Coupled Voltage Transformer (CCVT), main 115kV service isolation disconnect switch (988), an automatic means of overcurrent protection (circuit breaker R9), surge arresters, voltage sensing transformers, structural supports for the Company’s billing meters, two (2) transformers identified as #2 bank and #3 bank which are rated for 35.0/46.7MVA each, two (2) hydro generator units rated at 29.3MVA each, and five (5) generators with a combined rating of 12.3MVA. The circuit breaker R9 is asserted by a relay system having various protection features in addition to overcurrent protection. The Company’s billing meters are supported by the Developer’s structures within the substation fence.

b.)

The Developer’s facility is presently served by the Company’s transmission system via a single circuit tap from the Company’s 115kV Spier -West #9 line from pole T55, also designated as the Point of Interconnection. This single circuit tap continues to the Developer’s facility and is terminated to the Developer’s receiving structure.

c.) **Point of Interconnection**

The point of the Developer’s interconnection to the Company’s EPS is identified as Developer’s receiving structure.

#### d.) Point of Change of Ownership

The point of change of ownership between the Company and the Developer is at the Developer's receiving structure. The Developer owns, operates and maintains a single line trap and single capacitor coupled voltage transformer (CCVT) which are tapped ahead of the Point of Change of Ownership on one of the tap conductors. Furthermore, the Company owns billing metering transformers which are beyond (electrically downstream of) the point of change of ownership.

### 2. System Upgrade Facilities:

- (a) The Developer's facilities are connected to the Company's transmission system, The Company requires the Developer to install a remote monitoring system for the Company's use. This project addresses this requirement by the installation of a Company Remote Telemetry Unit (RTU) , furnished by the Company and installed by the Developer. The Company will collect and monitor data points within the Developer's facility, including, but not limited to, the status of disconnect switch 988, circuit breaker R9, and power quantity values such as MVA imported/exported, voltage levels, and current values, or other quantities as deemed necessary by the Company.
- (b) The monitoring capability achieved through the installation of an RTU requires the Developer to join the Company's private and secure communications network. The physical attachment of the appropriate communications media is the responsibility of the Developer, including the recurring cost imposed by the communications service provider(s) and associated costs.
- (c) The RTU will be furnished by the Company and installed by the Developer per the Company's direction. The Company will provide commissioning of the unit to test functionality and accuracy of the installation. The Company will recover costs associated with the RTU in accordance with our regulatory obligations.

### 3. System Deliverability Upgrades:

*~~[Insert description of any System Deliverability Upgrade.]~~*

### ~~9. Cost Estimates~~

*~~[Insert cost table for Connecting Transmission Owner's Attachment Facilities and Upgrades drawn from the Class Year Study or Cluster Study]~~*

### ~~10. Operating & Maintenance Expenses for CTOAFs~~

*~~[Connecting Transmission Owner to insert operating and maintenance cost recovery requirements for Connecting Transmission Owner's Attachment Facilities.]~~*

~~11.~~—

4. **Estimate Costs of Interconnection** ~~Customer's Estimated Tax Liability~~

~~[Pursuant to Section 5.17.4, to insert Interconnection Customer's estimated tax liability in the event taxes are imposed.]~~

~~12.~~— **Contingent Facilities**

---

**Figure A-1**

**Simplified One-Line Diagram**

*[Parties to insert simplified one-line diagram that clearly shows Facility, Attachment Facilities, Upgrades, POI, and PCO]*

<u>Description</u>	<u>Estimated Cost</u>
<u>Engineering and Review of Customer Submittals</u>	<u>\$33,000.00</u>
<u>RTU</u>	<u>\$65,000.00</u>
<u>Testing and Commissioning-Relay/Protection</u>	<u>\$3,200.00</u>
<u>Company's walkthrough of installation</u>	<u>\$2,200.00</u>
<u>Estimated Project Total Costs owed to Connecting Transmission Owner</u>	<u>\$103,400.00</u>

## APPENDIX B B MILESTONES

### ~~1. Selected Option Pursuant to Article 5.1~~

~~*[To specify which option Interconnection Customer selected pursuant to Article 5.1 concerning the CTOAFs and Stand-Alone SUFs.]*~~

### ~~2. Milestones~~

~~*[To insert]*~~

### ~~3. Security~~


~~*[Insert description of the Security form and amount provided by Interconnection Customer in the Class Year Study or Cluster Study for CTOAFs, SUFs, and/or SDUs and insert description of any additional Security required for CTOAFs in accordance with Section 11.5 of this Agreement.]*~~


### ~~4. Site Control~~

Check box if applicable ☐

~~Interconnection Customer with qualifying regulatory limitations must demonstrate 100% Site Control by [NYISO to insert date one hundred eighty (180) Calendar Days from the Effective Date of this Agreement] or the Agreement may be terminated per Article 17 (Default) of this Agreement.~~

# APPENDIX C — INTERCONNECTION DETAILS

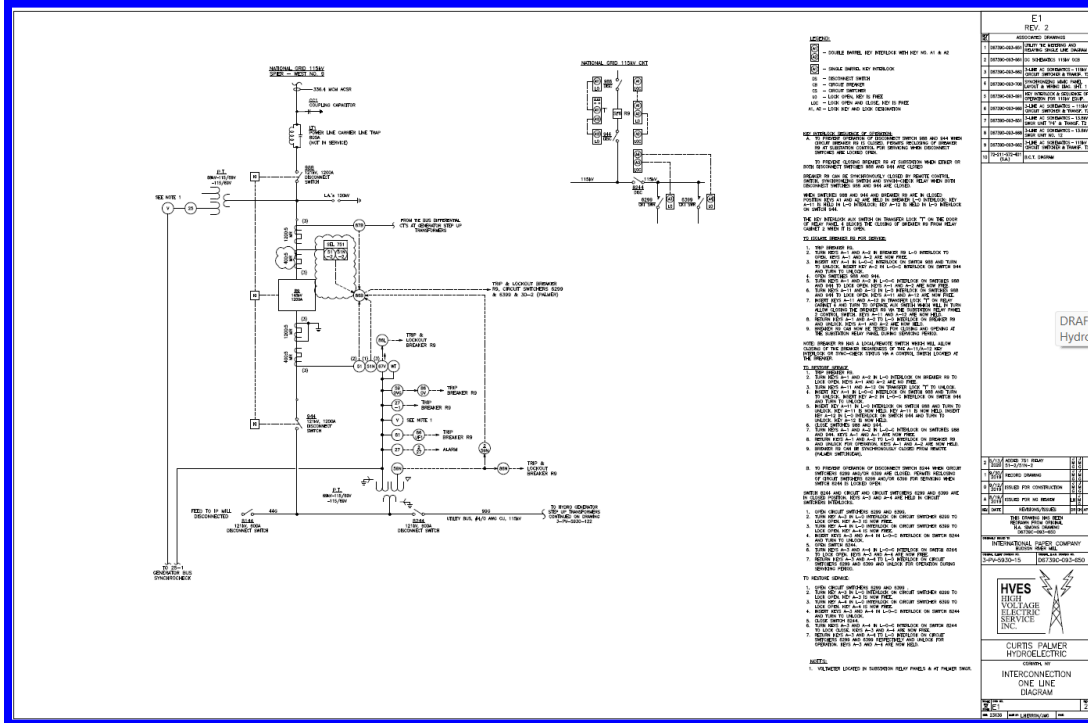

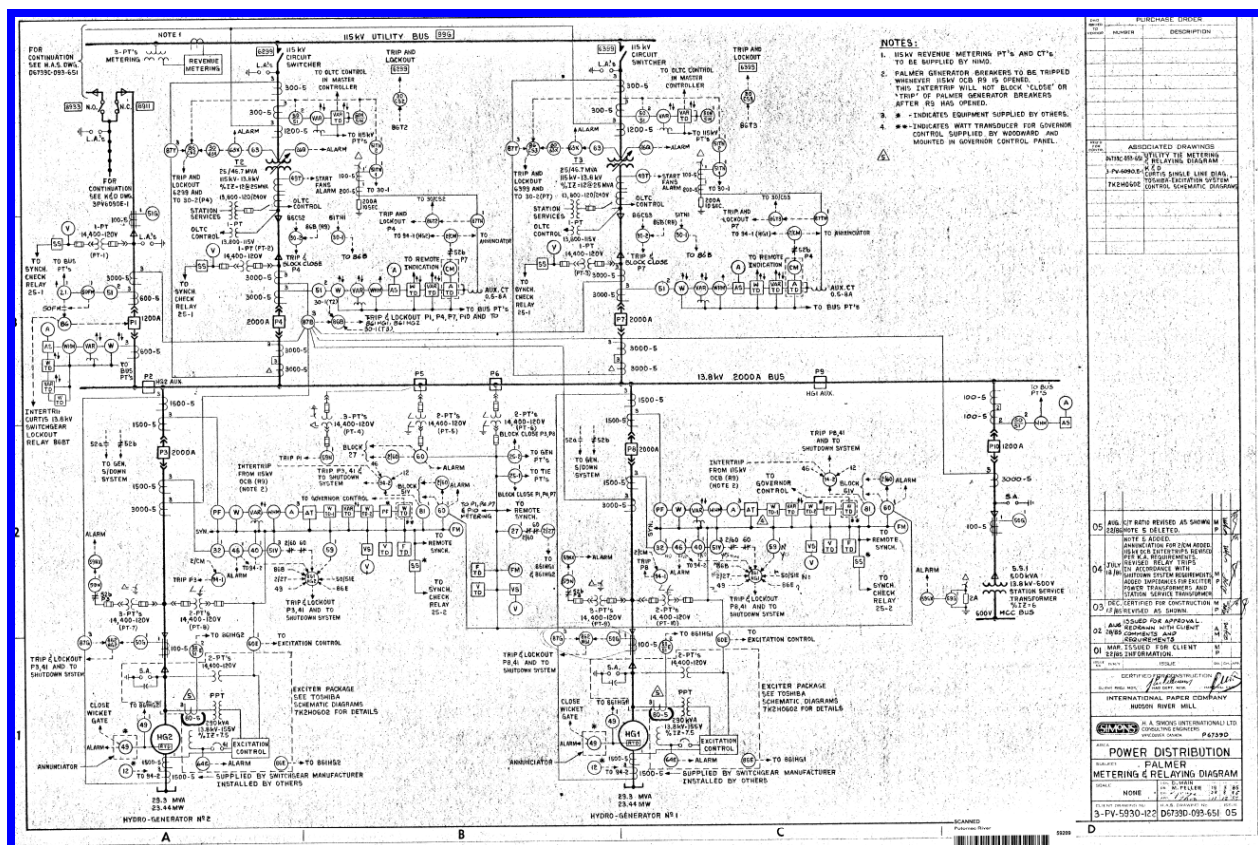

## APPENDIX C-1 – OPERATING REQUIREMENTS

### 1) ~~1.~~ Interconnection Customer Operating Requirements

The NYISO, in consultation with the Connecting Transmission Owner, shall also provide requirements that must be met by the Interconnection Customer prior to initiating parallel operation with the New York State Transmission System or the Distribution System.

- a. The Interconnection Customer must comply with all applicable NYISO tariffs and procedures, as amended from time to time.
- b. To the extent not inconsistent with the terms of this Agreement, the ISO OATT, or applicable NYISO procedures, Interconnection Customer must comply with Connecting Transmission Owner's operating instructions and requirements as referenced in Article 9.3 of this Agreement, which requirements shall include the dedicated data circuits, including system protection circuits, to be maintained by Interconnection Customer in accordance with Article 8.1 of this Agreement. Interconnection Customer must also comply with the applicable requirements as set out in the Connecting Transmission Owner's ESBs, which have been identified and provided to the Interconnection Customer as amended from time to time to the extent not inconsistent with the terms of this Agreement or applicable NYISO tariffs and procedures. Upon the Connecting Transmission Owner's notice to the Interconnection Customer of amendments to the ESBs, the Interconnection Customer has 30 days to comply with such amendments.
- c. Specific outage requirements shall be identified, and detailed outage plans developed, during final engineering. For purposes of coordinating the outages required to perform the work under this Agreement, the Connecting Transmission Owner provides the following information:
- d. Connecting Transmission Owner's Power Control Order (PCO) 7.3, Coordination of Transmission Outages and In-Service Work requires thirty (30) days advance lead time for Transmission Outage Application (TOA) submission for any line outage with a duration longer than three (3) days, and ten (10) days' notice for outages less than or equal to three (3) days. Summer scheduling criteria will prohibit any outages on the transmission lines between June 1 and August 31. However, if high grid loading occurs (due to hot weather) or severe storms are forecasted in late in September, as has happened historically, outages in September can be cancelled by the NYISO.

~~*[To insert any additional operating requirements.]*~~

**~~2. ——— [Primary Frequency Response Operating Range]~~**

*~~[To insert if applicable]~~*

**~~3. ——— [Operating Requirements Variations for Class Year Transmission Project or Cluster Study Transmission Project]~~**

*~~[To insert if applicable]~~*

## **APPENDIX D - SECURITY ARRANGEMENTS DETAILS**

Infrastructure security of New York State Transmission System equipment and operations and control hardware and software is essential to ensure day-to-day New York State Transmission System reliability and operational security. The Commission will expect the NYISO, all Transmission Owners, all ~~Interconnection-Customers~~Developers and all other Market Participants to comply with the recommendations offered by the President's Critical Infrastructure Protection Board and, eventually, best practice recommendations from the electric reliability authority. All public utilities will be expected to meet basic standards for system infrastructure and operational security, including physical, operational, and cyber-security practices.

APPENDIX E-1 – INITIAL SYNCHRONIZATION DATE

\_\_\_\_\_~~[Date]~~

\_\_\_\_\_~~[NYISO Address]~~\_\_\_\_\_

~~[Connecting Transmission Owner Address]~~  
August 12th, 2025

2 Hanson Place 12th Floor  
Brooklyn, NY 11217

Re: \_\_\_\_\_~~Facility~~Curtis/Palmer Hydroelectric Generating Facilities

Dear \_\_\_\_\_Vishal Ahirrao:

On ~~[Date]~~~~[Interconnection Customer]~~October 16, 1986, Curtis/Palmer Hydroelectric Company L.P. initially synchronized the ~~Facility~~ ~~[specify~~Generating Facilities Palmer unit #1 & #2 and Curtis units, ~~if applicable]~~ 1-5. This letter confirms that ~~[Interconnection Customer]~~Curtis/Palmer Hydro Electric Company L.P.'s Initial Synchronization Date was ~~[specify]~~October 16, 1986.

Thank you.

[Signature]

\_\_\_\_\_~~[Interconnection Customer Representative]~~

Pascale Tremblay

Chief Asset Officer

Curtis/Palmer Hydroelectric Company L.P.

APPENDIX E-2 COMMERCIAL OPERATION DATE

~~\_\_\_\_\_~~ ~~{Date}~~

~~\_\_\_\_\_~~ ~~{NYISO Address}~~

~~{Connecting Transmission Owner Address}~~

August 12th, 2025

2 Hanson Place 12th Floor  
Brooklyn, NY 11217

Re: ~~\_\_\_\_\_~~ ~~Facility~~ Curtis/Palmer Hydroelectric Generating Facilities

Dear ~~\_\_\_\_\_~~ Vishal Ahirrao:

On ~~{Date}~~ ~~{Interconnection Customer}~~ October 16, 1986, Curtis/Palmer Hydroelectric Company L.P. has completed Trial Operation of Unit ~~No~~ Nos. ~~\_\_\_\_\_~~ Palmer unit #1 & #2 and Curtis units 1-5. This letter confirms that ~~{Interconnection Customer}~~ Curtis/Palmer Hydroelectric Company L.P. commenced Commercial Operation of Unit ~~No~~ Nos. ~~\_\_\_\_\_~~ Palmer unit #1 & #2 and Curtis units 1-5 at the ~~Facility~~ Generating Facilities, effective as of ~~{Date plus one day}~~ October 17, 1986.

Thank you.

[Signature]

~~{Interconnection Customer Representative}~~ Pascale Tremblay

Chief Asset Officer

Curtis/Palmer Hydroelectric Company L.P.

## APPENDIX F ~~=~~ ADDRESSES FOR DELIVERY OF NOTICES AND BILLINGS

### Notices:

~~NYISO:~~

~~[To be supplied.]~~

Connecting Transmission Owner:

~~[To be supplied.]~~

~~Interconnection Customer:~~

~~[To be supplied.]~~

Vishal Ahirrao – Director, Customer Energy Integration and Commercial Services  
2 Hanson Place 12th Floor  
Brooklyn, NY 11217

Developer:

Attention – Transmission  
3636 Nobel Drive, Suite 260  
San Diego, CA 92122

### Billings and Payments:

Connecting Transmission Owner:

~~[To be supplied.]~~

~~Interconnection Customer:~~

~~[To be supplied.]~~

Vishal Ahirrao  
2 Hanson Place 12th Floor  
Brooklyn, NY 11217

Developer:

Attention – Transmission  
3636 Nobel Drive, Suite 260  
San Diego, CA 92122

**Alternative Forms of Delivery of Notices (telephone, facsimile or email):**

~~NYISO:~~

~~[To be supplied.]~~

Connecting Transmission Owner:

Vishal Ahirrao – Director, Customer Energy Integration and Commercial Services  
2 Hanson Place 12th Floor  
Brooklyn, NY 11217  
Phone: (781) 907-3002  
E-mail: [Vishal.Ahirrao@nationalgrid.com](mailto:Vishal.Ahirrao@nationalgrid.com)

Developer:

Attention – Transmission  
[legal@innergex.com](mailto:legal@innergex.com)

## **APPENDIX G – OPERATION AND MAINTENANCE**

In accordance with Article 10.5 of this Agreement, Developer shall be responsible for all reasonable expenses (“O&M Expenses”) associated with the operation, maintenance, repair and replacement of Connecting Transmission Owner’s Attachment Facilities, as such facilities are detailed in Appendix A.

Developer shall have the option to pay such O&M Expenses either under the procedure described in Option 1 or in Option 2 below.

### **Option 1: Fixed On-Going Charge Payment**

Connecting Transmission Owner will invoice and Developer shall pay an annual payment to the Connecting Transmission Owner equal to the product of the Gross Plant Investment associated with the Connecting Transmission Owner Attachment Facility and the Annual Transmission Ongoing Charge Factor, for the term of this Agreement.

All payments due to be made by Developer shall be made within thirty (30) days after receiving an invoice from Connecting Transmission Owner.

The Project’s Gross Connecting Transmission Owner’s Attachment Facilities Plant Investment cost shall be established in writing by Connecting Transmission Owner no later than 90 days following the effective date of the agreement.

The Annual On-Going Charge Factor shall be calculated annually each July based on the Connecting Transmission Owner’s most recently filed FERC Form 1 data and will equal the sum of the Revenue Requirement Components as identified on O&M Attachment 1 divided by the Total Gross Plant of the Connecting Transmission Owner. Total Gross Plant shall equal the sum of Item Nos. A (1)(a)(b) and (c) in O&M Attachment 1.

### **Option 2: Annual Actual O&M Expenses**

Developer shall pay for all actual O&M Expenses incurred by Connecting Transmission Owner, which expenses shall be billed by Connecting Transmission Owner quarterly as accumulated during the calendar quarter for which they were incurred.

All payments due to be made by Developer shall be made within thirty (30) days after receiving an invoice from Connecting Transmission Owner, which invoice shall be issued after the end of each calendar quarter for the most recent quarter.

### **Selection by Developer**

Developer shall select which option for paying O&M Expenses by providing written notice to the Connecting Transmission Owner within thirty (30) days after receiving from the Connecting Transmission Owner the Gross Connecting Transmission Owner's Attachment Facilities Plant Investment cost and the most recent Annual Transmission Ongoing Charge Factor. If Developer fails to provide timely notice to Connecting Transmission Owner of the option selected, Developer will be deemed to have selected Option 2: Annual Actual O&M Expenses.

## **O&M ATTACHMENT 1**

Capitalized terms used in this calculation will have the following definitions:

### **Allocation Factors**

1. General Plant Allocation Factor shall equal Electric General Plant divided by the sum of Electric General Plant plus gas general plant as reported in the Annual Report filed with the New York State Public Service Commission.
2. Gross Transmission Plant Allocation Factor shall equal the total investment in Transmission Plant in Service divided by the sum of the total Transmission Plant in Service plus the total Distribution Plant in Service, excluding Intangible Plant, General Plant and Common Plant.
3. Transmission Wages and Salaries Allocation Factor shall equal the ratio of Connecting Transmission Owner's Transmission-related direct electric wages and salaries including any direct wages or salaries charged to Connecting Transmission Owner by a National Grid Affiliate to Connecting Transmission Owner's total electric direct wages and salaries including any wages charged to Connecting Transmission Owner by a National Grid Affiliate excluding any electric administrative and general wages and salaries.

### **Ratebase and Expense items**

1. Administrative and General Expense shall equal electric expenses as recorded in FERC Account Nos. 920-935.
2. Amortization of Investment Tax Credits shall equal electric credits as recorded in FERC Account No. 411.4.
3. Distribution Plant in Service shall equal the gross plant balance as recorded in FERC Account Nos. 360 – 374.
4. Electric Common Plant shall equal the balance of Common Plant recorded in FERC Account Nos. 389-399 multiplied by the General Plant Allocation Factor.
5. General Plant shall equal electric gross general plant balance recorded in FERC Account Nos. 389-399.
6. Materials and Supplies shall equal electric materials and supplies balance as recorded in FERC Account No. 154.
7. Payroll Taxes shall equal those electric payroll tax expenses as recorded in FERC Account Nos. 408.100, 408.110, and 408.130.
8. Prepayments shall equal electric prepayment balance as recorded in FERC Account No. 165.

9. Real Estate Tax Expenses shall equal electric transmission-related real estate tax expense as recorded in FERC Account No. 408.140 and 408.180.
10. Transmission Operation and Maintenance Expense shall equal electric expenses as recorded in FERC Account Nos. 560, 562-573.
11. Transmission Plant in Service shall equal the gross plant balance as recorded in FERC Account Nos. 350-359.
12. Transmission Revenue Credits shall equal the revenue reported in Account 456.
13. Transmission Related Bad Debt Expense shall equal Bad Debt Expense as reported in Account 904 related to transmission billing.
14. Wholesale Metering Cost shall equal any costs associated with any Revenue or Remote Terminal Unit (RTU) meters and associated equipment located at an internal or external tie at voltages equal to or greater than 23V. The cost shall be determined by multiplying the number of wholesale meters in FERC Account No. 370.3 by the average cost of the meters plus the average costs of installation.

In the event that the above-referenced FERC accounts are renumbered, renamed, or otherwise modified, the above sections shall be deemed amended to incorporate such renumbered, renamed, modified or additional accounts.

### **Revenue Requirement Components**

The Revenue Requirement Component shall be the sum of Connecting Transmission Owner's (A) Return and Associated Income Taxes, (B) Transmission Related Real Estate Tax Expense, (C) Transmission Related Amortization of Investment Tax Credits, (D) Transmission Related Payroll Tax Expense, (E) Transmission Operation and Maintenance Expense, (F) Transmission Related Administrative and General Expenses, less (G) Revenue Credits, plus (H) Bad Debt Expense.

A. Return and Associated Income Taxes shall equal the product of the Transmission Investment Base as identified in A(1) below and the Cost of Capital Rate.

1. Transmission Investment Base shall be defined as:

Transmission Related General Plant plus Transmission Related Common Plant plus Transmission Related Regulatory Assets plus Transmission Related Prepayments plus Transmission Related Materials and Supplies plus Transmission Related Cash Working Capital.

(a) Transmission Plant in Service shall equal the balance of Total investment in Transmission Plant plus Wholesale Metering Cost.

- (b) Transmission Related General Plant shall equal the balance of investment in General Plant multiplied by the Transmission Wages and Salaries Allocation Factor.
- (c) Transmission Related Common Plant shall equal Electric Common Plant multiplied by the Gross Transmission Plant Allocation Factor and multiplied by the Transmission Wages and Salaries Allocation Factor.
- (d) Transmission Related Regulatory Assets shall equal balances in FERC Account Nos. 182.3 and 254 for state and federal regulatory assets and liabilities related to FAS109, and excess AFUDC multiplied by the Gross Transmission Plant Allocation Factor.
- (e) Transmission Related Prepayments shall equal the electric balance of Prepayments multiplied by the Gross Transmission Plant Allocation Factor.
- (f) Transmission Related Materials and Supplies shall equal the balance of Materials and Supplies assigned to Transmission added to the remainder of Material and Supplies not directly assigned to either Transmission or Distribution multiplied by the Gross Transmission Plant Allocation Factor.
- (g) Transmission Related Cash Working Capital shall be a 12.5% allowance (45 days/360 days) of the Transmission Operation and Maintenance Expense (less FERC Account 565: Transmission of Electricity by Others) and Transmission-Related Administrative and General Expense.

## 2. Cost of Capital Rate

The Cost of Capital Rate shall equal the proposed Weighted Costs of Capital plus Federal Income Taxes and State Income Taxes.

- (a) The Weighted Costs of Capital will be calculated for the Transmission Investment Base using Connecting Transmission Owner's actual capital structure and will equal the sum of (i), (ii), and (iii) below:
  - (i) the long-term debt component, which equals the product of the actual weighted average embedded cost to maturity of Connecting Transmission Owner's long-term debt then outstanding and the actual long-term debt capitalization ratio;
  - (ii) the preferred stock component, which equals the product of the actual weighted average embedded cost to maturity of Connecting Transmission Owner's preferred stock then outstanding and the actual preferred stock capitalization ratio; and
  - (iii) the return on equity component, shall be the product of the allowed ROE of 11.9% plus a 50 basis point adder (per FERC Order 697

and 697A) and Connecting Transmission Owner's actual common equity capitalization ratio.

(b) Federal Income Tax shall equal

$$\frac{A \times \text{Federal Income Tax Rate}}{(1 - \text{Federal Income Tax Rate})}$$

where A is the sum of the preferred stock component and the return on equity component, each as determined in Sections 2.(a)(ii) and for the ROE set forth in 2.(a)(iii) above

(c) State Income Tax shall equal

$$\frac{(A + \text{Federal Income Tax}) \times \text{State Income Tax Rate}}{(1 - \text{State Income Tax Rate})}$$

Where A is the sum of the preferred stock component and the return on equity component as determined in A.2.(a)(ii) and A.2.(a)(iii) above and Federal income Tax is determined in 2.(b) above.

B. Transmission Related Real Estate Tax Expense shall equal the Real Estate Tax Expenses multiplied by the Gross Plant Allocation Factor.

C. Transmission Related Amortization of Investment Tax Credits shall equal the electric Amortization of Investment Tax Credits multiplied by the Gross Transmission Plant Allocation Factor.

D. Transmission Related Payroll Tax Expense shall equal Payroll Taxes multiplied by the Transmission Wages and Salaries Allocation Factor.

E. Transmission Operation and Maintenance Expense shall equal the Transmission Operation and Maintenance Expense as previously defined.

F. Transmission Related Administrative and General Expenses shall equal the sum of the electric Administrative and General Expenses multiplied by the Transmission Wages and Salaries Allocation Factor.

G. Revenue Credits shall equal all Transmission revenue recorded in FERC account 456.

H. Transmission Related Bad Debt Expense shall equal Transmission Related Bad Debt Expense as previously defined.

~~—————[To be supplied.]~~

~~—————Interconnection Customer:~~

—————[To be supplied.]